



SECTION IV

**WATER
DETAILS**

SECTION IV- WATER DETAILS**TABLE OF CONTENTS**

<u>TITLE</u>	<u>NUMBER</u>
Method of Testing Water Mains	W/1.0
2-inch Air Valve in Manhole for 24-inch Diameter and Smaller Pipelines	W/2.0
Vent Box for Extended Air Release Pipe	W/2.0a
Vent Box for Air/Vacuum Valve Vault On 30-inch Diameter and Larger Pipes	W/2.0b
Shallow Type 2-inch Air Valve in Manhole For 24-inch Diameters and Smaller Pipelines	W/2.0c
Shallow Type 2-inch Air Valve in Manhole For 24-inch Diameters and Smaller Pipelines	W/2.0d
Adjustable Valve Box Round Head Sliding Type	W/2.1
Extension Stems and Valve Boxes for Deep Valve Settings	W/2.2
16-inch, 20-inch, 24-inch, 30-inch and 36-inch Horizontal Valve Installations	W/2.40
16-inch, 20-inch, 24-inch, 30-inch and 36-inch Horizontal Valve Installations	W/2.4a
Cast in Place Concrete Vault for 16-inch, 20-inch and 24-inch Horizontal Valves	W/2.5
Cast in Place Concrete Vault for 30-inch and 36-inch Horizontal Valves	W/2.5a
16-inch and 20-inch Vertical Valves Installation	W/2.6
Cast in Place Concrete Vault for 16-inch and 20-inch Vertical Valves	W/2.7
Polyethylene Encasement at Concrete Interface	W/2.8
Type "A" Blowoff for Water Mains 16-inch to 30-inch	W/3.0
Endwall Detail for Type "B" Blowoff	W/3.01
Type "A" Blowoff for Water Mains 36-inch and Larger	W/3.02
Type "B" Blowoff for Water Mains 36-inch and Larger	W/3.03
Type "B" Blowoff Profiles for Water Mains 16-inch and Larger	W/3.04
Piping Support at Welded-on Connection	W/3.05
Welded-on Connection for Blowoffs on Mains 36-inch and Larger	W/3.06



Blow-off Connection in Non-Traffic Areas for 4-inch and 6-inch Water Mains	W/3.07
Blow-off Connection in Traffic Areas for 4-inch and 6-inch Water Mains	W/3.08
Pressure Reducing Valve Vault Type “1” Layout	W/4.2
Pressure Reducing Valve Vault Type “2” Layout	W/4.3
Type “1” and “2” Pressure Reducing Valve Vault Piping Layout	W/4.4
Pressure Relief Valve Vault	W/4.5
Endwall for Pressure Relief Valve Piping	W/4.6
Duel Pressure Relief Valve Vault	W/4.7
Pressure Relief Valve Vault Piping Plan	W/4.8
4-inch, 6-inch and 8-inch F.M. Meter Vault	W/5.0
4-inch, 6-inch, 8-inch, and 10-inch F.M. Meter Vault Piping Layout	W/5.0a
4-inch FM Meter with Check Valve Vault	W/5.0b
6-inch and 8-inch FM Meter with Check Valve Vault	W/5.0c
4-inch, 6-inch and 8-inch F.M. Meter with Check Valve in Vault Piping Layout	W/5.0d
Remote Reading Device for Meter location in Roadway	W/5.0e
Fire Hose Connection for FM Meter, Ultrasonic Meter and Detector Check Vault Layouts	W/5.0f
10-inch F.M. Meter Vault	W/5.0g
Fire Hose Connection in Traffic Areas for FM Meter, Ultrasonic Meter and Detector Check Vault Layouts	W/5.0h
10-inch FM Meter Vault with Check Valve Vault	W/5.0i
3-inch, 4-inch and 6-inch Compound Meter Vault	W/5.1
3-inch, 4-inch and 6-inch Compound Meter Vault Piping Layout	W/5.1a
Cast in Place Concrete Top Slab Reinforcing Details	W/5.2
Cast in Place Concrete Top Slab Reinforcing Details	W/5.21
Cast in Place Concrete Top Slab for Type “1” Layout Pressure Reducing Valve Vaults	W/5.22
Cast in Place Concrete Top Slab for duel pressure relief and Type “2” Layout	



Pressure Reducing Valve Vaults	W/5.23
Cast in Place Concrete Top Slab for Ultrasonic Meter, FM Meter and Detector Check Vaults	W/5.24
Cast in Place Concrete Top Slab for Ultrasonic Meter and FM meter with Check Valve Vault	W/5.25
Cast in Place Concrete Top Slab for 10-inch FM Meter with Check Valve Vault	W/5.26
Cast in Place Concrete Vault	W/5.3
Cast in Place Concrete Vault Notes	W/5.4
Top Slab Details for Vaults	W/5.5
3/4-inch Meter Setting for 1-inch Service	W/5.6
1-inch Meter Setting for 1-1/2-inch Service	W/5.7
1-1/2-inch Meter Settings for 2-inch Service	W/5.8
2-inch Meter Settings for 4-inch Service	W/5.9
2-inch Meter Settings for Existing 2-inch Meter Replacement	W/5.9a
1-inch, 1-1/2-inch and 2-inch Water House Connections for Inside Meters	W/5.10
1-inch, 1-1/2-inch and 2-inch Water House Connections for Inside Meters, Rural Type Paving Section	W/5.11
4-inch thru 12-inch Ductile Iron Water Connection	W/5.12
Location of Outside Meters for 1-inch, 1-1/2-inch & 2-inch Water House Connections Closed Paving Section	W/5.13
1-inch, 1-1/2-inch and 2-inch Water House Connections and Outside Meter Locations Rural Paving Sections	W/5.14
Double 3/4-inch Meter Setting	W/5.15
Double 1-inch Meter Setting	W/5.15a
Existing Outside Meter Temporary Water Service for Water Main Replacement	W/5.16
Existing Inside Meter Setting Temporary Water Service for Water Main Replacement	W.5.16a
Ductile Iron Pipe Load Chart	W/6.0
Polyvinyl Chloride (PVC) Pipe (AWWA C900/905) Load Chart	W/6.1




1-inch and Smaller Inside Water Meter Setting	W/7.1
1-1/2-inch Inside Water Meter Setting When Meter Room Is Not Adjacent to Exterior Building Walls	W/7.2a
1-1/2-inch Inside Water Meter Setting When Meter Room Is Adjacent to Exterior Building Walls	W/7.2b
2-inch Inside Water Meter Setting When Meter Room Is Not Adjacent to Exterior Building Walls	W/7.3a
2-inch Inside Water Meter Setting When Meter Room Is Adjacent to Exterior Building Walls	W/7.3b
3-inch, 4-inch and 6-inch Indoor Compound Meter When Meter Room Is Adjacent to Exterior Building Walls	W/7.4
3-inch, 4-inch and 6-inch Indoor Compound Meter When Meter Room Is Not Adjacent to Exterior Building Walls	W/7.5
4-inch, 6-inch and 8-inch Indoor FM Meter When Meter Room Is Adjacent to Exterior Building Walls	W/7.6
4-inch, 6-inch and 8-inch Indoor FM Meter When Meter Room Is Not Adjacent to Exterior Building Walls	W/7.7
3-inch and larger Indoor Detector Assembly When Meter Room Is Adjacent to Exterior Building Walls	W/7.8
3-inch and larger Indoor Detector Assembly When Meter Room Is Not Adjacent to Exterior Building Walls	W/7.9
Fire Hydrant Setting Closed Paving Section	W/8.0
Fire Hydrant Setting Open Paving Section	W/8.1
Continuity Test Station for AWWA C900 PVC Pipe	W/9.0
Continuity Test Station for AWWA C900 PVC Pipe at Fire Hydrant	W/9.1
Air/Vacuum Valve Vault On 30-inch Diameter and Larger Pipes	W/10.0
Details for Air/Vacuum Valve Vault on 30-inch Diameter and Larger Pipes	W/10.1
Air/Vacuum Valve Vault On 30-inch Diameter and Larger Pipes	W/10.2
Entry Port Vault for 36-inch to 48-inch Diameter Pipes	W/10.3
Blind Flange Details for Entry Port Vaults	W/10.4



Air/Vacuum Valve Vault and Entry Port Vault for 36-inch to 48-inch Diameter Pipes	W/10.5
Concrete Vault for Entry Ports	W/10.6
Cast In Place Concrete Top Slab Reinforcing for Air/Vacuum Valve Vault and Entry Port Vaults	W/10.7
Pipe Closure Joint Detail Using MJ Solid Sleeves	W/11.0
Pipe Closure Joint Detail For Exist. ACP Water Mains	W/11.1
4-inch, 6-inch, 8-inch and 10-inch Detector Check Vault for the Replacement of Existing Detector Check Only	W/12.0
Detector Check Vault Piping Layout for Replacement of Existing Detector Check Vaults Only	W/12.0a
Connecting to Existing PCCP Water Main using Ductile Iron Tee	W/13.0
Connecting to Existing PCCP Water Main for 2" and smaller Water Connections	W/13.1
4-inch, 6-inch and 8-inch Ultrasonic Meter Vault	W/14.0
10-inch Ultrasonic Meter Vault	W/14.0a
4-inch, 6-inch, 8-inch and 10-inch Ultrasonic Meter Vault Piping Layout	W/14.0b
4-inch, 6-inch 8-inch and 10-inch Ultrasonic Meter Vault Piping Layout	W/14.0c



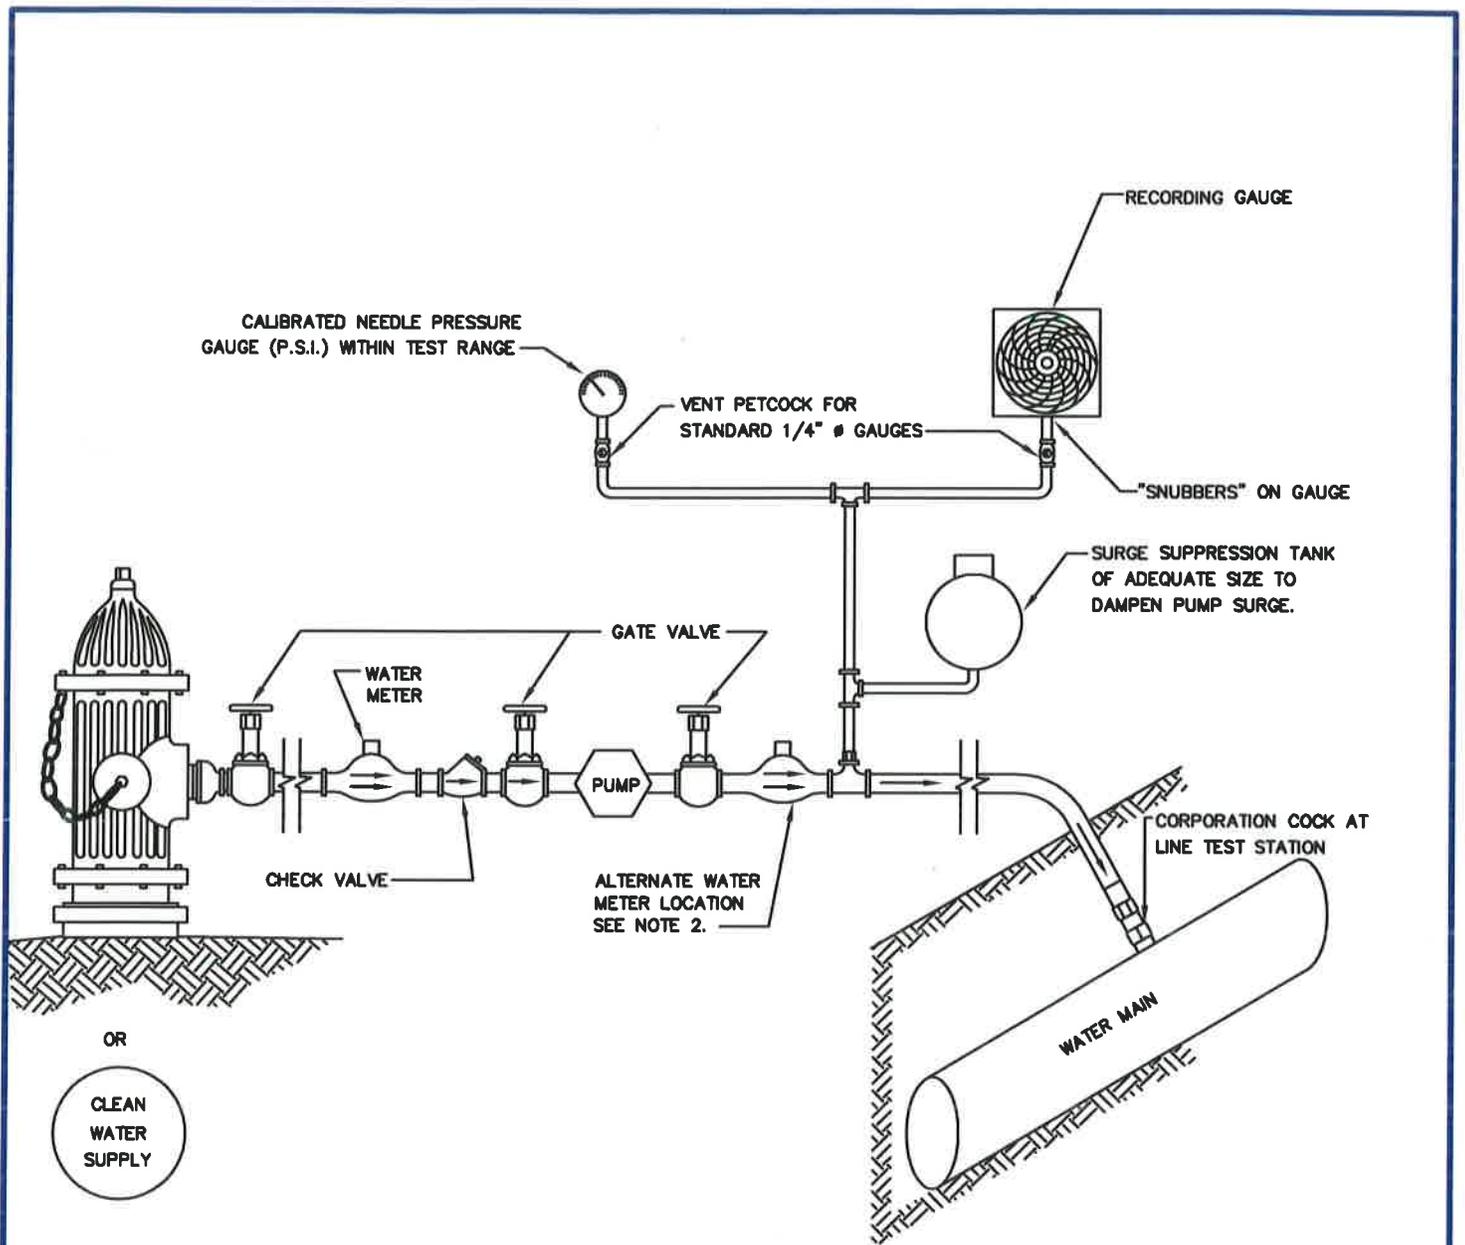

NOTES:

1. ALL LINES, FITTINGS AND TEST APPURTENANCES SHALL BE CAPABLE OF WITHSTANDING MAXIMUM TEST PRESSURE.
2. WHEN TEST PRESSURE IS LESS THAN PRESSURE RANGE OF METER, INSTALL METER AT ALTERNATE LOCATION SHOWN.
3. PROVIDE ADEQUATE PROTECTION TO ALL LINES, FITTINGS AND TEST APPURTENANCES WHEN TESTING DURING FREEZING WEATHER.
4. PUMP MUST BE CAPABLE OF APPLYING PRESSURE WITHIN TEST RANGE (PROVIDE FOR PRESSURE RELIEF ON PUMP).
5. ELEVATION OF TEST GAUGES MUST BE KNOWN

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 7/28/16


Chief Engineer

STANDARD DETAIL
METHOD OF TESTING
WATER MAINS


W
1.0

NOTES:

1. ALL FITTINGS BELOW AIR VALVE TO BE HEAVY DUTY THREADED UNPOLISHED BRASS UNLESS NOTED OTHERWISE.
2. PIPE TAP & ANGLE VALVE TO BE SAME SIZE AS AIR VALVE (2").
3. PROVIDE GRANULAR BEDDING UNDER MANHOLE PER DETAIL S/1.0.
4. VENT BOX TO BE INSTALLED OUTSIDE OF TRAVELED AREAS.
5. SEE DETAIL W/2.8 FOR POLYETHYLENE ENCASEMENT AT CONCRETE INTERFACE.

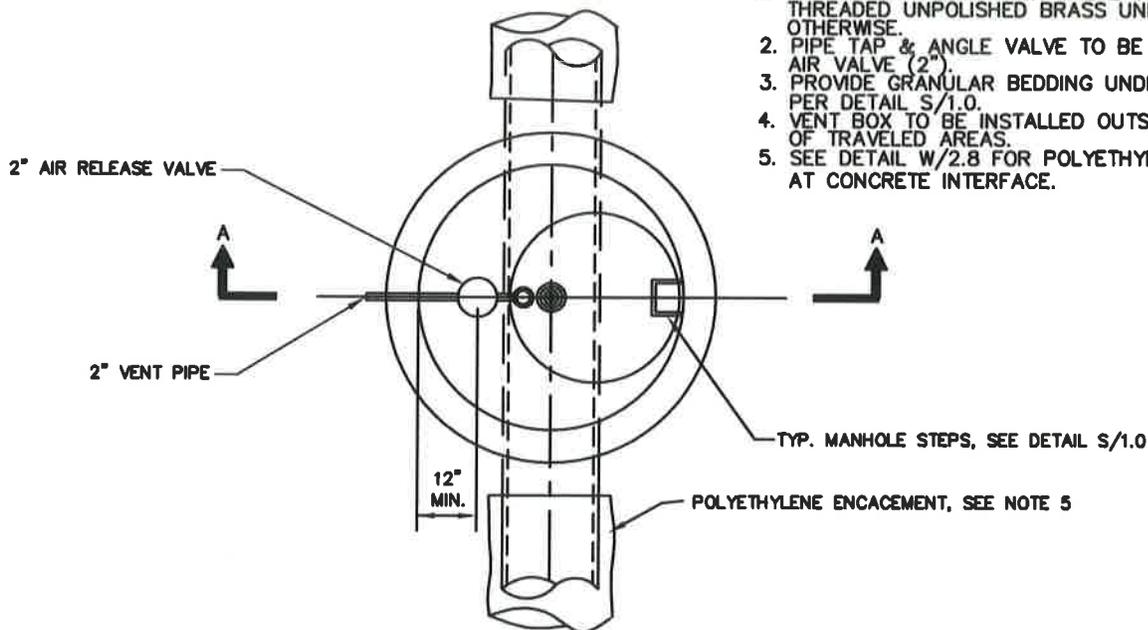

PLAN

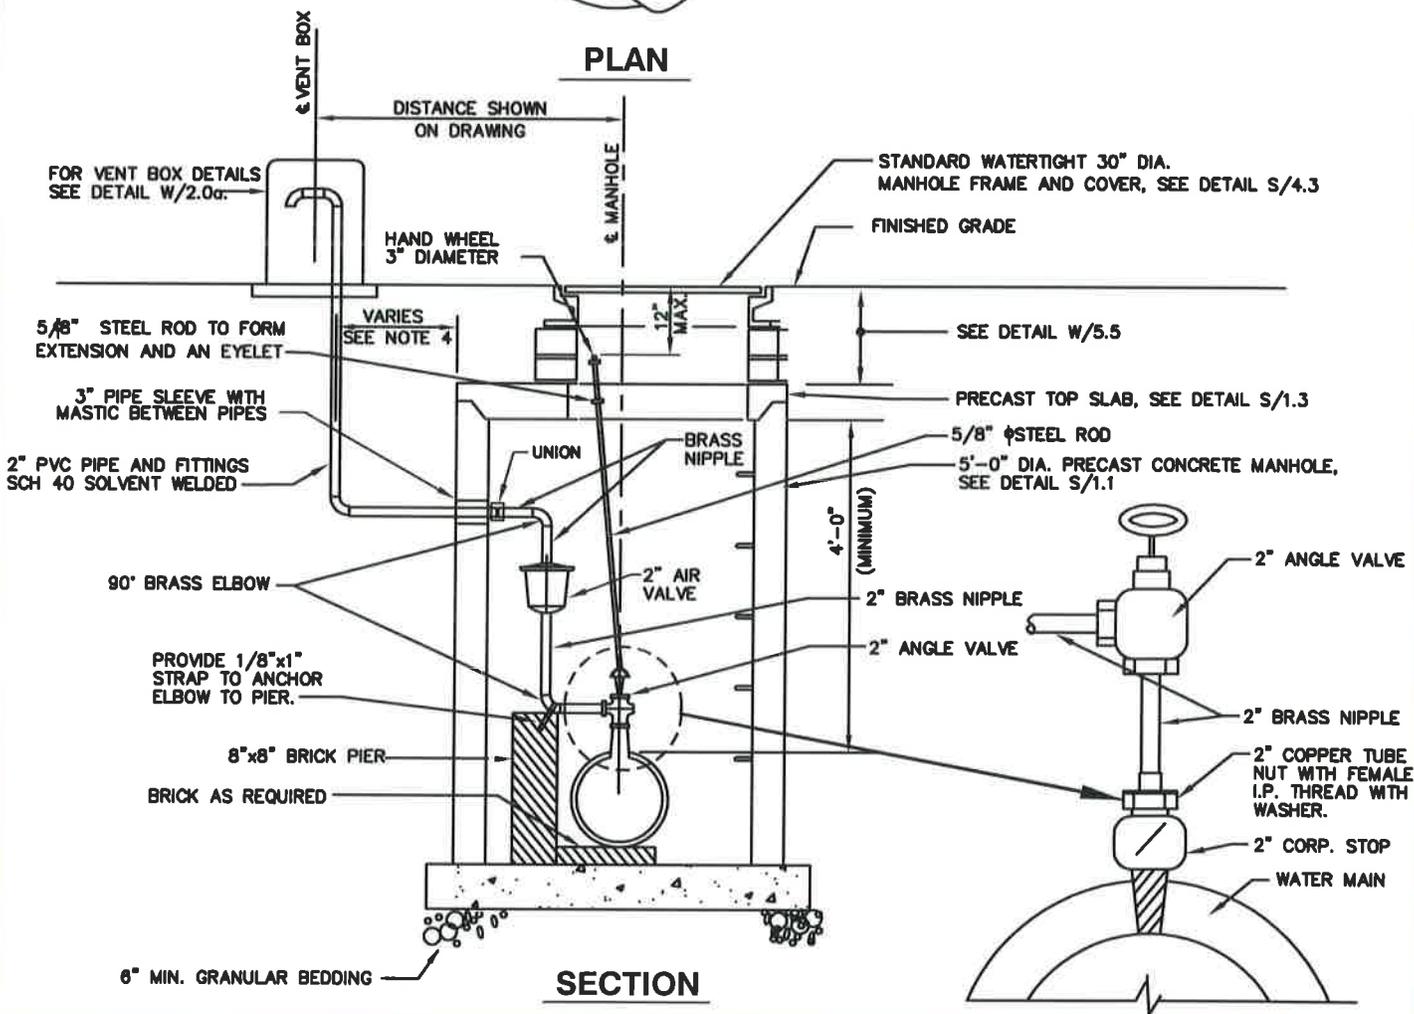

SECTION

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:


9/28/16

Chief Engineer


STANDARD DETAIL

2-INCH AIR VALVE IN MANHOLE
FOR 24-INCH DIAMETER AND
SMALLER PIPELINES


W
2.0

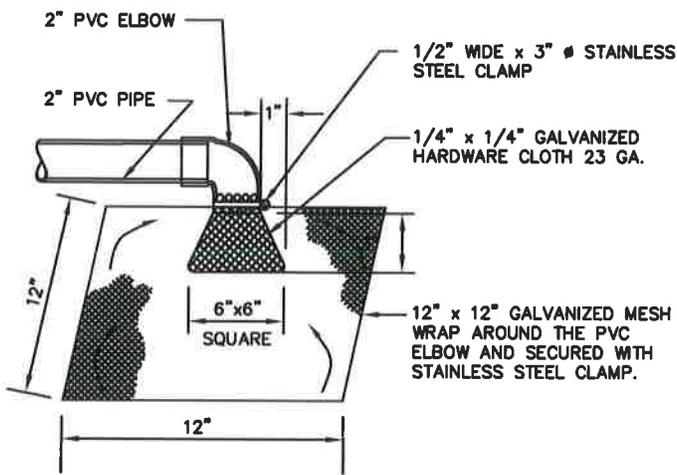

BIRD SCREEN DETAIL

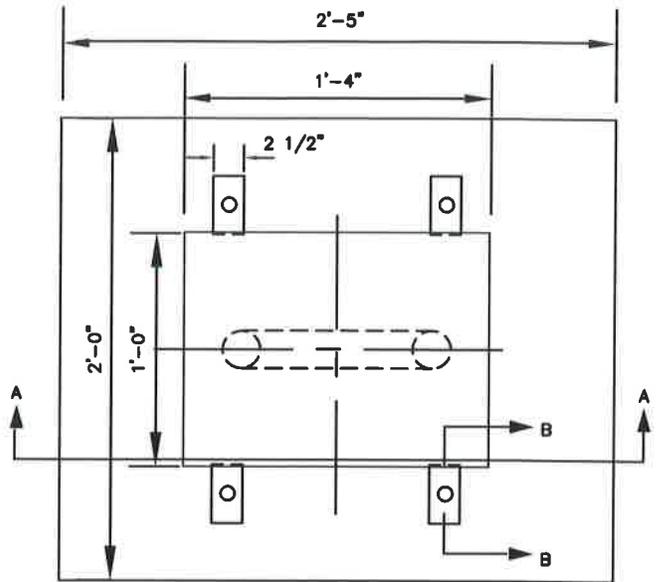

PLAN

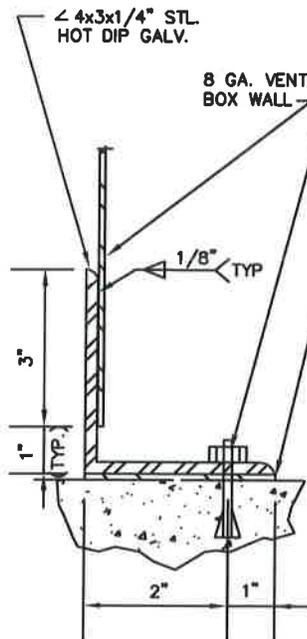

SECTION B-B

IN FLOOD PLAINS, THE VENT PIPE OUTLET SHALL BE 1'-0" MINIMUM ABOVE THE 100-YEAR FLOOD ELEVATION. SEE DRAWINGS FOR ELEVATION.

4-1/2" ϕ x 2 3/4" S.S. EXPANSION BOLT WITH WASHER. EMB. PER MANUFACTURER RECOMMENDATIONS (TYP 4)

1/8" NEOPRENE PAD

GRADE CONCRETE PAD TOWARDS SLOTS FOR POSITIVE DRAINAGE

FOR TOP SLAB ELEVATION, SEE DRAWINGS

FINISHED GRADE

CONCRETE PAD $f'_c=3000$ PSI

2" MIN. GRANULAR BEDDING

6 MIL POLYVINYL

WWM-4x4-W1.4xW1.4.

1'-0"x1'-4"x2'-0" 8 GA. GALVANIZED STEEL BOX.

2' MIN.

BIRD SCREEN, SEE DETAIL.

4-1/2" ϕ x 2 3/4" S.S. EXPANSION BOLT WITH WASHER. EMB. PER MANUFACTURER RECOMMENDATIONS (TYP 4)

1" TYPICAL

1/4"

1"

2" TYPICAL

4" MIN.

3" ϕ SLEEVE WITH MASTIC

2" ϕ PVC PIPE, SCH. 40, SOLVENT WELDED.

SECTION A-A

NOTES:

1. ALL METAL FABRICATION SHALL BE DONE IN ACCORDANCE WITH SPECIFICATION.
2. ALL WELDED JOINTS SHALL BE CONTINUOUS COMPLETE PENETRATION WELDS UNLESS OTHERWISE NOTED.
3. THE BOX ASSEMBLY SHALL BE HOT DIP GALVANIZED AFTER FABRICATION.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:

9/28/16

Chief Engineer

STANDARD DETAIL


VENT BOX FOR
EXTENDED AIR
RELEASE PIPE

W
2.0a

4-1/2" DIA. x 2-3/4" STAINLESS
STEEL EXPANSION BOLT WITH
WASHER, SEE DETAIL W/2.0a
(TYPICAL OF 4).

L 4"x3"x1/4" HOT DIP STEEL
SEE DETAIL W/2.0a
(TYPICAL OF 4).


2" PVC VENT PIPE,
SEE DETAILS W/10.1 AND W/2.0a

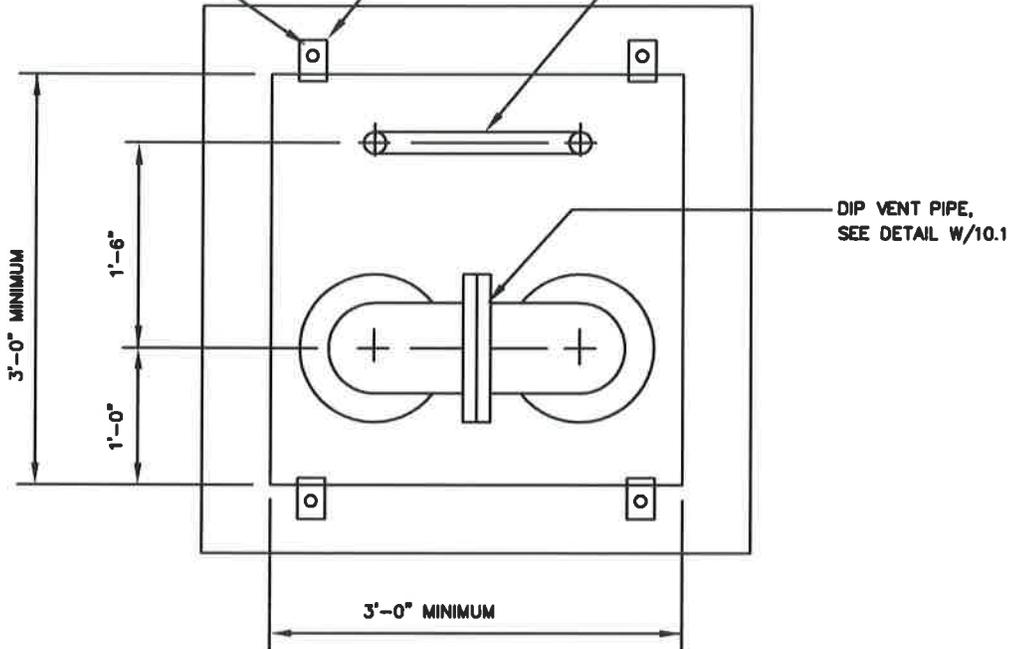

NOTE:

SEE DETAIL W/2.0a FOR
NOTES, SIZES AND DETAILS
NOT SHOWN.

PLAN

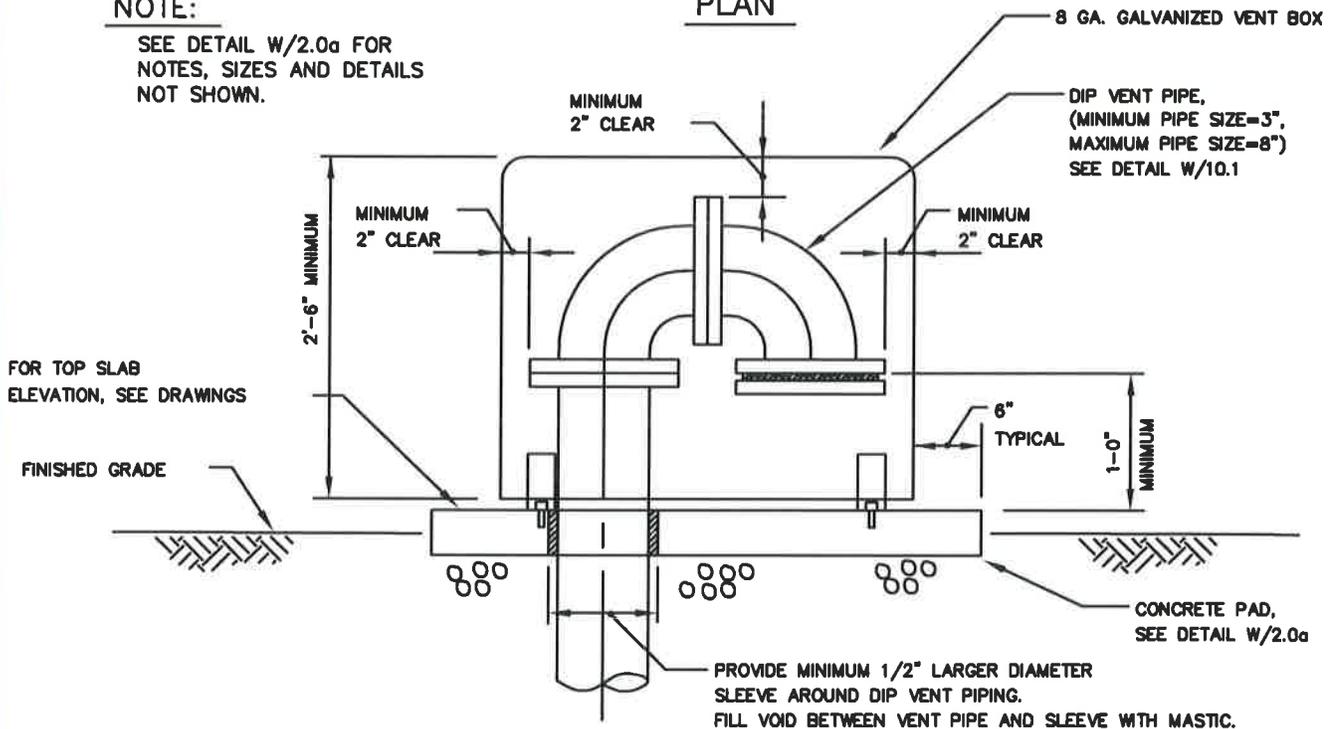

SECTION

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:

9/28/16


[Signature]
Chief Engineer

STANDARD DETAIL
VENT BOX FOR
AIR/VACUUM VALVE VAULT
ON 30-INCH DIAMETER
AND LARGER PIPES


W
2.0b

NOTES:

1. FOR ADDITIONAL INFORMATION, SEE STD DETAILS W/2.0 AND W/2.0a
2. FOR SECTIONS A-A AND B-B, SEE DETAIL W/2.0d
3. SEE DETAIL W/2.8 FOR V-BIO POLYETHYLENE ENCASEMENT AT CONCRETE INTERFACE.

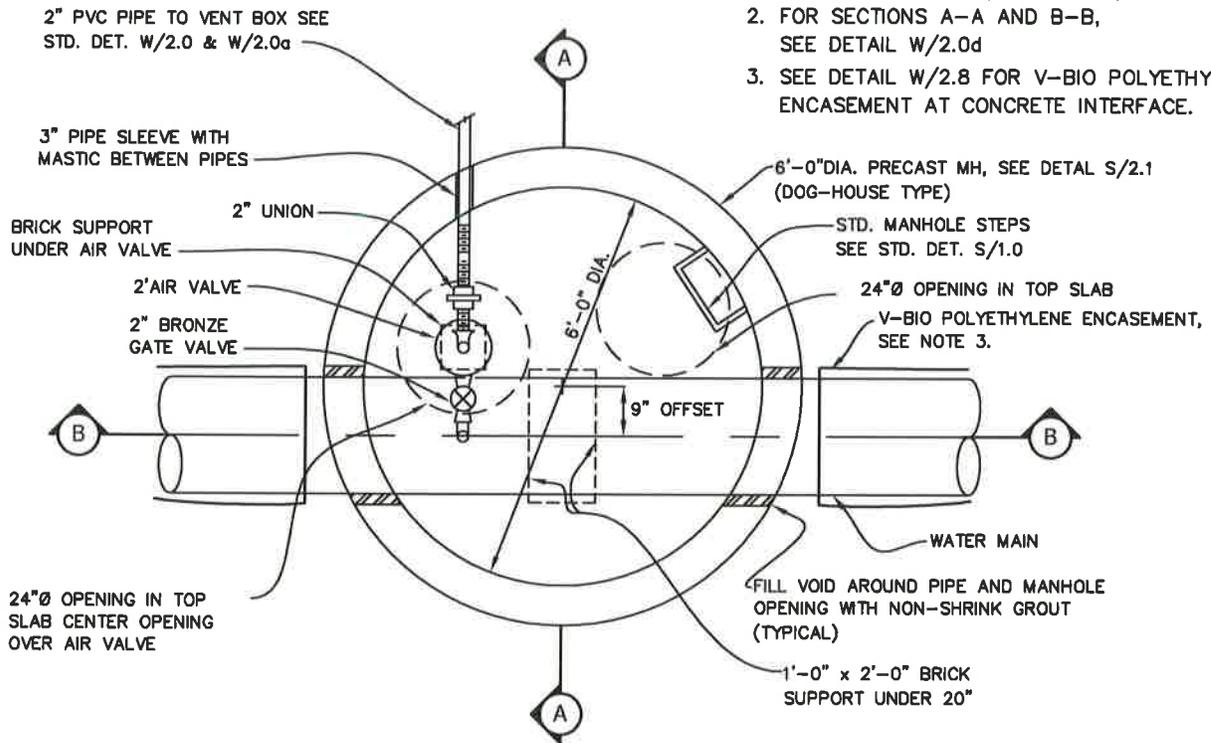

AIR VALVE MANHOLE - PLAN

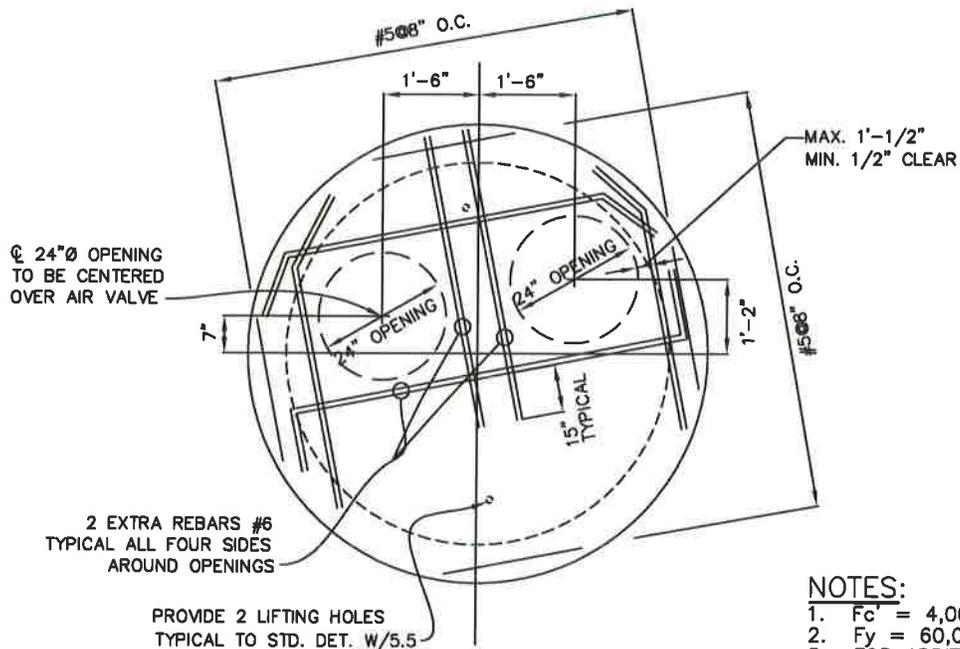

TOP SLAB - PLAN

NOTES:

1. $F_c = 4,000\text{PSI} @ 28 \text{ DAY}$
2. $F_y = 60,000 \text{ PSI}$
3. FOR ADDITIONAL INFORMATION SEE SPECIFICATION SECTION 03300


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/10


Chief Engineer

STANDARD DETAIL
SHALLOW TYPE
2-INCH AIR VALVE IN MANHOLE
FOR 24-INCH DIAMETER AND
SMALLER PIPELINES

W
2.0c

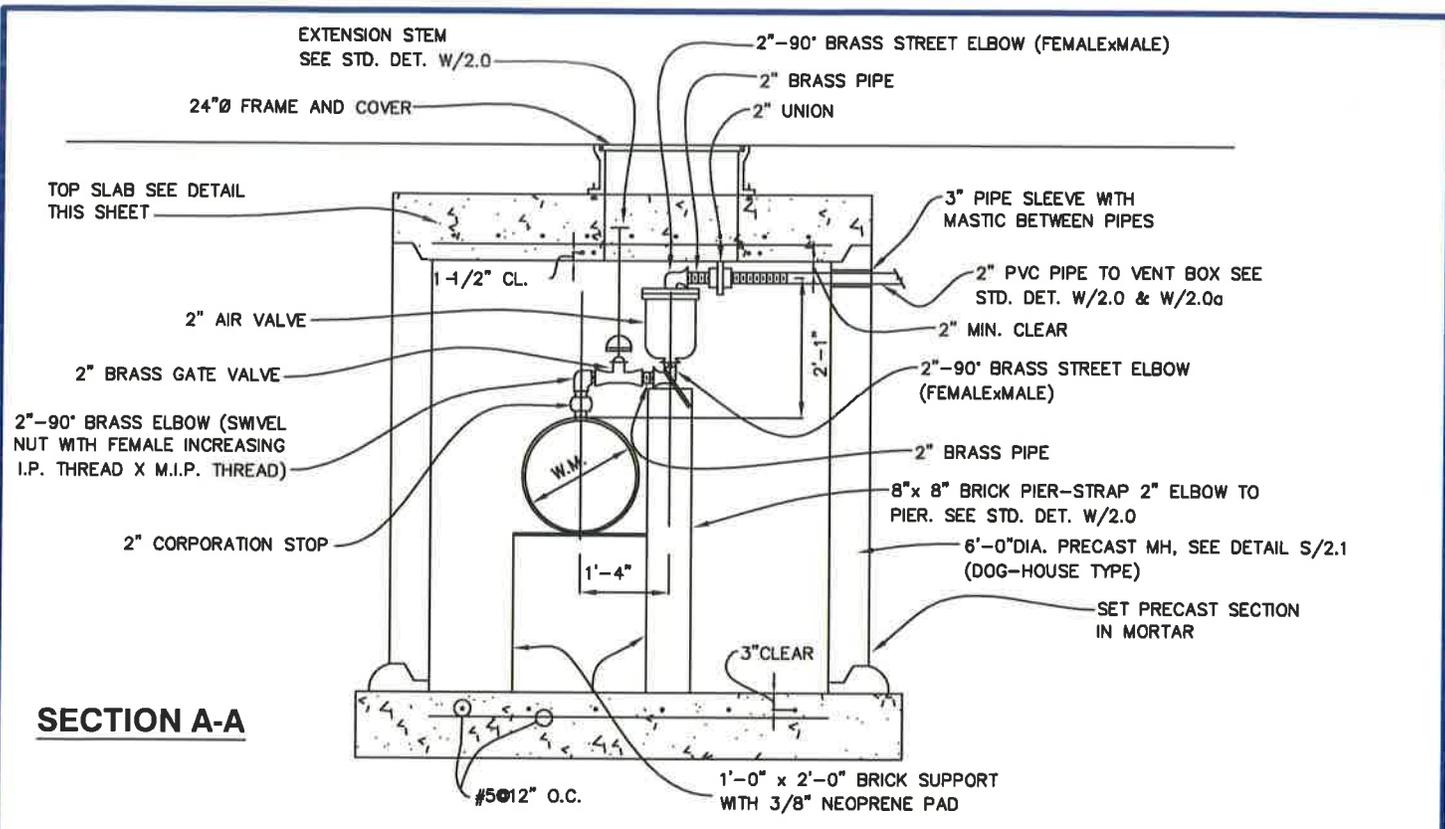

SECTION A-A

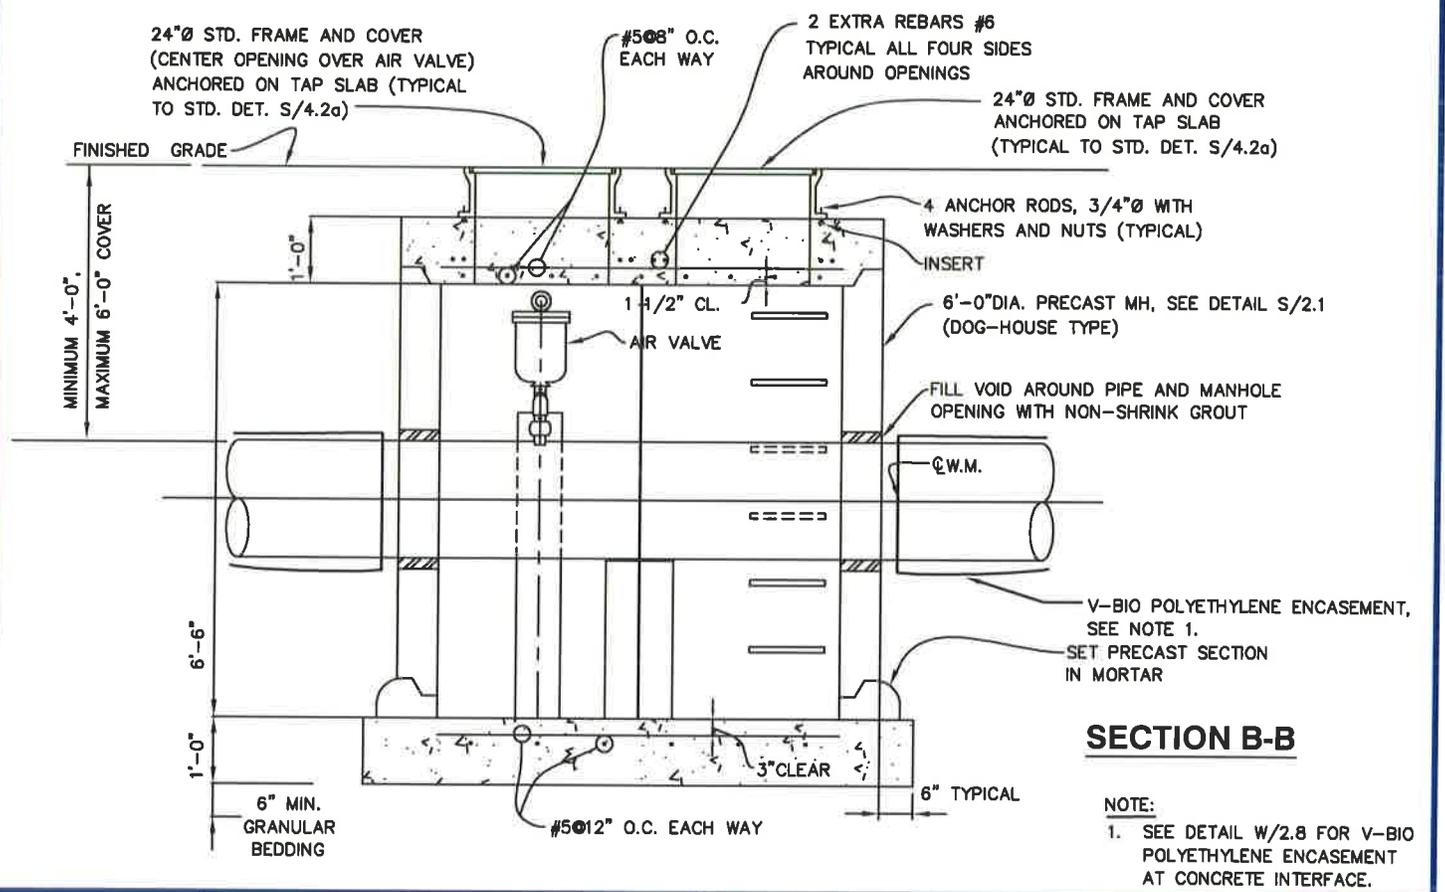

SECTION B-B

NOTE:
 1. SEE DETAIL W/2.8 FOR V-BIO POLYETHYLENE ENCASEMENT AT CONCRETE INTERFACE.




WASHINGTON
 SUBURBAN
 SANITARY
 COMMISSION

APPROVED: 9/28/16

 Chief Engineer

STANDARD DETAIL
 SHALLOW TYPE
 2-INCH AIR VALVE IN MANHOLE
 FOR 24-INCH DIAMETER AND
 SMALLER PIPELINES

W
 2.0d

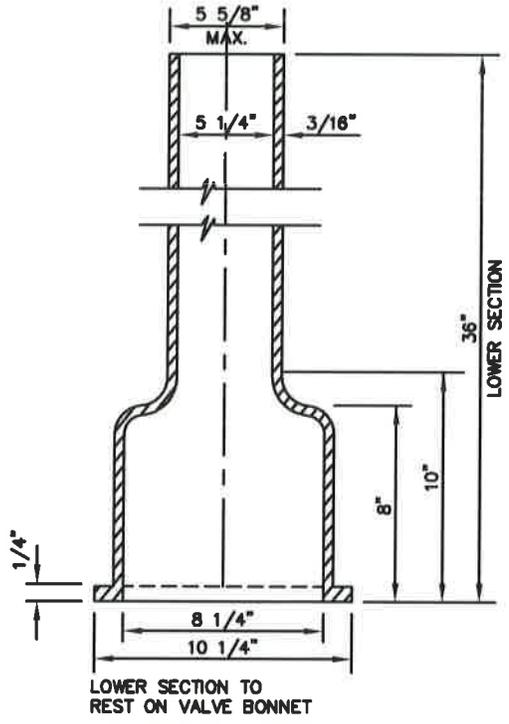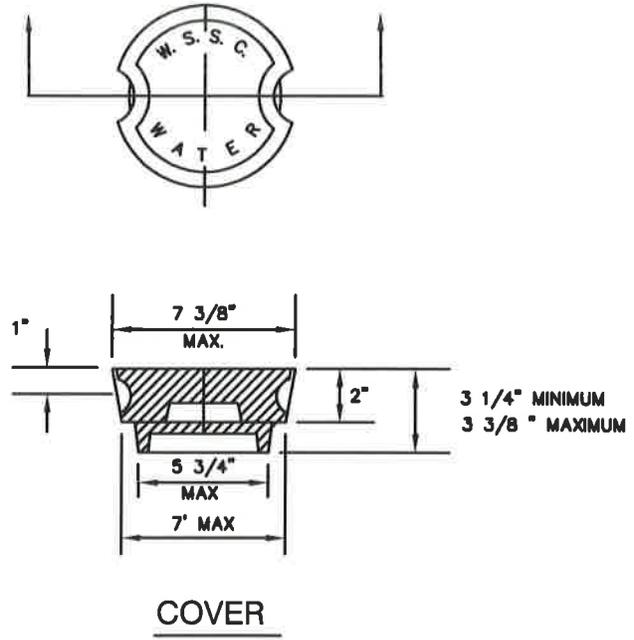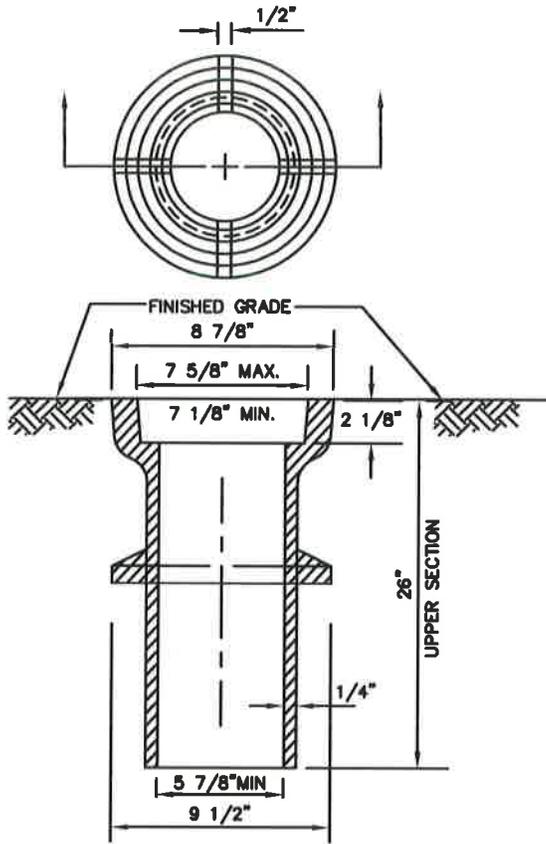


NOTE:



ALL SECTIONS SHOWN TO BE GRAY.
IRON CASTINGS, CLASS NO. 25 ASTM A-48

WEIGHTS:


LID - 15 LBS.
TOP SECTION - 52 LBS.
BOTTOM SECTION - 48 LBS
TOTAL - 115
MINUS WEIGHT TOLERANCE 5%

UPPER AND LOWER VALVE BOX SECTION

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/23/16</u>  Chief Engineer	STANDARD DETAIL ADJUSTABLE VALVE BOX ROUND HEAD SLIDING TYPE	W 2.1
--	---	---	----------

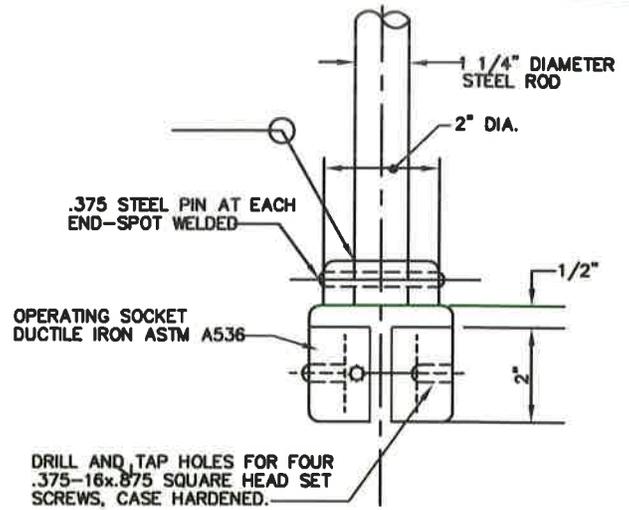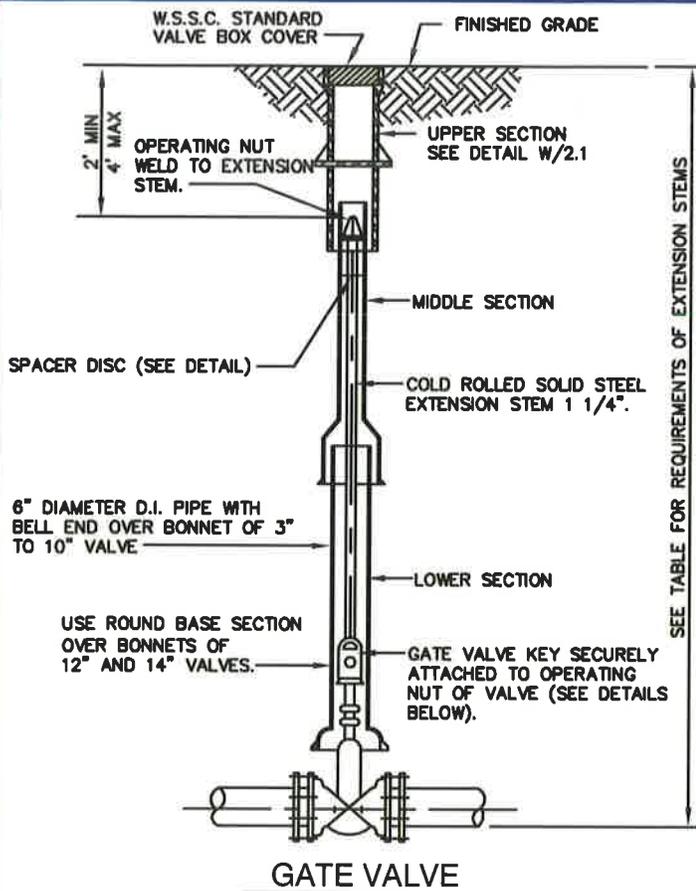



STANDARD

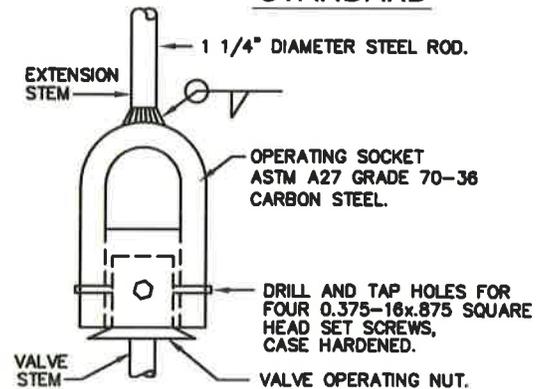


OPTION

WHEN EXTENSION STEMS ARE REQUIRED

SIZE OF WATER MAIN	DISTANCE FROM FINISHED GRADE TO INVERT OF WATER MAIN EXCEEDS
4" W	5.3'
6" W	5.7'
8" W	6.1'
10" W	6.5'
12" W	6.9'
16" W	7.5'

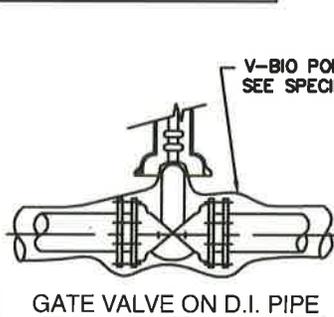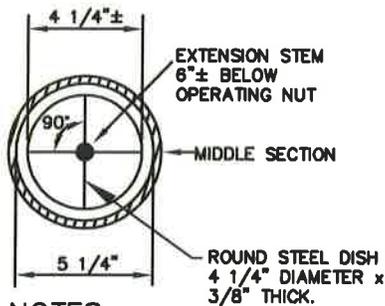

GATE VALVE ON D.I. PIPE

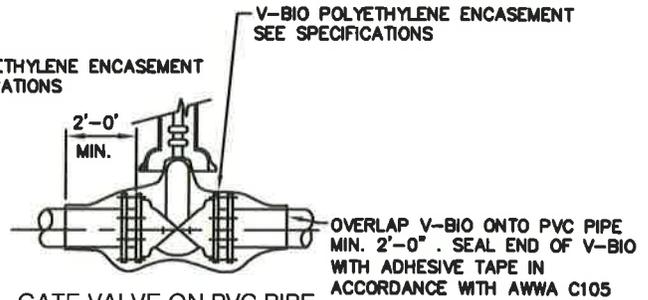

GATE VALVE ON PVC PIPE

NOTES:

1. EXTENSION TO BE SECURELY WELDED TO GATE VALVE KEY. STEM MATERIAL COMPOSITION SHALL COMPLY WITH ASTM A108.
2. LENGTH OF STEM TO BE SUCH THAT OPERATING NUT WILL BE LOCATED AS INDICATED ABOVE.
3. WELD STEEL DISH 4-1/4" DIAMETER x 3/8" THICK TO EXTENSION STEM TO INSURE OPERATING NUT IS CENTERED WITHIN VALVE BOX.
4. COAT EXTENSION STEM WITH FIELD APPLIED COATING, SPECIFICATIONS.
5. USE THIS DETAIL WHEN DISTANCE FROM TOP OF OPERATING NUT OF VALVE TO INVERT OF WATER MAIN EXCEEDS THE DIMENSIONS SHOWN ON TABLE.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/25/16


Chief Engineer

STANDARD DETAIL
**EXTENSION STEMS AND
VALVE BOXES FOR
DEEP VALVE SETTINGS**

W
2.2

RUBBER ANNULAR HYDROSTATIC SEALING DEVICES, SEE NOTE 6.

FLANGED HORIZONTAL GATE VALVE

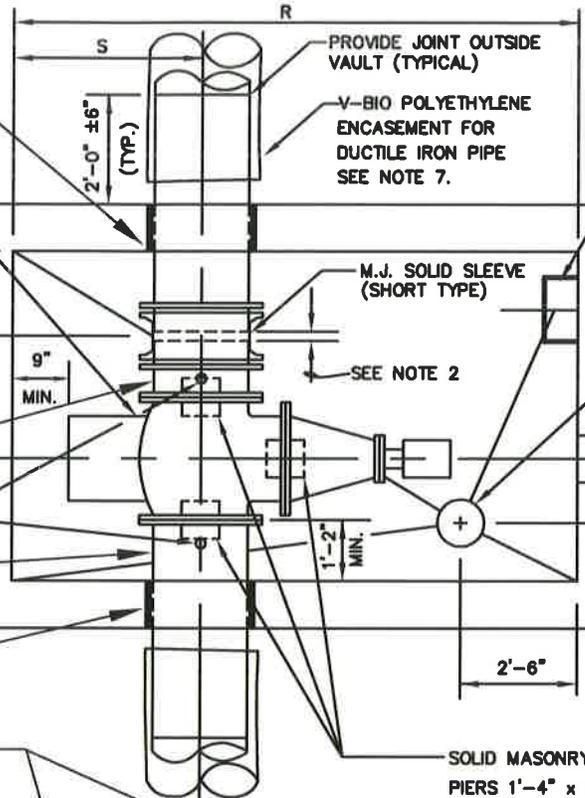

NOTES:

FOR SIZES AND NOTES SEE DETAIL W/2.4a

ALUMINUM LADDER SEE DETAIL M/16.0

U
MINIMUM

FLG X PE
2'-0" LONG

TAP FOR/CORP. STOP (SEE NOTE 3)

FLG X PE
5'-0" LONG

RUBBER ANNULAR HYDROSTATIC SEALING DEVICES, SEE NOTE 6.

VALVE BOXES CENTERED OVER VALVE OPERATING NUT, SEE DETAIL W/5.5

REMOVABLE TOP SLAB SEE DETAILS W/2.5, W/2.5a AND W/5.2


PLAN

SOLID MASONRY OR CONCRETE PIERS 1'-4" x 2'-0" (TYPICAL OF 3)

30" FRAME AND COVER SEE DETAIL W/5.5

FINISHED GRADE

MINIMUM, SEE DETAIL W/5.5
MAXIMUM 5'-0"

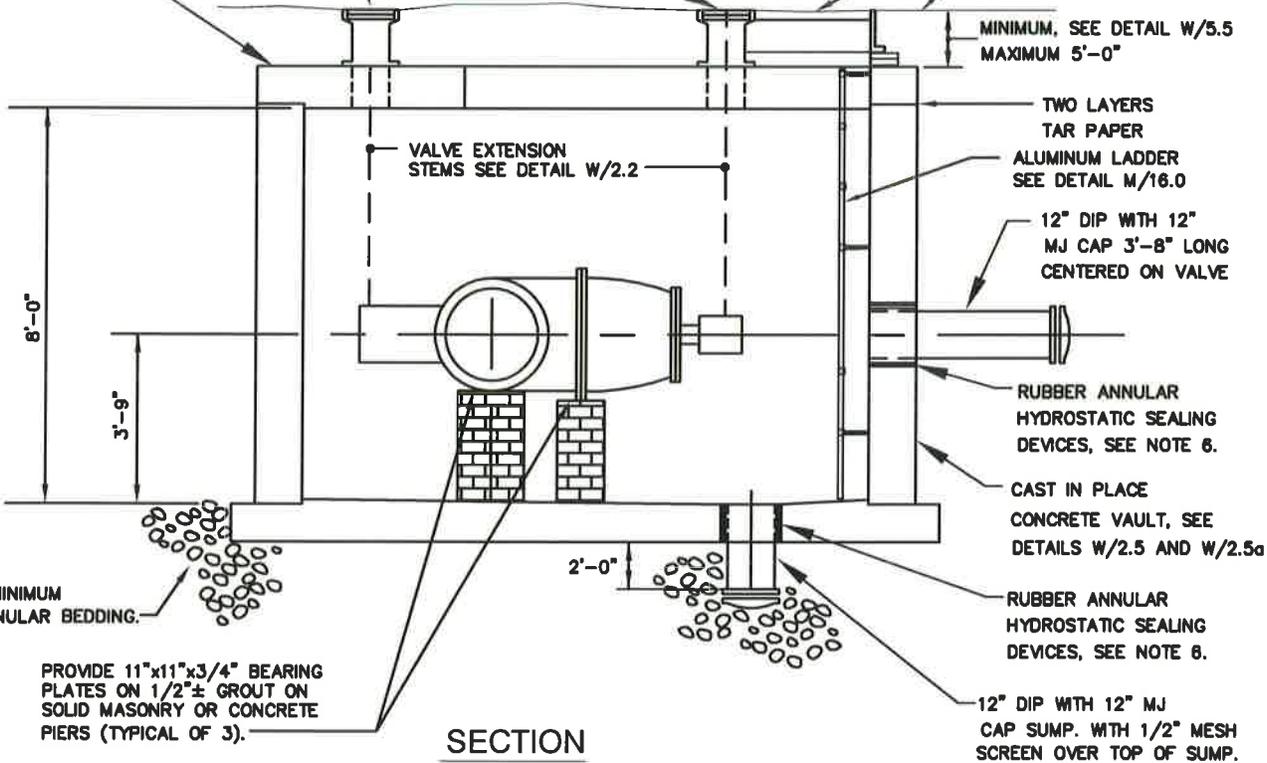

SECTION

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:

9/28/16

[Signature]
Chief Engineer


STANDARD DETAIL
16-INCH, 20-INCH, 24-INCH, 30-INCH
AND 36-INCH
HORIZONTAL VALVE
INSTALLATIONS


W
2.4

PIPE SIZE	VALVE SIZE	R	S	P	T	U (MIN.)
16"	16"	11'-0"	3'-6"	7'-0"	2'-4"	1'-5"
20"	20"	11'-0"	3'-6"	7'-0"	2'-4"	1'-5"
24"	24"	12'-0"	4'-0"	7'-0"	2'-4"	1'-5"
30"	30"	14'-0"	4'-6"	8'-6"	2'-7"	2'-0"
36"	36"	16'-0"	5'-0"	8'-6"	2'-7"	2'-0"

NOTES:


1. THIS VALVE VAULT IS NOT FOR ELECTRICALLY OPERATED VALVES.
2. PROVIDE SHORT TYPE MJ SOLID SLEEVE WITH WEDGE ACTION RESTRAINED JOINTS, SEE SPECIFICATIONS. TOLERANCE BETWEEN PIPE ENDS SHALL NOT EXCEED 1/2". DO NOT USE PIPE SPACERS, SEE SPECIFICATIONS.
3. TAP SIZES FOR CORPORATION STOPS: 1-1/2" FOR 16" AND 20" DIAMETER PIPE, 2" FOR 24" DIAMETER PIPE AND LARGER.
4. FOR STRUCTURAL DETAILS SEE DETAILS W/2.5 AND W/2.5a.
5. PROVIDE FLANGE BOLT END PROTECTION FOR ALL FLANGED JOINTS IN VAULTS, SEE SPECIFICATIONS.
6. PROVIDE RUBBER ANNULAR HYDROSTATIC SEALING DEVICES FOR PIPE THROUGH WALL CONNECTIONS, SEE SPECIFICATIONS. PROVIDE PIPE OPENING LARGE ENOUGH TO ALLOW FLANGE OR BELL JOINT TO PASS THROUGH.
7. SEE DETAIL W/2.8 FOR POLYETHYLENE ENCASEMENT AT CONCRETE INTERFACE.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u>  Chief Engineer	STANDARD DETAIL 16-INCH, 20-INCH, 24-INCH, 30-INCH AND 36-INCH HORIZONTAL VALVE INSTALLATIONS	<u>W</u> 2.4a
--	---	---	------------------

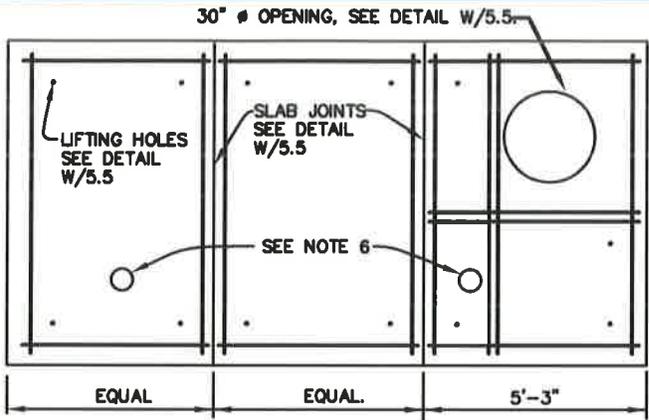


SEE DETAIL W/5.2 FOR TOP SLAB THICKNESS AND REINFORCEMENT

TOP SLAB-PLAN

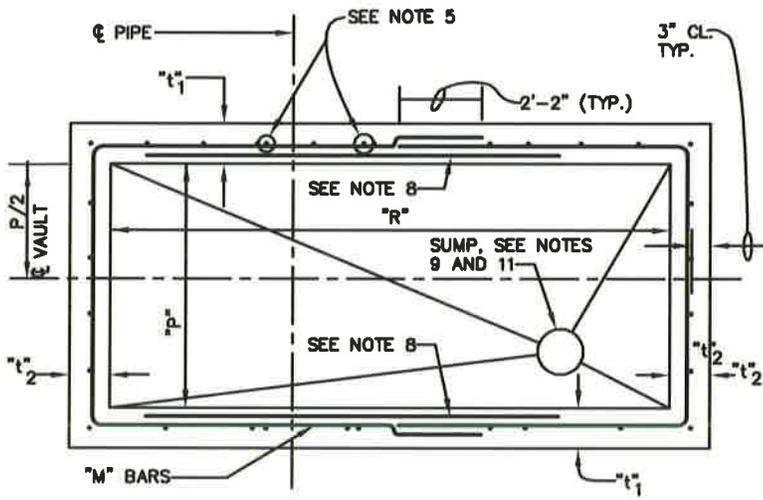

PLAN-TOP SLAB REMOVED

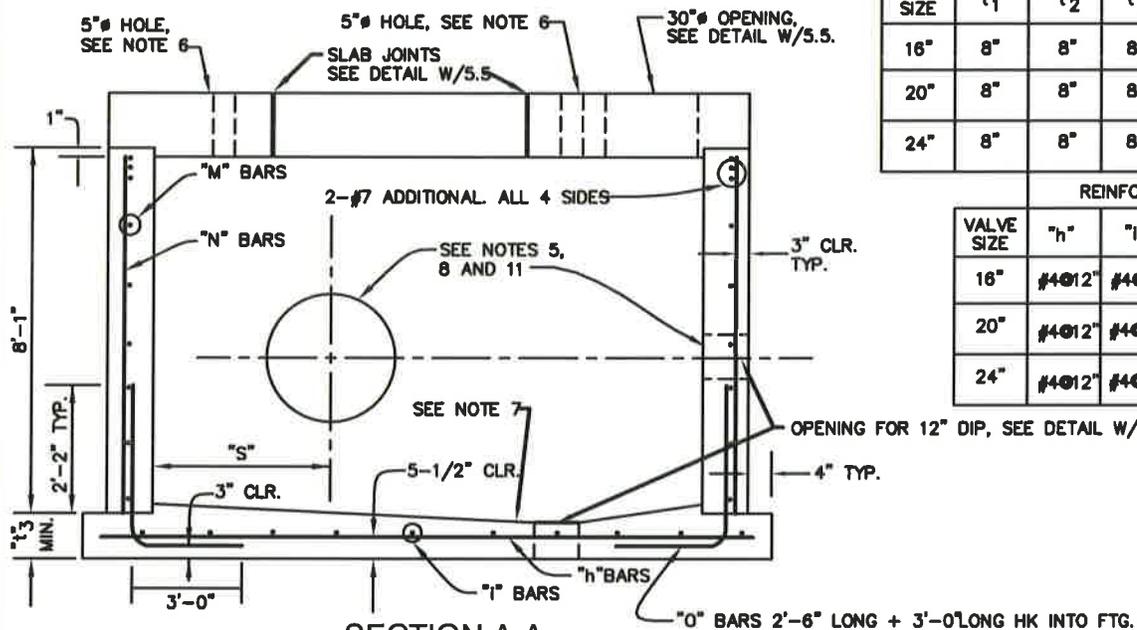

SECTION A-A

CAST IN PLACE CONCRETE VAULT NOTES

1. $f'_c = 4000$ PSI. ● 28 DAYS
2. $f_y = 60,000$ PSI.
3. VAULTS ARE DESIGNED FOR THE FOLLOWING CONDITIONS
 - A. H₂O LOADING & 1'-0" COVER + IMPACT (WATER TABLE 4'-0" BELOW FINISHED GRADE)
 - B. 5'-0" COVER & 2'-0" SURCHARGE. (WATER TABLE 4'-0" BELOW FINISHED GRADE)
4. PRECAST VAULT.
 - A. CONTRACTOR MAY USE PRECAST VAULTS, SEE SPECIFICATIONS FOR SUBMITTAL REQUIREMENTS.
 - B. MONOLITHICALLY CASE WALLS AND BASE SLAB.
 - C. IF THE BOTTOM SLAB IS NOT SLOPED, PROVIDE MINIMUM 1" THICK CEMENT MORTAR WEARING COURSE SLOP TO SUMP ● 1/4"/LF.
5. PROVIDE ADDITIONAL "N" BARS 6'-0" LONG EACH SIDE OF ALL PIPES PASSING THROUGH WALLS.
6. PROVIDE 5" Ø HOLE IN TOP SLAB CENTERED OVER VALVE OPERATING NUTS. PROVIDE VALVE BOXES PER DETAIL W/5.5.
7. SLOPE BASE OF VAULT TO DRAIN ● 1/4" LF.
8. PROVIDE ADDITIONAL. "M" BARS x 6'-0" LONG TOP & BOTTOM OF ALL PIPES PASSING THRU WALL.
9. FOR SUMP SEE DETAILS W/2.4 AND W/2.4a.
10. FOR PIPING AND VALVE CONFIGURATION AND ADDITIONAL DETAILS, SEE DETAILS W/2.4 AND W/2.4a.
11. PROVIDE RUBBER ANNULAR HYDROSTATIC SEALING DEVICES FOR PIPE THROUGH WALL CONNECTIONS, PROVIDE PIPE OPENING LARGE ENOUGH TO ALLOW FLANGE OR BELL JOINT TO PASS THROUGH.

VALVE SIZE	t ₁	t ₂	t ₃	"P"	"R"	"S"
16"	8"	8"	8"	7'-0"	11'-0"	3'-6"
20"	8"	8"	8"	7'-0"	11'-0"	3'-6"
24"	8"	8"	8"	7'-0"	12'-0"	4'-0"

REINFORCING BAR SIZES					
VALVE SIZE	"h"	"i"	"m"	"n"	"o"
16"	#4@12"	#4@12"	#5@12"	#5@8"	#6@8"
20"	#4@12"	#4@12"	#5@12"	#5@8"	#6@8"
24"	#4@12"	#4@12"	#5@12"	#5@8"	#6@8"

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer


STANDARD DETAIL
CAST IN PLACE CONCRETE
VAULT FOR 16-INCH, 20-INCH, AND
24-INCH HORIZONTAL VALVES

W
2.5

30" Ø OPENING, SEE DETAIL W/5.5.

CAST IN PLACE CONCRETE VAULT NOTES


1. $f'_c = 4000$ PSI. @ 28 DAYS
2. $f_y = 60,000$ PSI.
3. VAULTS ARE DESIGNED FOR THE FOLLOWING CONDITIONS
 - A. H2O LOADING & 1'-0" COVER + IMPACT (WATER TABLE 4'-0" BELOW FINISHED GRADE)
 - B. 5'-0" COVER & 2'-0" SURCHARGE. (WATER TABLE 4'-0" BELOW FINISHED GRADE)
4. PRECAST VAULT.
 - A. CONTRACTOR MAY USE PRECAST VAULTS, SEE SPECIFICATIONS FOR SUBMITTAL REQUIREMENTS.
 - B. MONOLITHICALLY CASE WALLS AND BASE SLAB.
 - C. IF THE BOTTOM SLAB IS NOT SLOPED, PROVIDE MINIMUM 1" THICK CEMENT MORTAR WEARING COURSE SLOP TO SUMP @ 1/4"/LF.
5. PROVIDE ADDITIONAL "N" BARS 6'-0" LONG EACH SIDE OF ALL PIPES PASSING THROUGH WALLS.
6. PROVIDE 5" Ø HOLE IN TOP SLAB CENTERED OVER VALVE OPERATING NUTS. PROVIDE VALVE BOXES PER DETAIL W/5.5.
7. SLOPE BASE OF VAULT TO DRAIN @ 1/4"/LF.
8. PROVIDE ADDITIONAL. "M" BARS x 6'-0" LONG TOP & BOTTOM OF ALL PIPES PASSING THRU WALL.
9. FOR SUMP SEE DETAILS W/2.4 AND W/2.4a.
10. FOR PIPING AND VALVE CONFIGURATION AND ADDITIONAL DETAILS, SEE DETAILS W/2.4 AND W/2.4a.
11. PROVIDE RUBBER ANNULAR HYDROSTATIC SEALING DEVICES FOR PIPE THROUGH WALL CONNECTIONS, PROVIDE PIPE OPENING LARGE ENOUGH TO ALLOW FLANGE OR BELL JOINT TO PASS THROUGH.

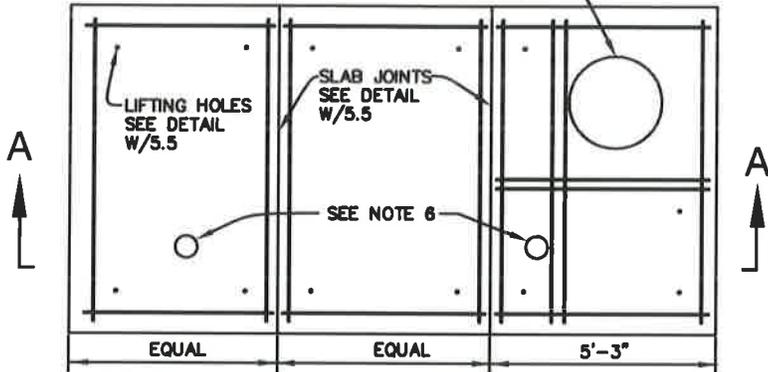

SEE DETAIL W/5.2 FOR TOP SLAB THICKNESS AND REINFORCEMENT

NOTE: FOR 30" AND 36" VALVES VAULTS REFER TO DETAIL W/5.21, "Q" 9'-0", THICKNESS AND REINFORCING

TOP SLAB-PLAN

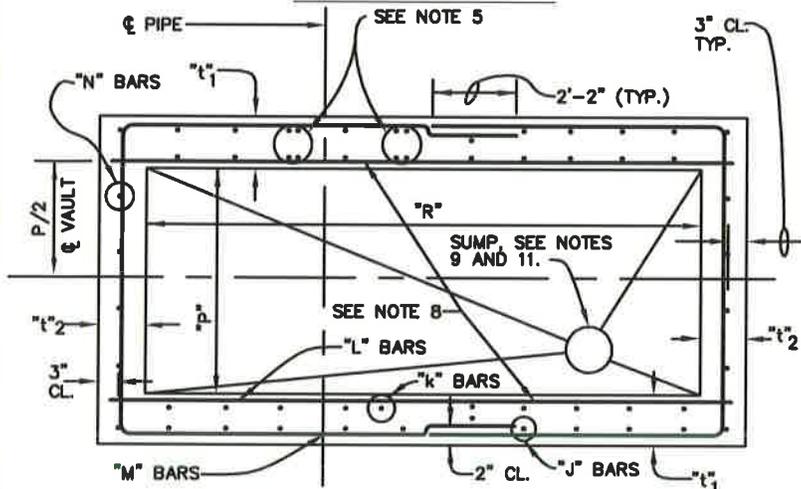


PLAN-TOP SLAB REMOVED

VALVE SIZE	t ₁	t ₂	t ₃	"P"	"R"	"S"
30"	10"	8"	8"	8'-6"	14'-0"	4'-6"
36"	12"	8"	8"	8'-6"	16'-0"	5'-0"

REINFORCING BAR SIZES				
VALVE SIZE	"h"	"i"	"j"	"k"
30"	#4@12"	#5@5"	#5@7"	#4@12"
36"	#4@12"	#5@5"	#5@8"	#4@10"

REINFORCING BAR SIZES				
VALVE SIZE	"l"	"m"	"n"	"o"
30"	#4@10"	#5@7"	#5@7"	#5@7"
36"	#4@12"	#5@8"	#5@8"	#5@8"

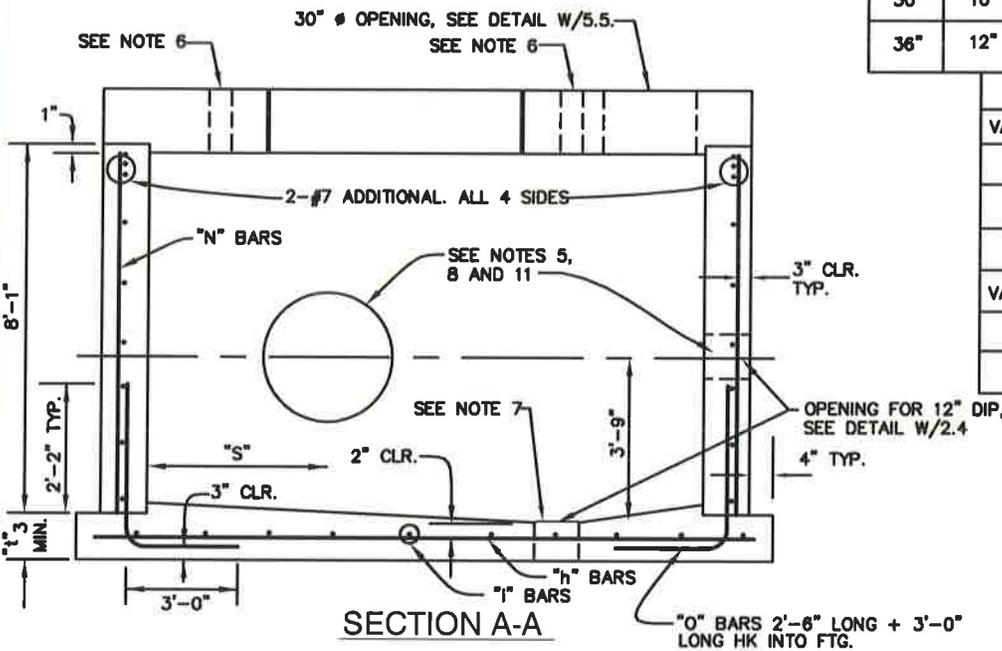

SECTION A-A

"O" BARS 2'-6" LONG + 3'-0" LONG HK INTO FTG.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: *9/28/16*

Chief Engineer

STANDARD DETAIL
CAST IN PLACE CONCRETE
VAULT FOR 30-INCH AND 36-INCH
HORIZONTAL VALVES

W
2.5a

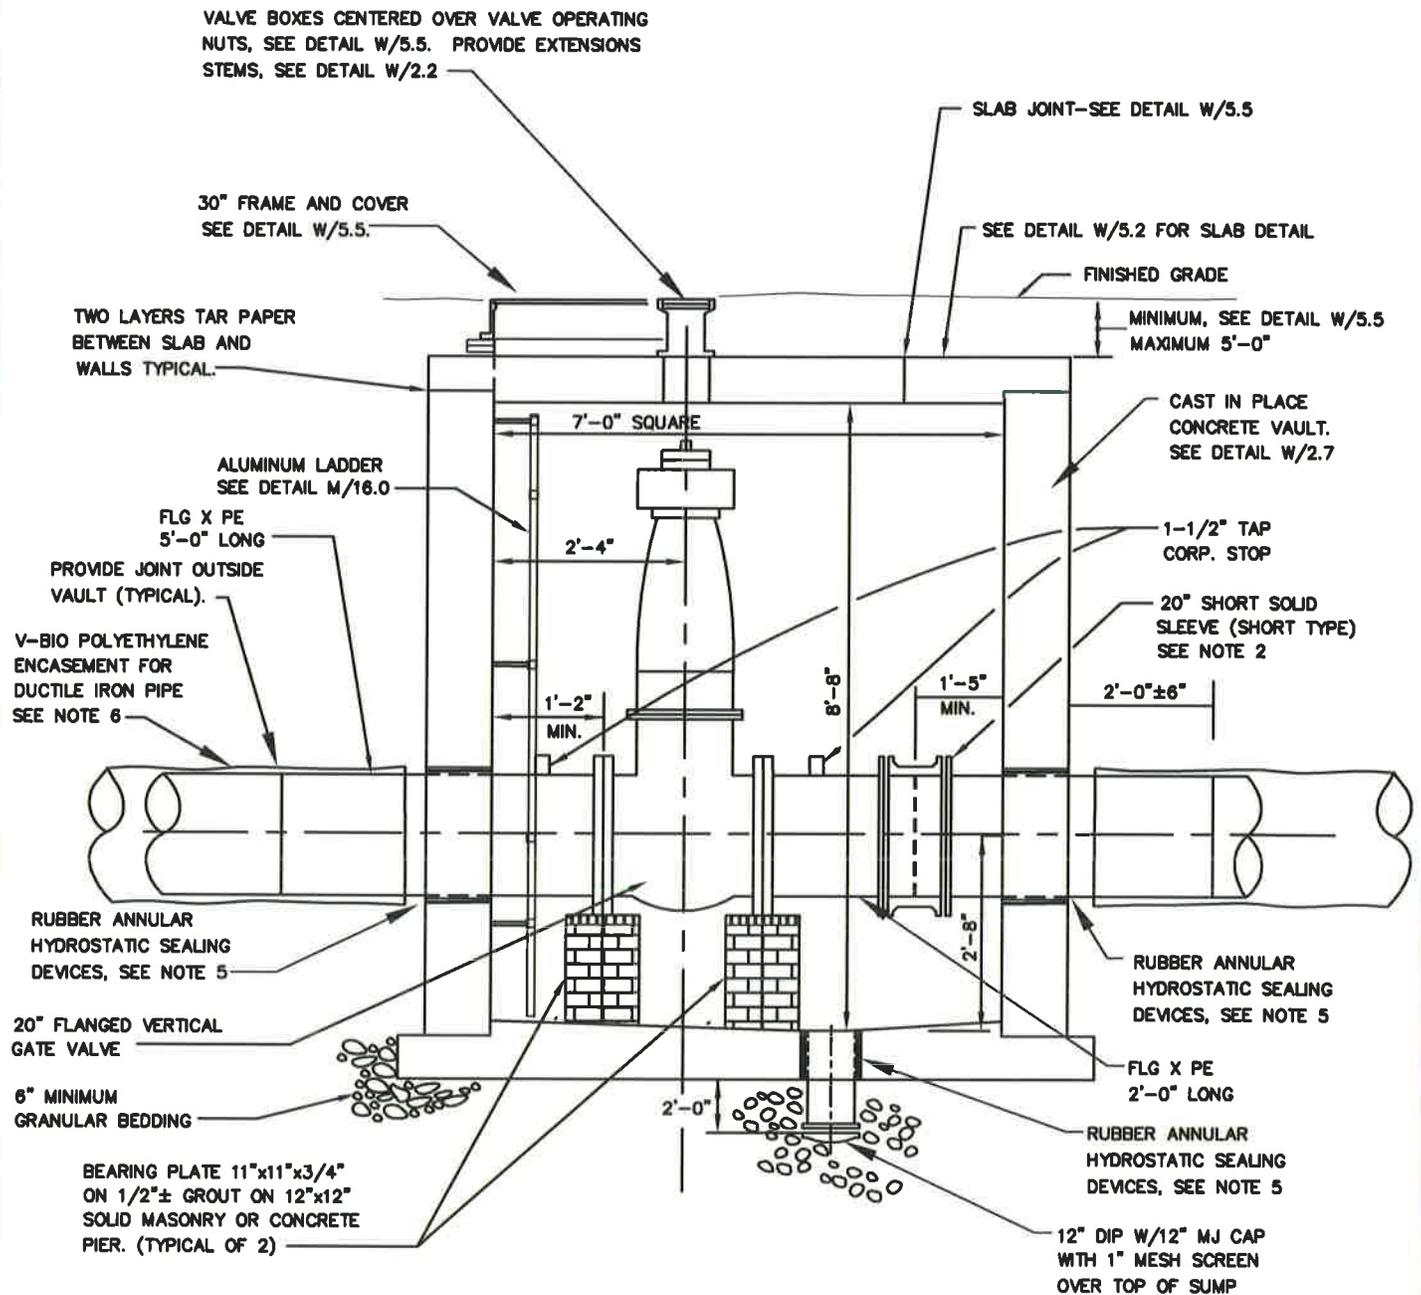


NOTES:

1. THIS VALVE VAULT IS NOT FOR ELECTRICALLY OPERATED VALVES.
2. PROVIDE SHORT TYPE MJ SOLID SLEEVE WITH WEDGE ACTION RESTRAINED JOINTS, SEE SPECIFICATIONS. TOLERANCE BETWEEN SHALL NOT EXCEED 1/2". DO NOT USE PIPE SPACERS, SEE SPECIFICATIONS.
3. PROVIDE FLANGE BOLT END PROTECTION FOR ALL FLANGED JOINTS IN VAULTS, SEE SPECIFICATIONS.
4. FOR STRUCTURAL DETAILS SEE DETAIL W/2.7.
5. PROVIDE RUBBER ANNULAR HYDROSTATIC SEALING DEVICES FOR PIPE THROUGH WALL CONNECTIONS, SEE SPECIFICATIONS PROVIDE PIPE OPENING LARGE ENOUGH TO ALLOW FLANGE OR BELL JOINT TO PASS THROUGH.
6. SEE DETAIL W/2.8 FOR POLYETHYLENE ENCASEMENT AT CONCRETE INTERFACE.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED:

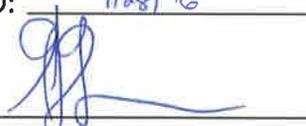9/28/16

Chief Engineer


STANDARD DETAIL

16-INCH AND 20-INCH
VERTICAL VALVES
INSTALLATION

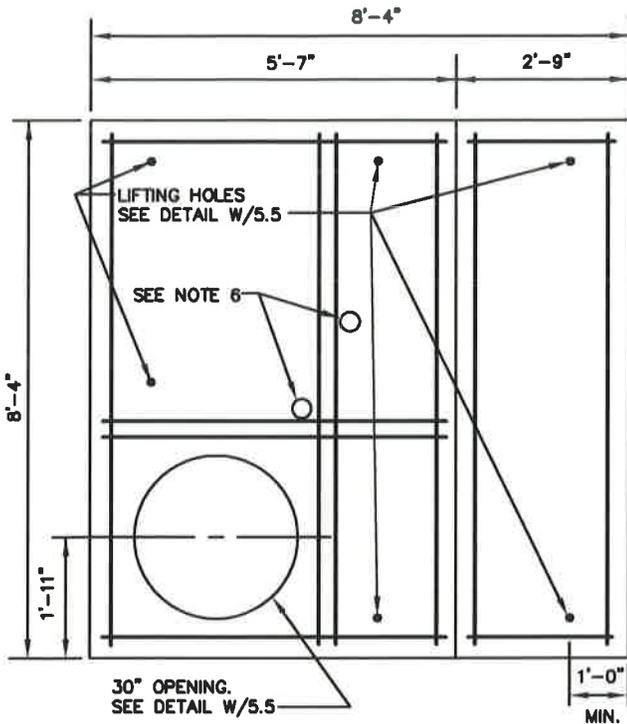W
2.6



PLAN-TOP SLAB

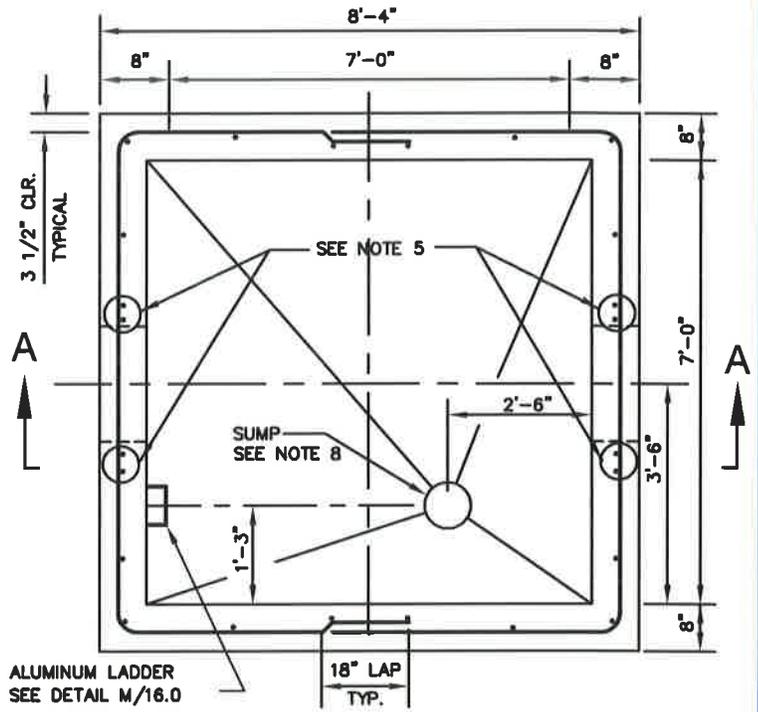


PLAN-TOP SLAB REMOVED

CAST IN PLACE CONCRETE VAULT NOTES

1. $f'c = 4000$ PSI. \ominus 28 DAYS
2. $f_y = 60,000$ PSI.
3. VAULTS ARE DESIGNED FOR THE FOLLOWING CONDITIONS
 - A. H₂O LOADING & 1'-0" COVER + IMPACT (WATER TABLE 4'-0" BELOW FINISHED GRADE)
 - B. 5'-0" COVER & 2'-0" SURCHARGE. (WATER TABLE 4'-0" BELOW FINISHED GRADE)
4. PRECAST VAULT.
 - A. CONTRACTOR MAY USE PRECAST VAULTS, SEE SPECIFICATIONS FOR SUBMITTAL REQUIREMENTS.
 - B. MONOLITHICALLY CASE WALLS AND BASE SLAB.
 - C. IF THE BOTTOM SLAB IS NOT SLOPED, PROVIDE MINIMUM 1" THICK CEMENT MORTAR WEARING COURSE SLOP TO SUMP \ominus 1/4" / LF.
5. PROVIDE ADDITIONAL #5 BAR 5'-0" LONG ON ALL SIDES OF ALL PIPES PASSING THROUGH WALLS.
6. PROVIDE 5" ϕ HOLE IN TOP SLAB CENTERED OVER VALVE OPERATING NUTS. PROVIDE VALVE BOXES PER DETAIL W/5.5.
7. SLOPE BASE OF VAULT TO DRAIN \ominus 1/4" / LF.
8. FOR SUMP SEE DETAIL W/2.6.
9. FOR PIPING AND VALVE CONFIGURATION AND ADDITIONAL DETAILS, SEE DETAIL W/2.6
10. PROVIDE RUBBER ANNULAR HYDROSTATIC SEALING DEVICES FOR PIPE THROUGH WALL CONNECTIONS,

TOP SLAB, SEE DETAIL W/5.2
 "O" = 7'-0" FOR THICKNESS & REINFORCING.

SLAB JOINTS SEE DETAIL W/5.5

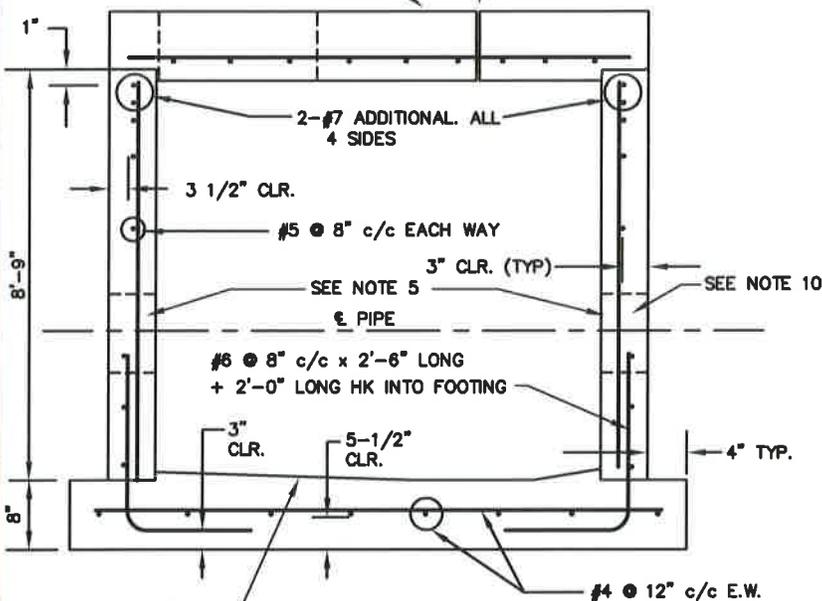

SECTION A-A


WASHINGTON
 SUBURBAN
 SANITARY
 COMMISSION

APPROVED: 9/28/16

 Chief Engineer

STANDARD DETAIL
 CAST IN PLACE
 CONCRETE VAULT FOR
 16-INCH AND 20-INCH
 VERTICAL VALVES

W
 2.7

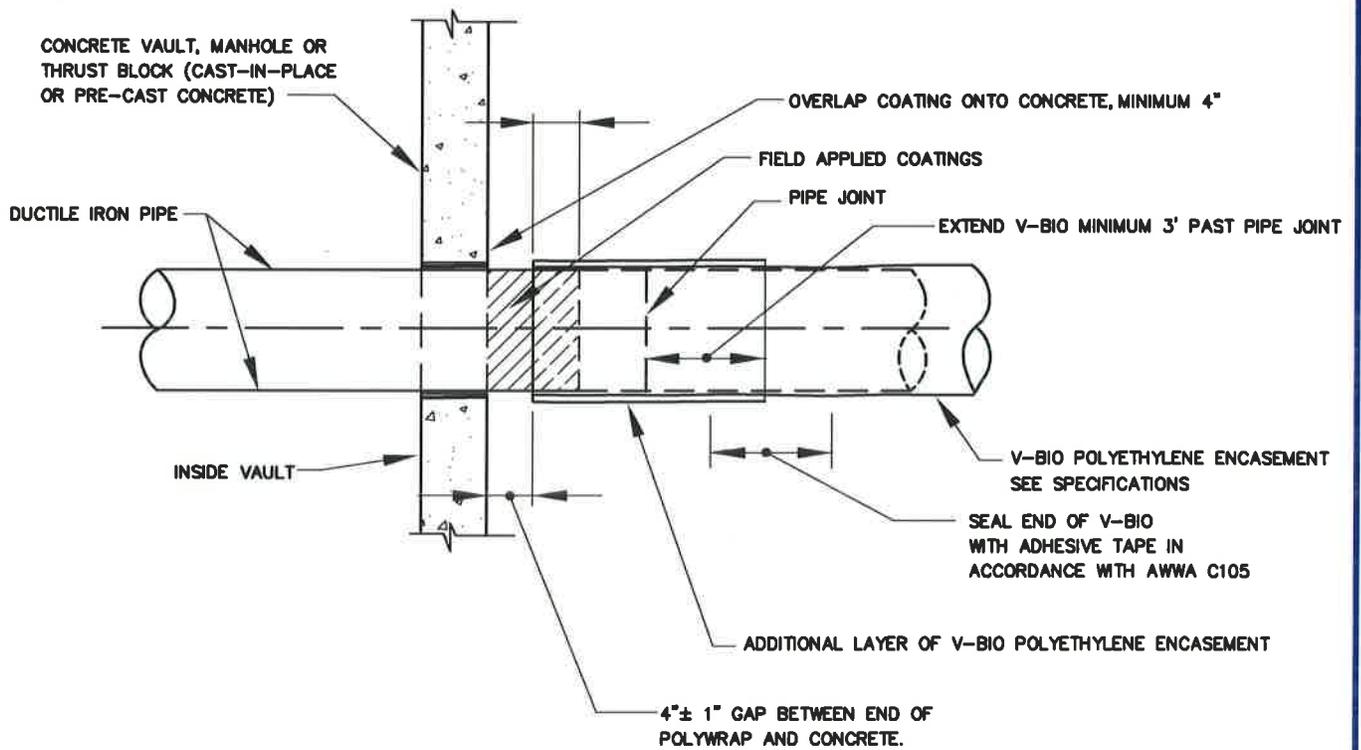

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:

9/28/16


[Signature]

Chief Engineer

STANDARD DETAIL

V-BIO
POLYETHYLENE ENCASEMENT
AT CONCRETE INTERFACE


W
2.8

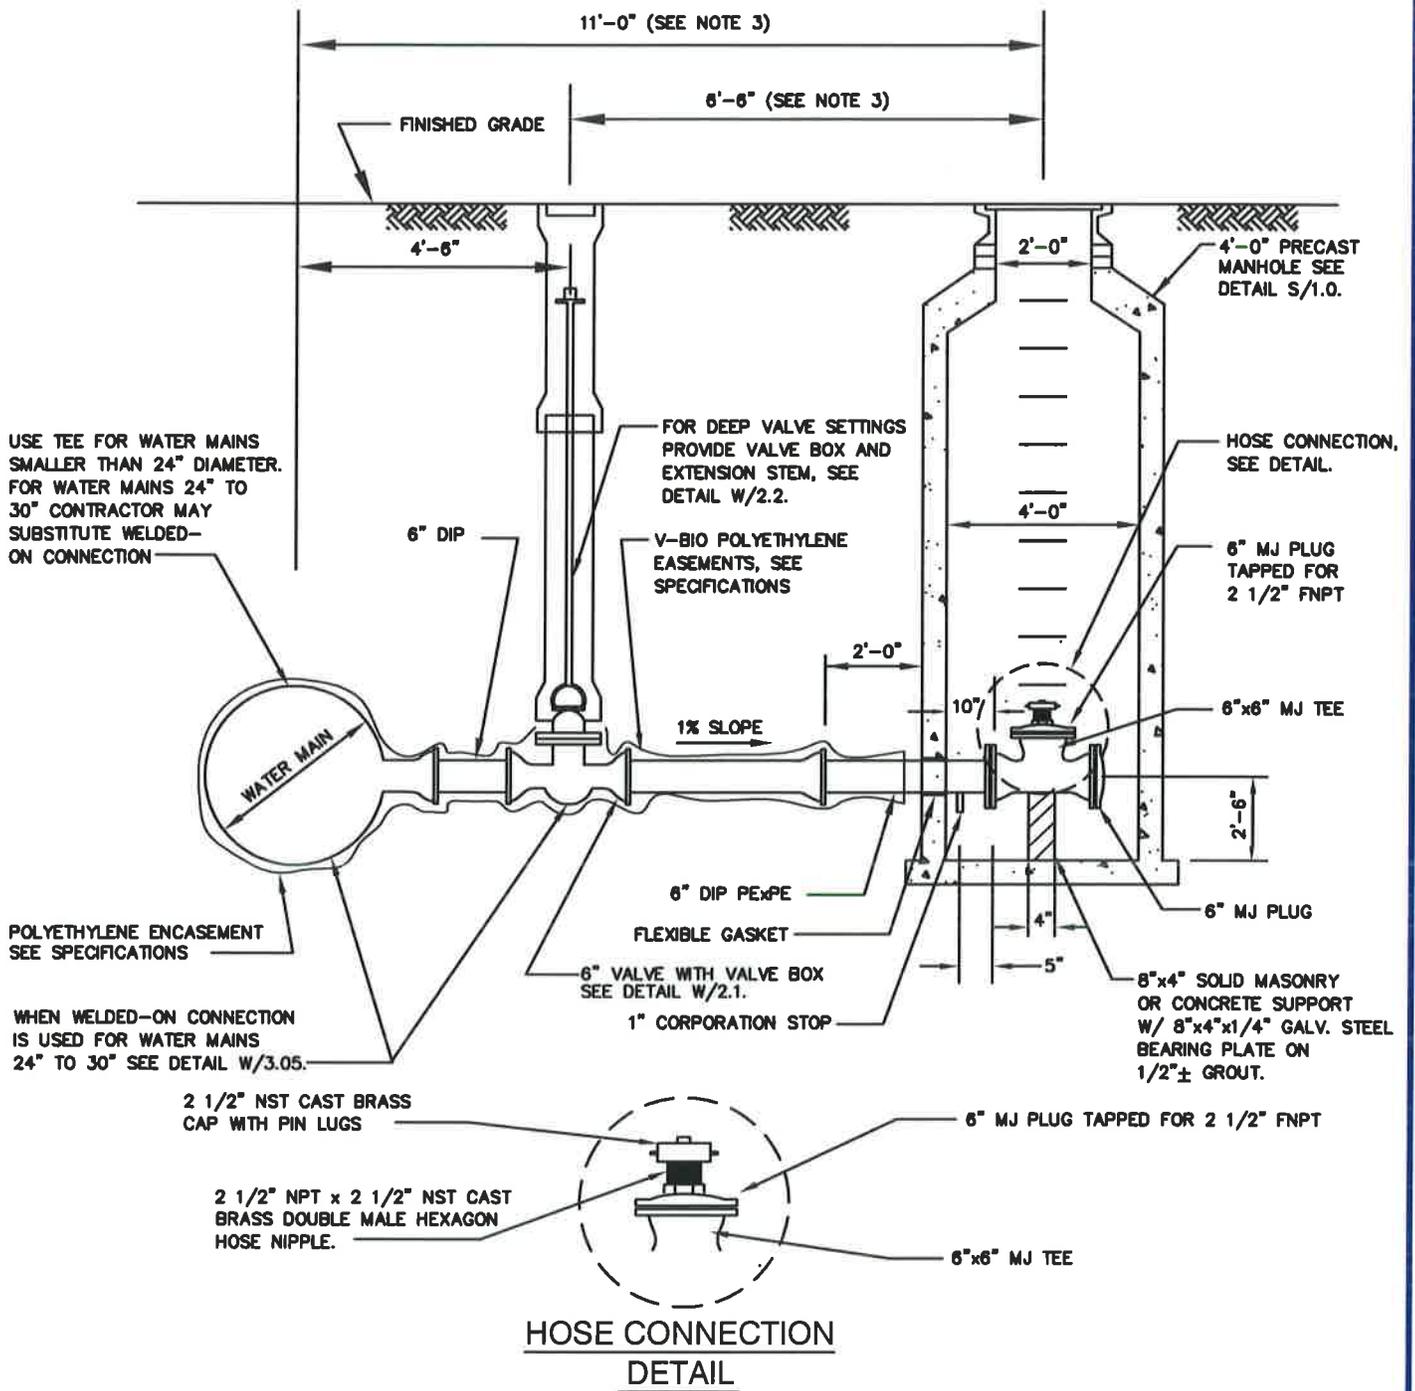


NOTES:

1. RESTRAIN ALL JOINTS ON 6" BLOWOFF PIPING, SEE SPECIFICATIONS.
2. SET VALVE BOX AND MANHOLE RIM TO FINISHED GRADE OR AS SHOWN ON THE DRAWINGS.
3. MANHOLE SHALL BE LOCATED AS SHOWN UNLESS OTHERWISE INDICATED ON THE DRAWINGS.
4. SEE DETAIL W/2.8 FOR V-BIO POLYETHYLENE ENCASEMENT AT MANHOLE INTERFACE.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u>  Chief Engineer	STANDARD DETAIL TYPE "A" BLOWOFF FOR WATER MAINS 16-INCH TO 30-INCH	W 3.0
--	---	--	----------

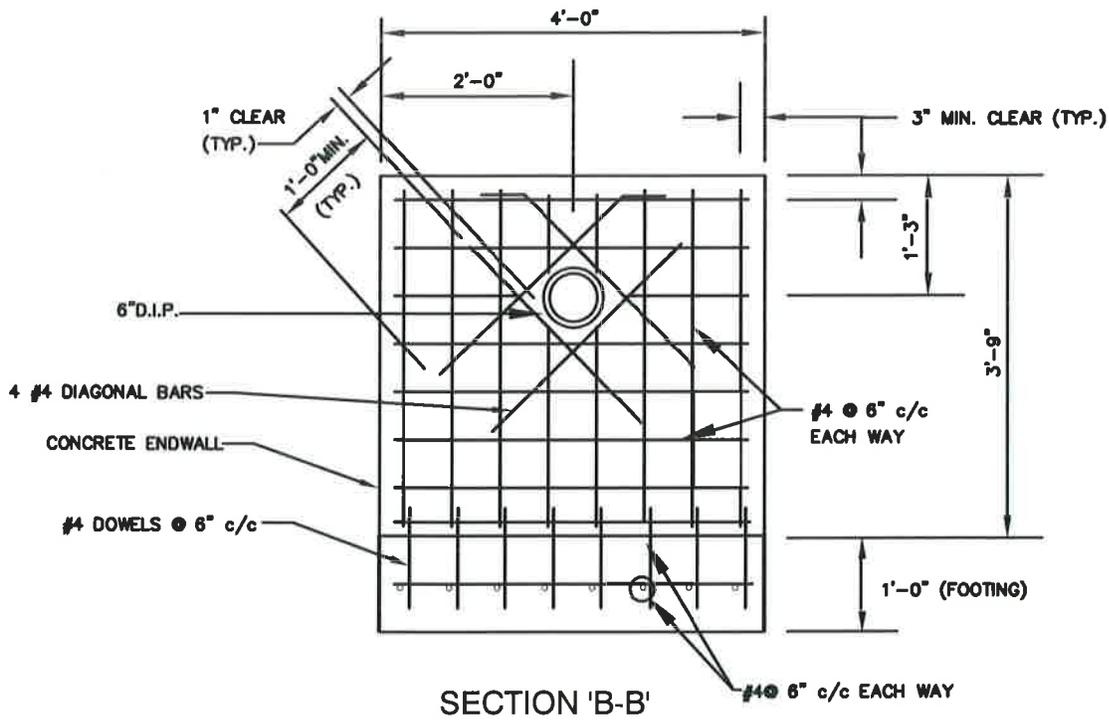

SECTION 'B-B'

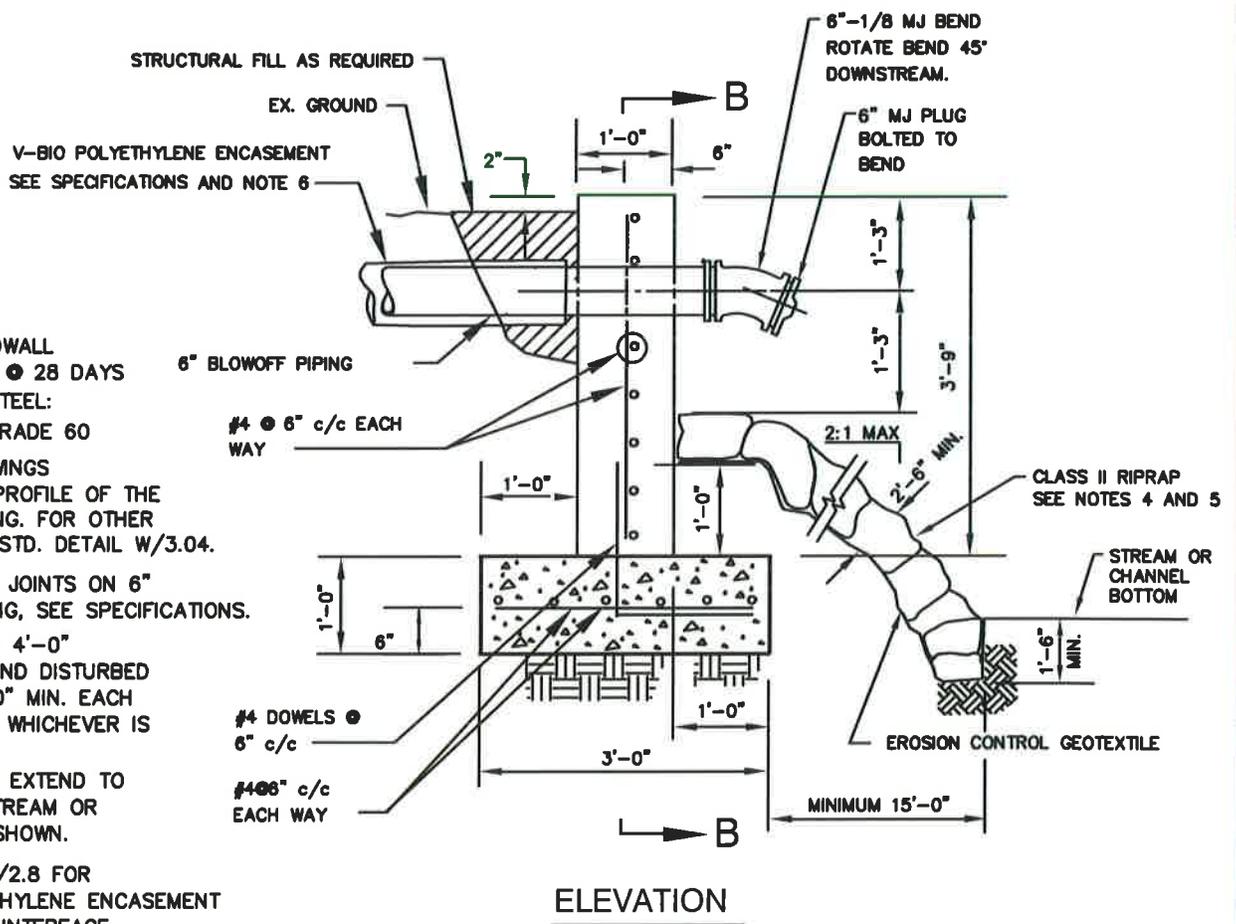

ELEVATION

NOTES:

1. CONCRETE ENDWALL
F'c 4,000 PSI @ 28 DAYS
REINFORCED STEEL:
ASTM A615, GRADE 60
2. SEE THE DRAWINGS
FOR ACTUAL PROFILE OF THE
BLOWOFF PIPING. FOR OTHER
DETAILS, SEE STD. DETAIL W/3.04.
3. RESTRAIN ALL JOINTS ON 6"
BLOWOFF PIPING, SEE SPECIFICATIONS.
4. PLACE RIPRAP 4'-0"
MINIMUM BEYOND DISTURBED
AREA OR 6'-0" MIN. EACH
SIDE OF PIPE, WHICHEVER IS
GREATER.
5. RIPRAP SHALL EXTEND TO
BOTTOM OF STREAM OR
CHANNEL AS SHOWN.
6. SEE DETAIL W/2.8 FOR
V-BIO POLYETHYLENE ENCASMENT
AT END WALL INTERFACE.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:


9/28/16

Chief Engineer

STANDARD DETAIL


ENDWALL FOR TYPE "B"
BLOWOFF


W
3.01

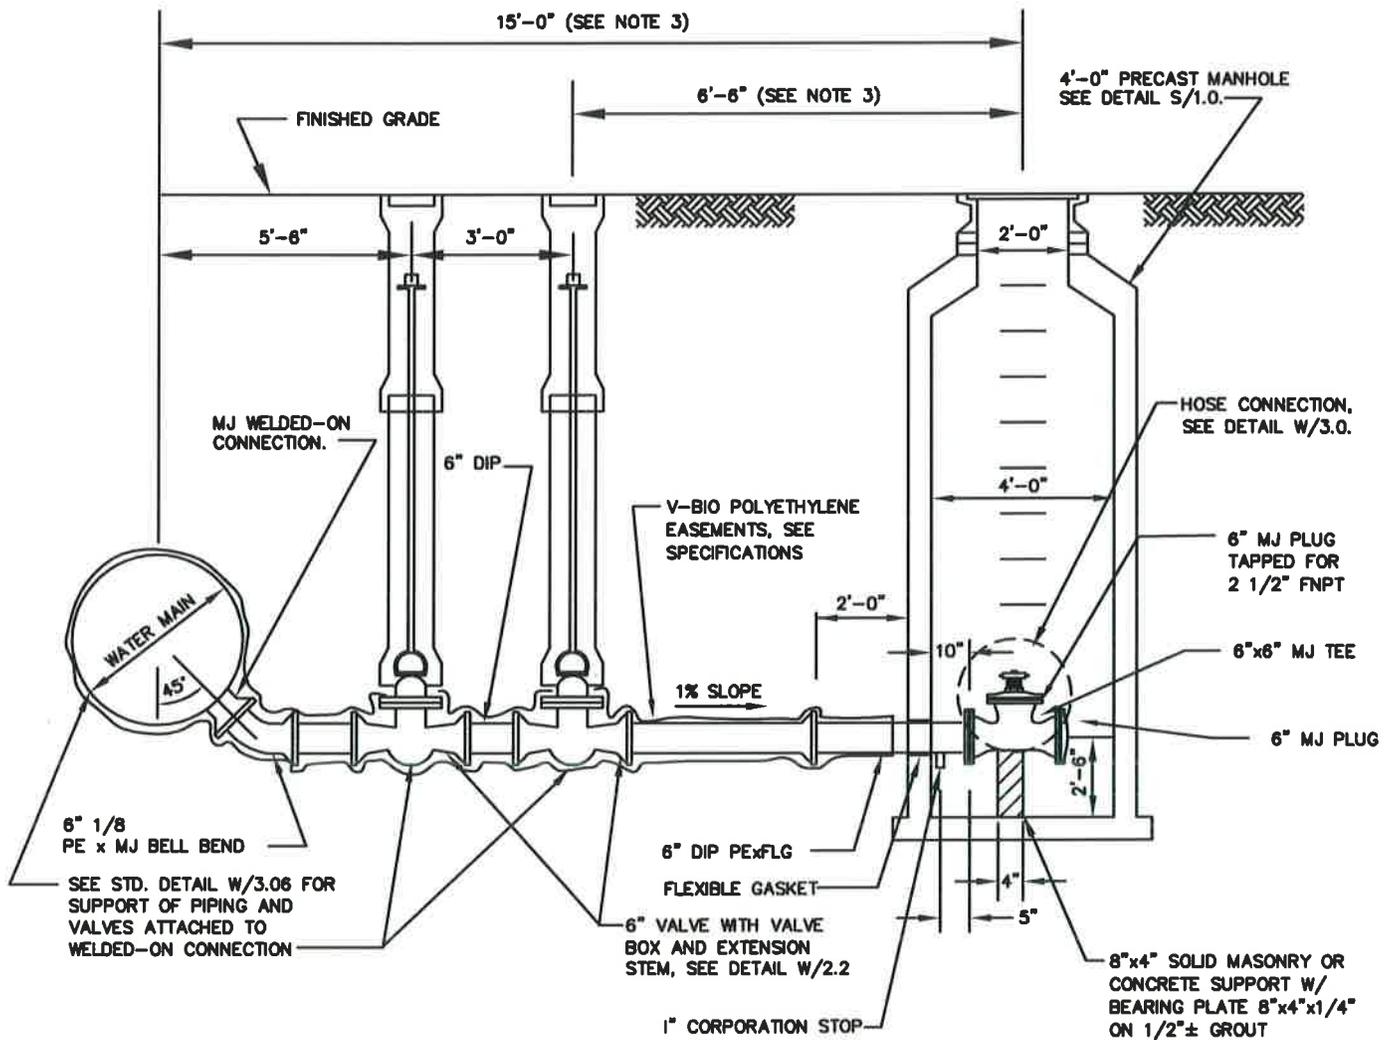


NOTES:

1. RESTRAIN ALL JOINTS ON 6" BLOWOFF PIPING, SEE SPECIFICATIONS
2. SET VALVE BOX AND MANHOLE RIM TO FINISHED GRADE OR AS SHOWN ON THE DRAWINGS.
3. MANHOLE SHALL BE LOCATED AS SHOWN UNLESS OTHERWISE INDICATED ON THE DRAWINGS.
4. SEE DETAIL W/2.8 FOR V-BIO POLYETHYLENE ENCASEMENT AT MANHOLE INTERFACE.

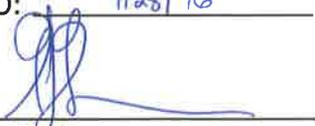WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u>  Chief Engineer	STANDARD DETAIL TYPE "A" BLOWOFF FOR WATER MAINS 36-INCH AND LARGER	W <hr/> 3.02
--	---	--	-----------------

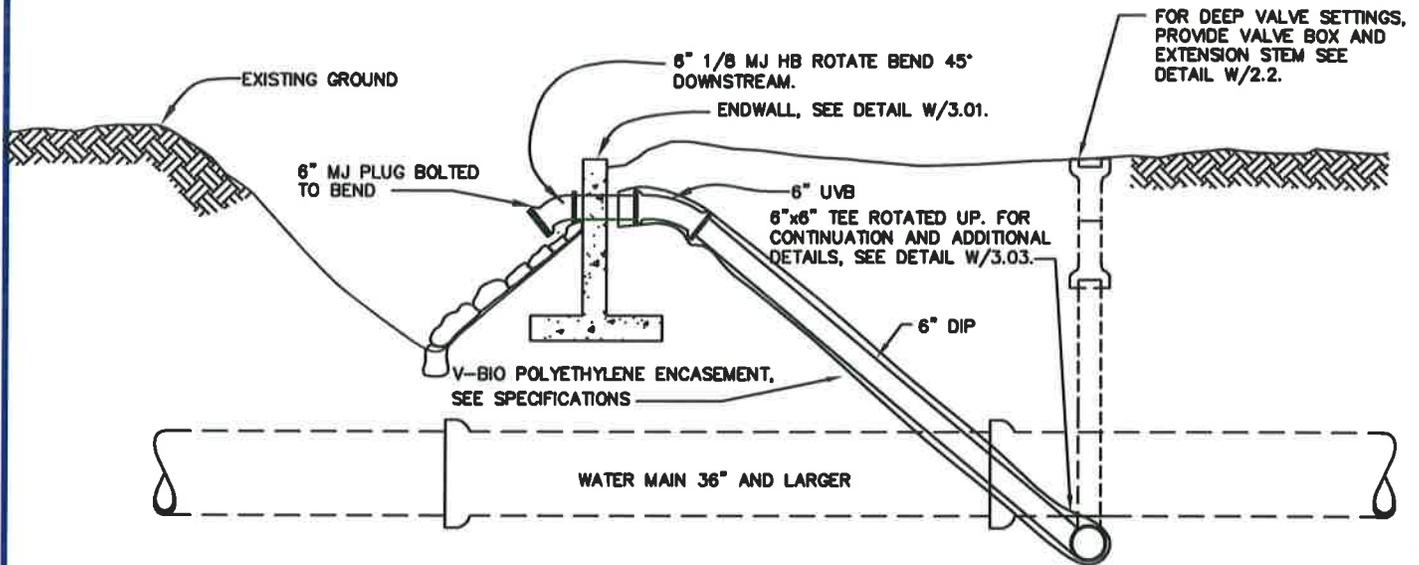

TYPICAL PROFILE FOR TYPE "B" BLOWOFF FOR MAINS 36" AND LARGER


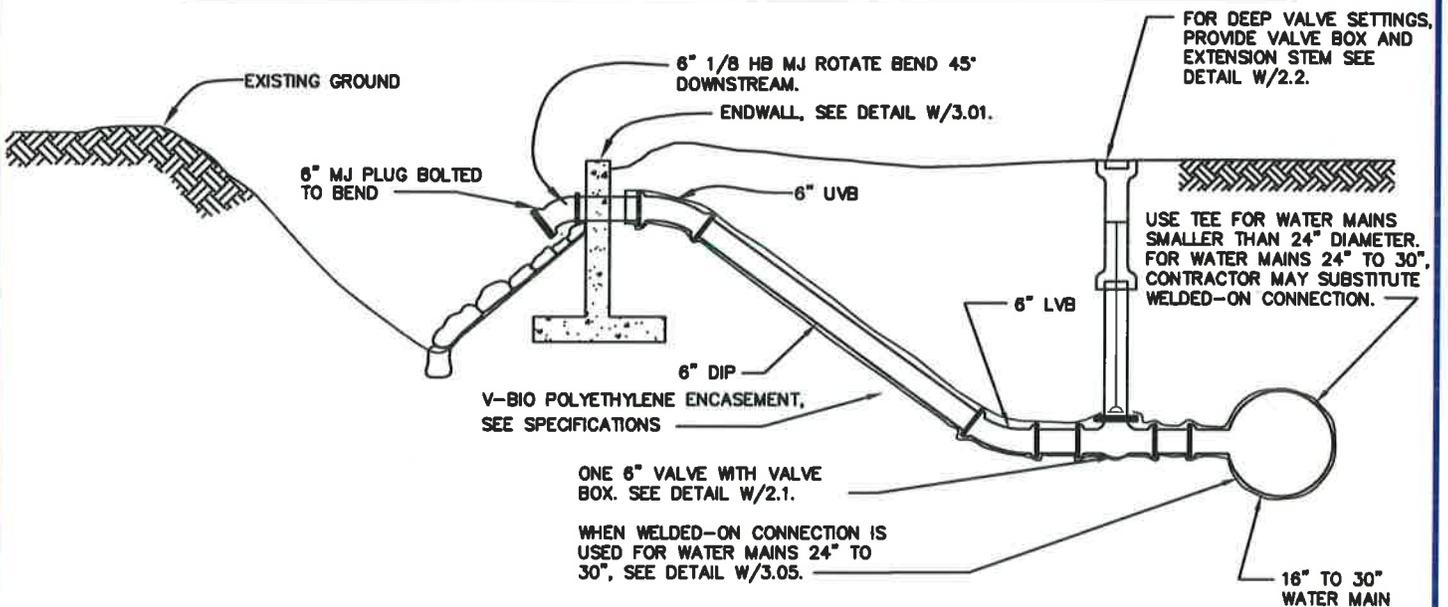


TYPICAL PROFILE FOR TYPE "B" BLOWOFF FOR MAINS 16" TO 30"

NOTES:


1. THESE ARE TYPICAL PROFILES ONLY. FOR ACTUAL ELEVATIONS AND LOCATIONS OF FITTINGS, SEE DRAWINGS.
2. RESTRAIN ALL JOINTS ON 6" BLOWOFF PIPING, SEE SPECIFICATIONS.
3. SEE DETAIL W/2.8 FOR V-BIO POLYETHYLENE ENCASEMENT AT ENDWALL INTERFACE.


WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/23/16</u> Chief Engineer	STANDARD DETAIL TYPE "B" BLOWOFF PROFILES FOR WATER MAINS 16-INCH AND LARGER	<u>W</u> 3.04
--	--	---	------------------

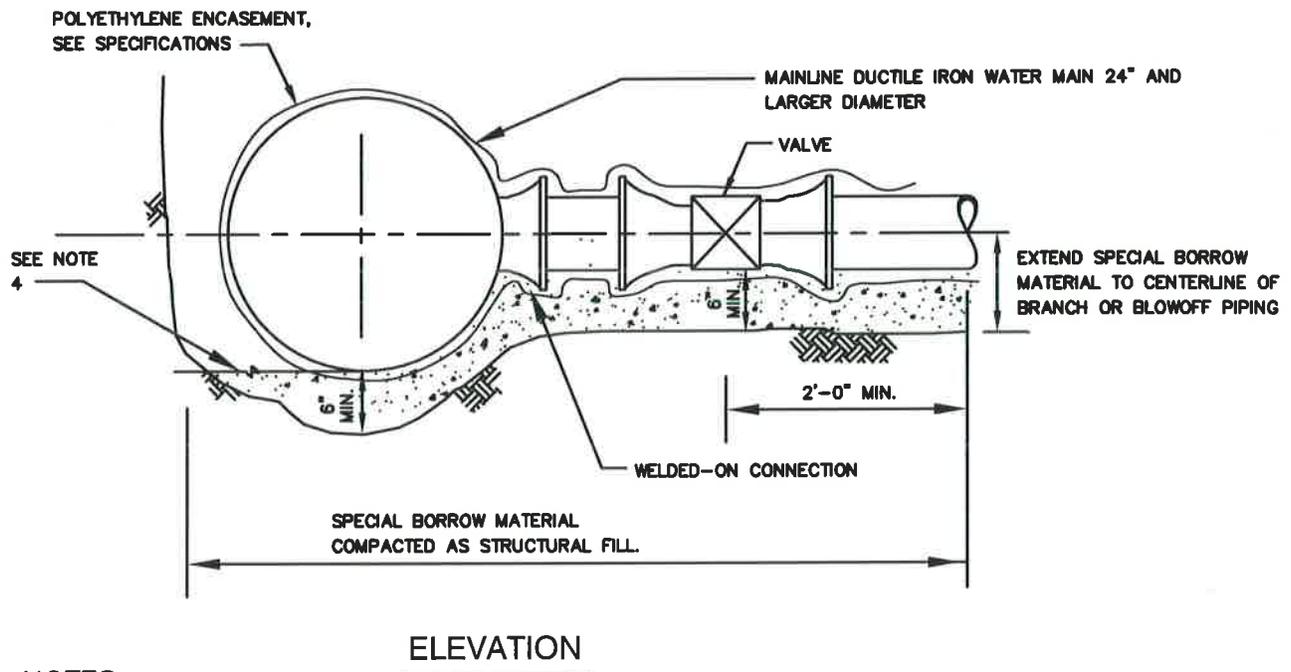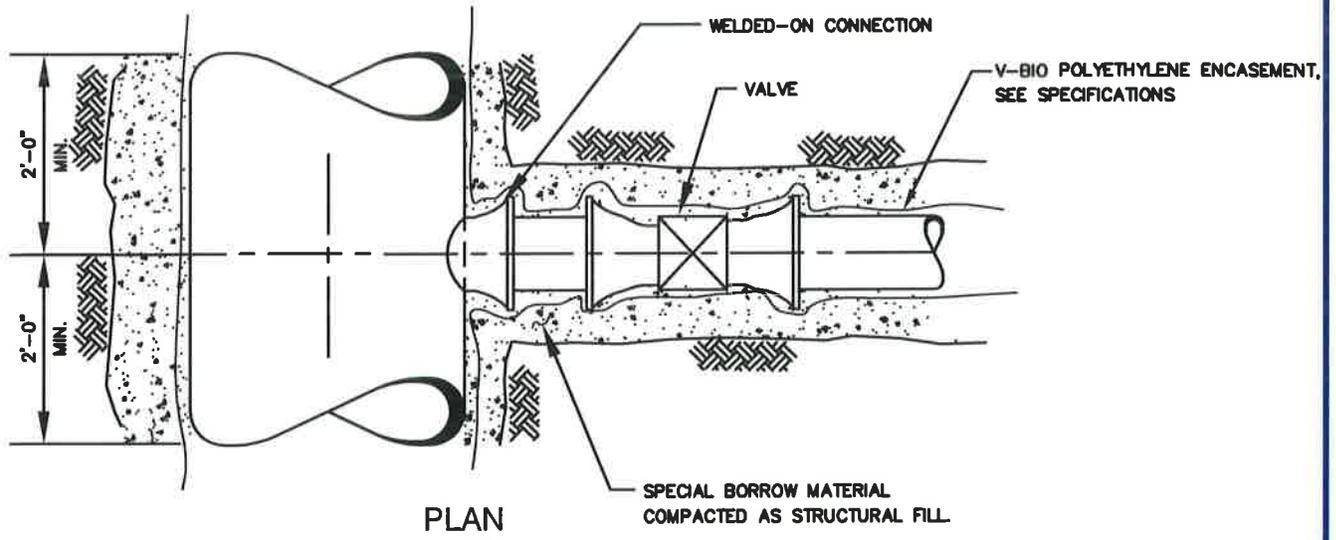

NOTES:

1. THIS DETAIL SHALL BE USED WHEN WELDED-ON CONNECTIONS ARE PROVIDED FOR WATER MAIN BRANCH CONNECTIONS ON DUCTILE IRON WATER MAINS 24" AND LARGER AND FOR BLOWOFF CONNECTIONS TO WATER MAINS 24" TO 30" INSTALLED ACCORDING TO DETAILS W/3.0 AND W/3.04.
2. DO NOT ATTACH PIPE OR FITTINGS TO THE WELDED-ON CONNECTION UNTIL MAINLINE PIPE WITH THE CONNECTION IS SUPPORTED IN PLACE.
3. SUPPORT ALL PIPING ATTACHED TO THE WELDED-ON CONNECTION IMMEDIATELY AFTER INSTALLATION TO MINIMIZE LOAD TRANSMISSION TO THE CONNECTION.
4. FOR PIPE EMBEDMENT REQUIREMENTS FOR MAINLINE PIPE, SEE DETAIL M/8.1a AND M/8.1b.
5. RESTRAIN VALVE TO THE WELDED-ON CONNECTION, SEE SPECIFICATIONS.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u>  Chief Engineer	STANDARD DETAIL PIPING SUPPORT AT WELDED-ON CONNECTION	$\frac{W}{3.05}$
--	---	---	------------------

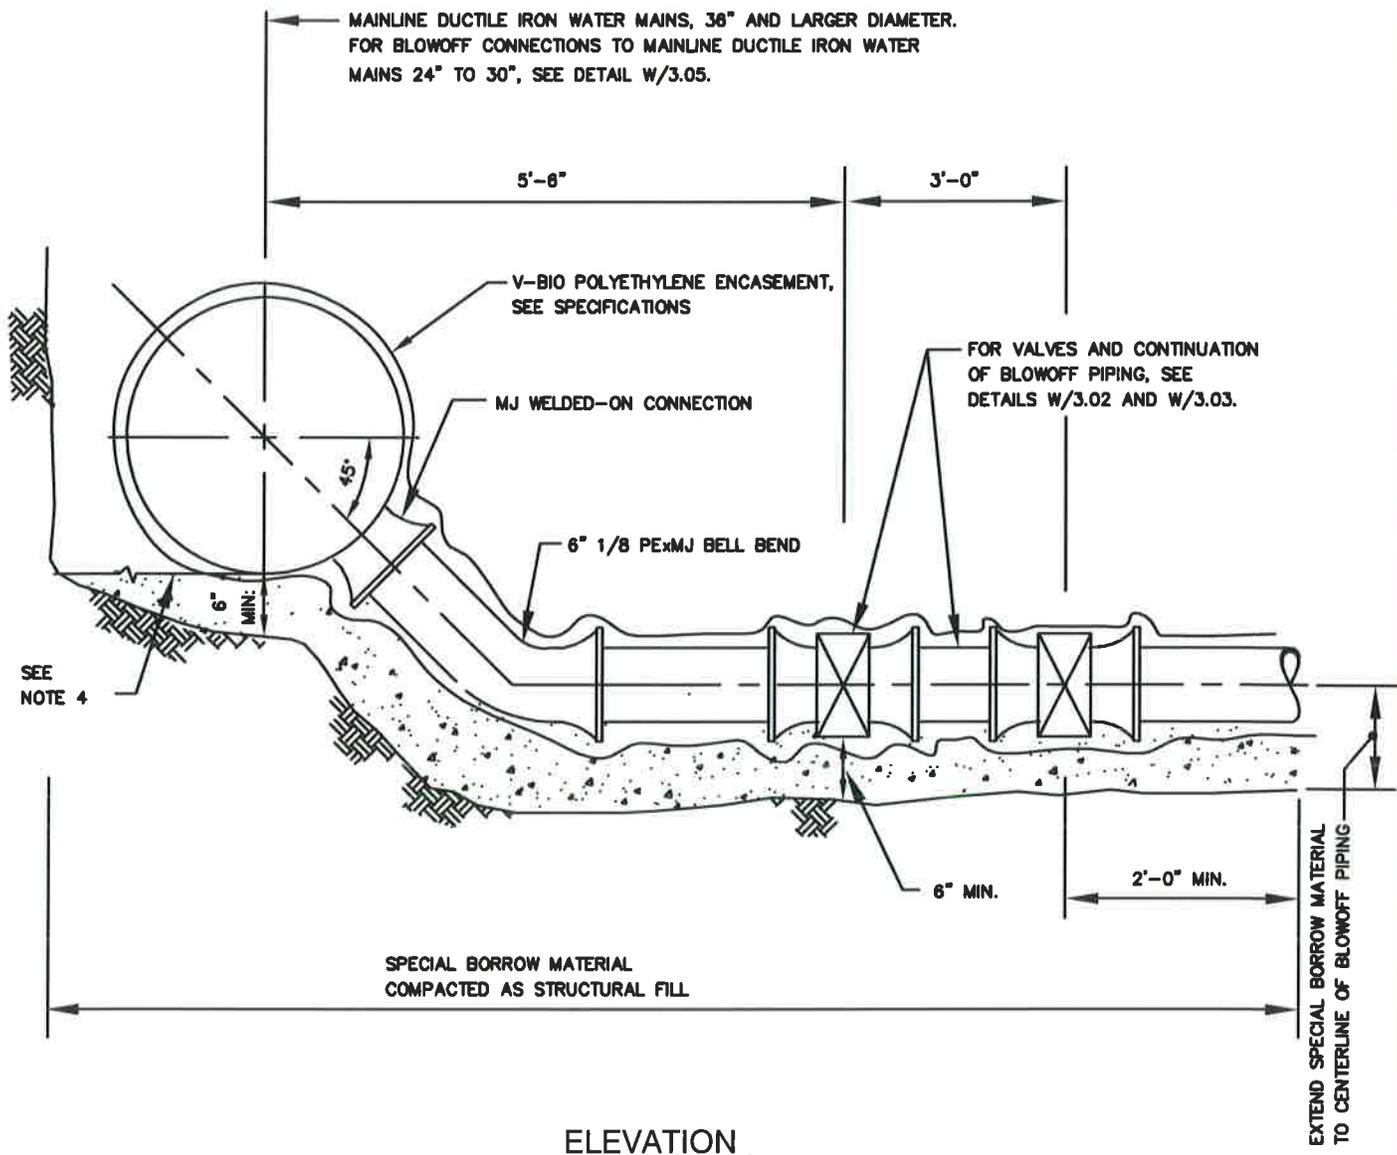


ELEVATION

NOTES:

1. DO NOT ATTACH PIPE OR FITTINGS TO THE WELDED-ON CONNECTION UNTIL MAINLINE PIPE WITH THE CONNECTION IS SUPPORTED IN PLACE.
2. SUPPORT ALL PIPING ATTACHED TO THE WELDED-ON CONNECTION IMMEDIATELY AFTER INSTALLATION TO MINIMIZE LOAD TRANSMISSION TO THE CONNECTION.
3. RESTRAIN ALL JOINTS ON BLOWOFF PIPING, SEE SPECIFICATIONS.
4. FOR PIPE EMBEDMENT REQUIREMENTS FOR MAINLINE PIPE, SEE DETAIL M/8.1a AND M/8.1b.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL

WELDED-ON CONNECTION
FOR BLOWOFFS ON
MAINS 36-INCH AND LARGER

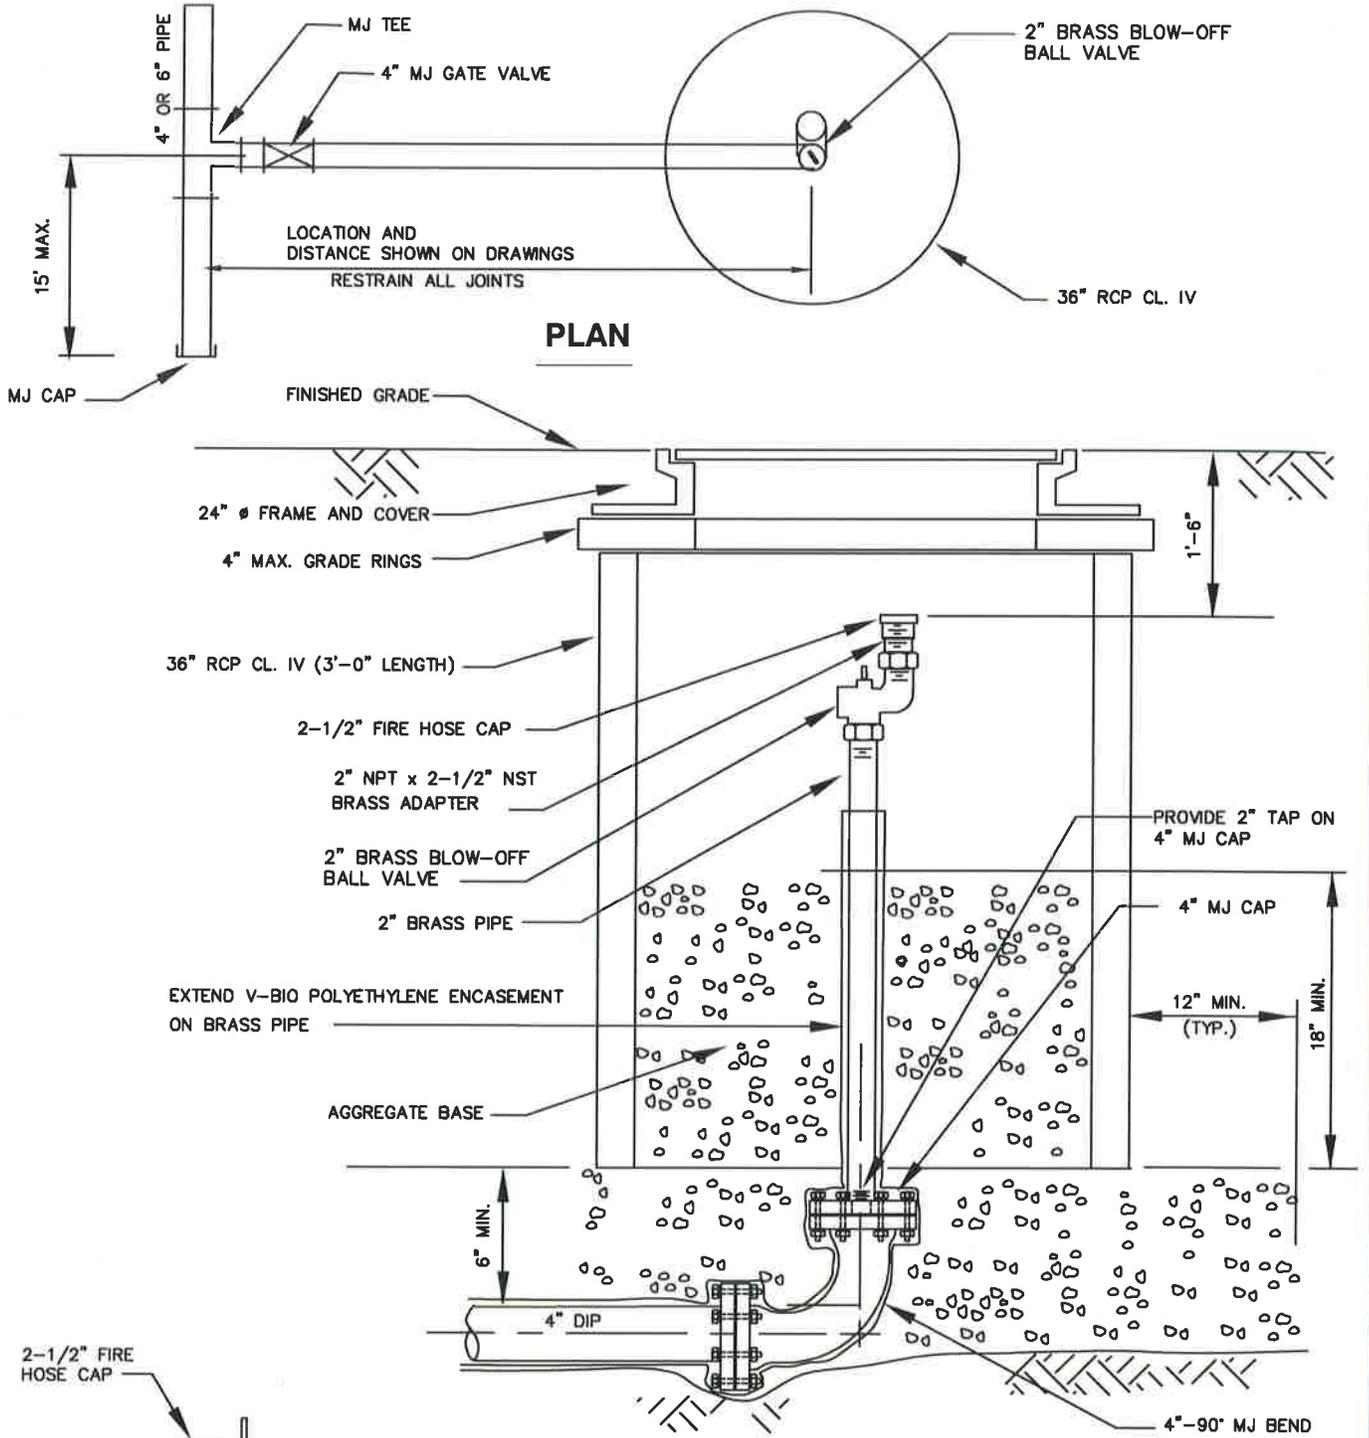W
3.06




PLAN

NOTES:

1. BLOW-OFF SETTING FOR NON-TRAFFIC AREAS ONLY, DO NOT LOCATE IN SIDEWALK OR DRIVEWAY, UNLESS OTHERWISE NOTED ON THE DRAWINGS.
2. COMPACT BACKFILL AND AGGREGATE BASE AS STRUCTURAL FILL.

ALTERNATE BLOW-OFF VALVE

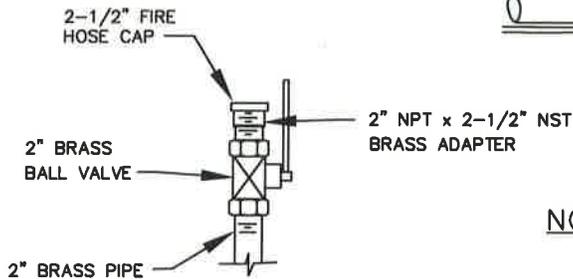


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/25/16

Chief Engineer


STANDARD DETAIL
**BLOW-OFF CONNECTION
IN NON-TRAFFIC AREAS
FOR 4-INCH AND 6-INCH
WATER MAINS**

W
3.07

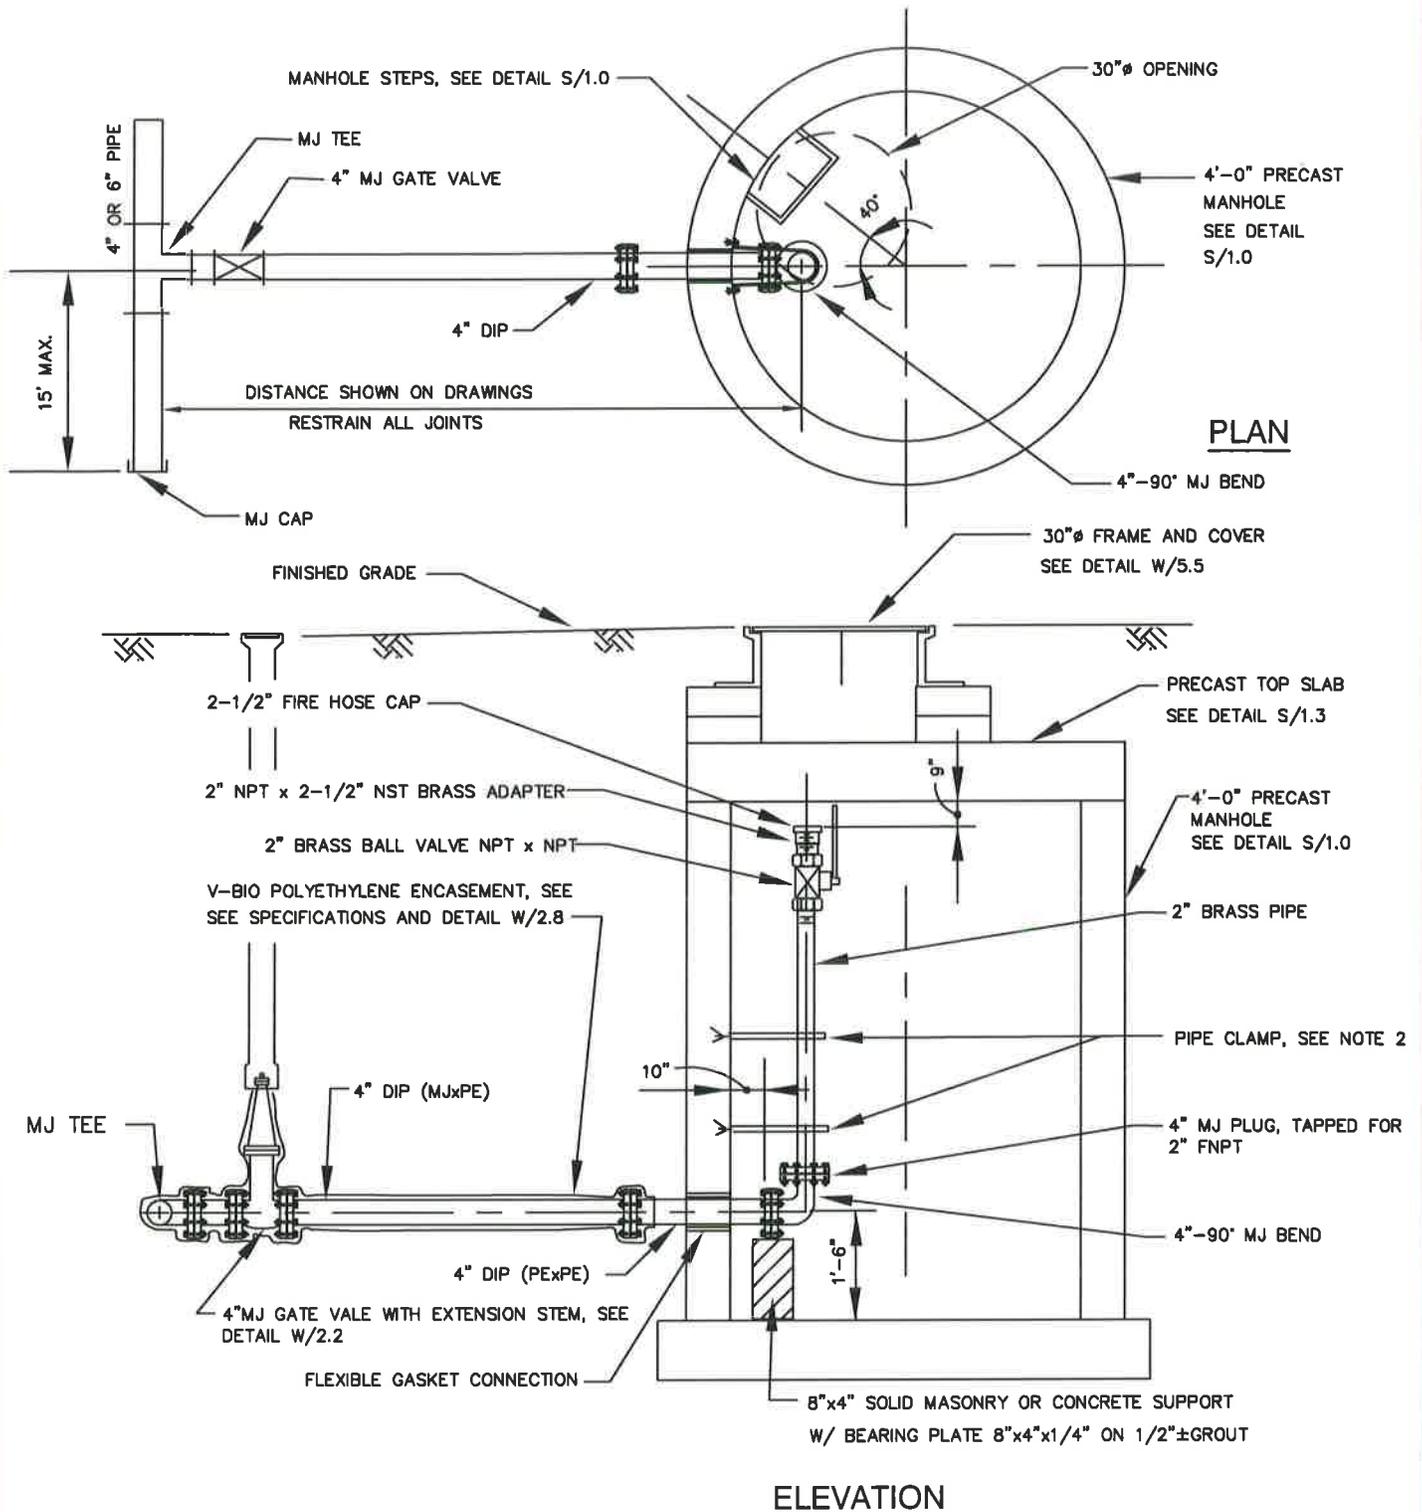

NOTES:

1. BLOW-OFF SETTINGS FOR TRAFFIC AREAS
2. 1-1/2" WIDE, 11 GAUGE STAINLESS STEEL ADJUSTABLE CLAMPING BRACKET AT 2 FEET MAX. SPACING. ANCHORED WITH 3/8" STAINLESS STEEL EXPANSION BOLTS.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/25/16</u>  Chief Engineer	SPECIAL DETAIL BLOW-OFF CONNECTION IN TRAFFIC AREAS FOR 4-INCH AND 6-INCH WATER MAINS	<u>W</u> 3.08
--	---	--	-------------------------

30"x30" SQ. OPENING IN TOP SLAB FOR VALVE REMOVAL, SEE NOTE A, DETAIL W/5.22.

PVC SCH. 80 HATCH DRAIN TO DRAIN TO GRAVEL PIT.

3/4" CORPORATION STOP (TYPICAL OF 4)

DIP (FLG.xPE)

PIPE "A", SEE NOTE 2, DETAIL W/4.4

RUBBER ANNULAR HYDROSTATIC SEALING DEVICES (TYP. OF 4) SEE SPECIFICATIONS

16"x8"x3/4" STEEL BEARING PLATE ON 1/2"± GROUT ON 16"x8" SOLID MASONRY OR CONCRETE PIER. (TYP. OF 3)

PRESSURE REDUCING VALVE "A" SEE NOTE 1, DETAIL W/4.4

PIPE "B", SEE NOTE 2, DETAIL W/4.4

DIP (FLG.xPE)

8"x8"x3/4" STEEL BEARING PLATE ON 1/2"± GROUT ON 8"x8" SOLID MASONRY OR CONCRETE PIER. (TYPICAL OF 4)

DIP (FLG.xPE)

PRESSURE REDUCING VALVE "B" SEE NOTE 1, DETAIL W/4.4

PROVIDE LIFTING HOOK OVER PRESSURE REDUCING VALVE WHEN ACCESS OPENING IS NOT PROVIDED. SEE DETAIL W/10.0

PLAN

30"x30" SQ. ALUMINUM HATCH (H-20 LOADING, SEE SPECIFICATIONS) FOR VALVE REMOVAL, SEE NOTE 1, DETAIL W/5.22.

30"x30" SQ. ALUMINUM HATCH (H-20 LOADING, SEE SPECIFICATIONS) SEE DETAIL W/5.5

ALUMINUM LADDER SEE DETAIL M/16.0

TOP SLAB, SEE NOTE 2

FOR MIN. SEE DETAIL W/5.5

Max 2.5'

10'x8' VAULT, SEE DETAIL W/5.3

3/4" CORPORATION STOP

10'-0" MAX. DEPTH BOTTOM SLAB TO GRADE

FLG. GATE VALVES WITH HAND WHEELS (TYP. OF 4)

PVC SCH. 80 HATCH DRAIN TO DRAIN GRAVEL PIT

GRAVEL PIT (1-CY OF #57 STONE) WRAP IN EROSION CONTROL GEOTEXTILE

V-BIO POLYETHYLENE ENCASUREMENT, SEE SPECIFICATIONS AND DETAIL W/2.8.

SLOPE FLOOR TO SUMP

3/4" CORPORATION STOP

M.J. SOLID SLEEVE, SEE NOTE 4, DETAIL W/4.4

RUBBER ANNULAR HYDROSTATIC SEALING DEVICES SEE SPECIFICATIONS

NOTES:


1. FOR PIPE AND PRESSURE REDUCING VALVE SIZES, PIPING LAYOUT AND NOTES, SEE DETAIL W/4.4
2. FOR TOP SLAB DETAIL, SEE DETAIL W/5.22.

ELEVATION

12" DIP AND 12" MJ CAP

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:

9/28/16

Chief Engineer

STANDARD DETAIL

PRESSURE REDUCING
VALVE VAULT
TYPE "1" LAYOUT

W
4.2

LOW PRESSURE SIDE SETTINGS

"A" PRV _____ PSI _____ LHG
 "B" PRV _____ PSI _____ HHG
 INVERT ELEVATION _____

FOR SETTINGS, SEE DRAWINGS

PRESSURE REDUCING VALVE VAULT
 SEE DETAILS W/4.2 OR W/4.3


PRESSURE REDUCING VALVE "A", SEE NOTE 1

PIPE "A", SEE NOTE 2

HIGH PRESSURE SIDE RANGE

LOW _____ PSI _____ LHG
 HIGH _____ PSI _____ HHG

FOR SETTINGS, SEE DRAWINGS

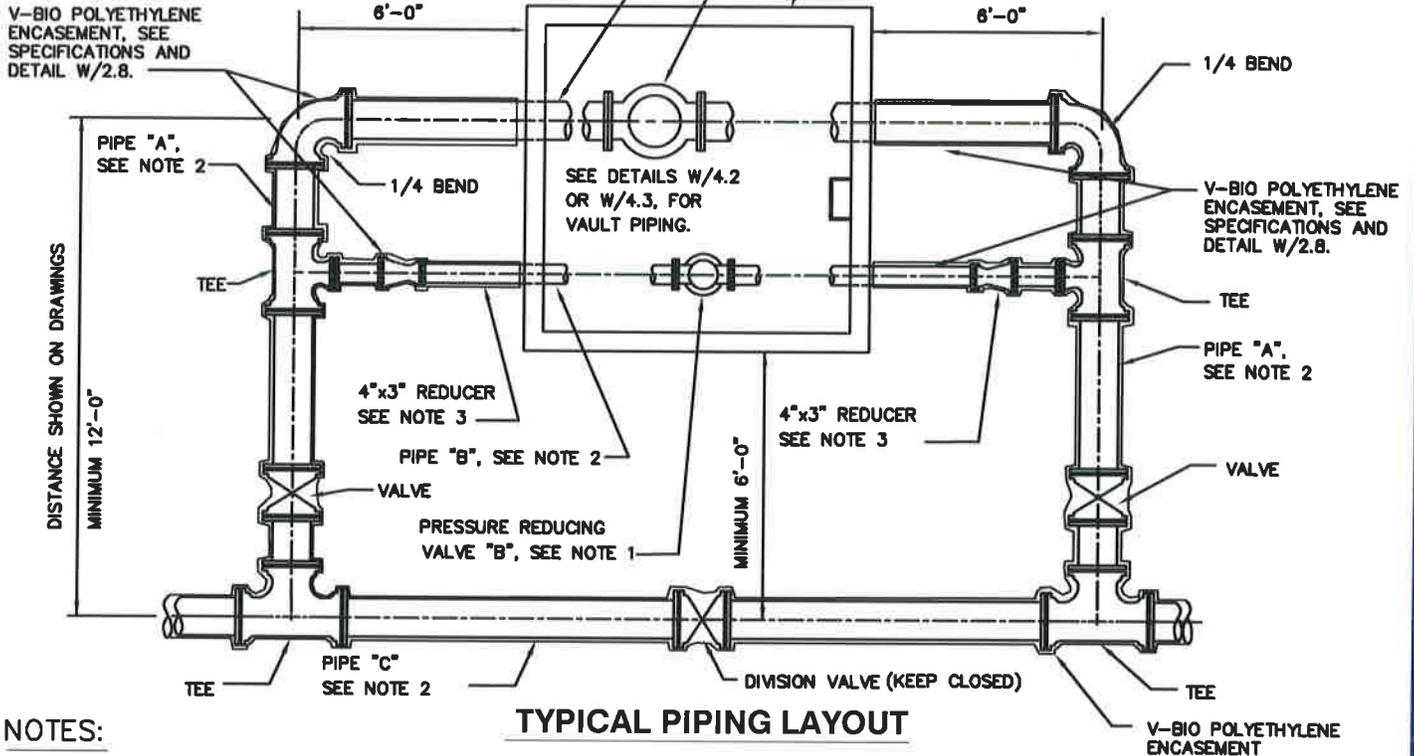

TYPICAL PIPING LAYOUT

NOTES:

1. PRESSURE REDUCING VALVE "A", AS SHOWN ON DETAIL W/4.2: MAXIMUM DIA. 12", MINIMUM DIA. 4".
 PRESSURE REDUCING VALVE "A", AS SHOWN ON DETAIL W/4.3: MAXIMUM DIA. 6", MINIMUM DIA. 4".
 PRESSURE REDUCING VALVE "B", AS SHOWN ON DETAIL W/4.2: MAXIMUM DIA. 6", MINIMUM DIA. 3".
 PRESSURE REDUCING VALVE "B", AS SHOWN ON DETAIL W/4.3: SMALLER THAN 3" DIA.
2. PIPE "A" SHALL BE SAME SIZE AS PRESSURE REDUCING VALVE "A", UNLESS NOTED ON DRAWINGS.
 PIPE "B" SHALL BE SAME SIZE AS PRESSURE REDUCING VALVE "B", MINIMUM SIZE SHALL BE 4" DIA, EXCEPT 3" PRV
 PIPE "C", SEE DRAWINGS.
3. PROVIDE 4"x3" REDUCER FOR 3" PRESSURE REDUCING VALVE.
 SEE DETAIL W/4.3 FOR SMALLER THAN 3" PRESSURE REDUCING VALVES.
4. PROVIDE M.J. SOLID SLEEVE WHERE SHOWN WITH WEDGE ACTION RESTRAINER GLAND, SEE SPECIFICATION.
 TOLERANCE BETWEEN PIPE ENDS SHALL NOT EXCEED 1/2". DO NOT USE PIPE SPACERS, SEE SPECIFICATIONS.
5. ONLY DUCTILE IRON PIPE AND FITTINGS, SEE DRAWINGS FOR SIZES.
6. RESTRAIN ALL JOINTS ON PIPE "A" FROM TEE TO TEE AND PIPE "B" WITH WEDGE ACTION RESTRAINER
 GLANDS, SEE SPECIFICATION.
7. PROVIDE EXTENSION STEMS AND VALVE BOXES FOR ALL BURIED VALVES, SEE DETAIL W/2.2.
8. THIS VALVE VAULT IS NOT FOR ELECTRICALLY CONTROLLED OR OPERATED VALVES.
9. STANDARD PRESSURE REDUCING VAULT IS BASED ON THE ASSUMPTIONS AND LIMITATIONS.
 IF THESE CONDITIONS ARE NOT MET, SPECIAL DESIGN IS REQUIRED.
 - a). ELEVATION OF GROUNDWATER TABLE IS ASSUMED TO BE 2'-0" BELOW BOTTOM SLAB ELEVATION.
 - b). LOCATION OF THE VAULT IS ASSUMED TO BE LOCATED OUTSIDE THE ROAD RIGHT OF WAY.
10. V-BIO POLYETHYLENE ENCASUREMENT FOR ALL DUCTILE IRON PIPE AND FITTINGS. SEE DETAIL W/2.8 AT CONCRETE INTERFACE.
11. PROVIDE RUBBER ANNULAR HYDROSTATIC SEALING DEVICES FOR ALL PIPE THROUGH WALL CONNECTIONS, SEE SPECIFICATIONS.
12. DO NOT LOCATE VAULT IN PAVED AREAS.

WASHINGTON
 SUBURBAN
 SANITARY
 COMMISSION

APPROVED:


9/28/16

 Chief Engineer


STANDARD DETAIL

TYPE 1 AND 2 PRESSURE
 REDUCING VALVE VAULT
 PIPING LAYOUT

W
 4.4

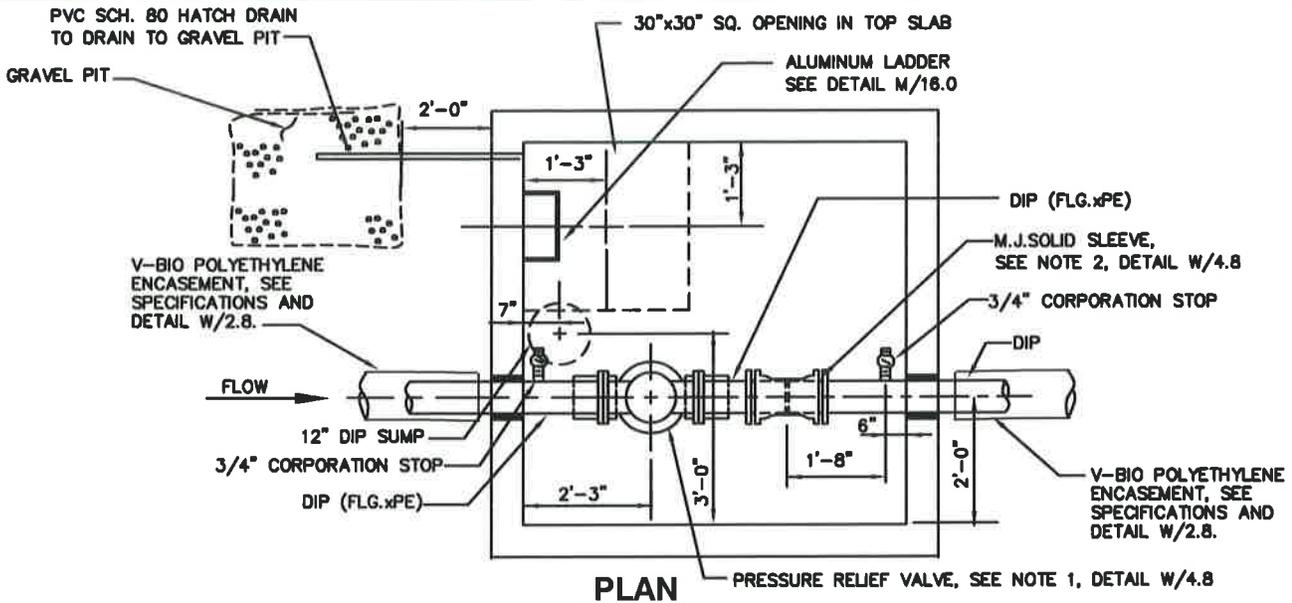

PLAN

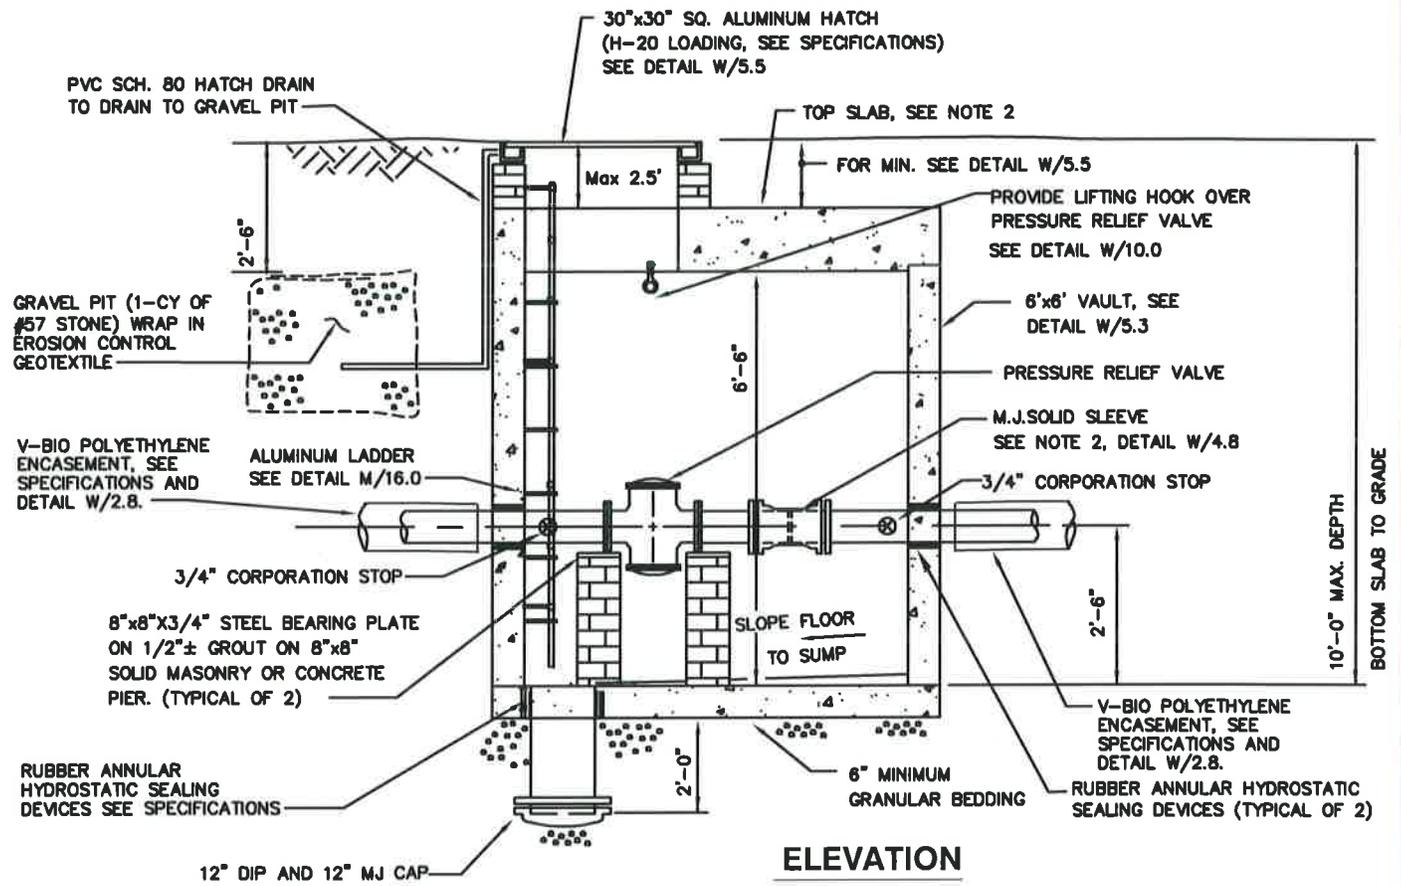

ELEVATION

NOTES:

1. FOR PIPE AND PRESSURE RELIEF VALVE SIZES, PIPING LAYOUT AND NOTES, SEE DETAILS W/4.8.
2. ONE PIECE TOP SLAB SIMILAR TO DETAIL W/5.2.
4. V-BIO POLYETHYLENE EASEMENT FOR ALL DUCTILE IRON PIPE AND FITTINGS. SEE DETAIL W/2.8 AT CONCRETE INTERFACE.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
**PRESSURE RELIEF
VALVE VAULT**

W
4.5

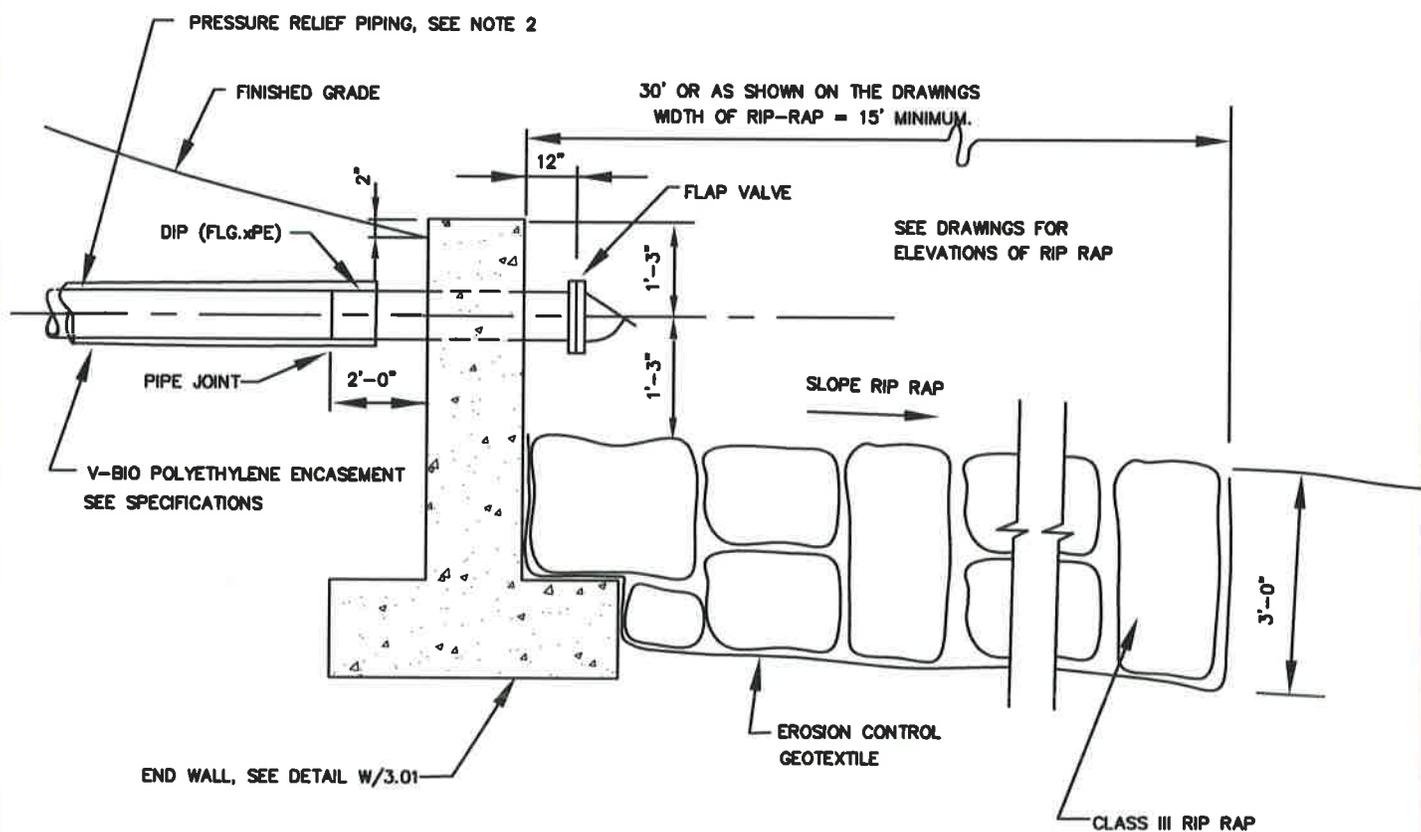


ELEVATION

NOTES

1. RESTRAIN ALL JOINTS ON PRESSURE RELIEF PIPING, SEE DETAIL W/4.8 NOTE 4.
2. SEE DRAWINGS FOR PROFILE OF PRESSURE RELIEF PIPING.
3. ONLY DUCTILE IRON PIPE AND FITTINGS.
4. V-BIO POLYETHYLENE EASEMENT FOR ALL DUCTILE IRON PIPE AND FITTINGS. SEE DETAIL W/2.8 AT CONCRETE INTERFACE.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
ENDWALL FOR
PRESSURE RELIEF VALVE PIPING

W
4.6

30"x30" SQ. OPENING IN TOP SLAB FOR VALVE REMOVAL, SEE NOTE A, DETAIL W/5.23.

M.J.SOLID SLEEVE, SEE NOTE 2, DETAIL W/4.8

5'-0"

PRESSURE RELIEF VALVE "B"
SEE NOTE 1, DETAIL W/4.8

DIP (FLG.xPE)

2'-6"

GATE VALVE

1'-8"

GRAVEL PIT

PVC SCH. 80 HATCH DRAIN TO DRAIN TO GRAVEL PIT

RUBBER ANNULAR HYDROSTATIC SEALING DEVICES (TYPICAL OF 4) SEE SPECIFICATIONS

12"

GATE VALVE

1'-3"

V-BIO POLYETHYLENE ENCASEMENT, SEE SPECIFICATIONS AND DETAIL W/2.8.

DIP (FLG.xPE)

3/4" CORPORATION STOP (TYPICAL OF 4)

2'-6"

GATE VALVE

3'-6"

ALUMINUM LADDER SEE DETAIL M/16.0

DIP (FLG.xPE)

DIP (FLG.xPE)

8"x8"x3/4" STEEL BEARING PLATE ON 1/2"± GROUT ON 8"x8" SOLID MASONRY OR CONCRETE PIER. (TYPICAL OF 6)

PRESSURE RELIEF VALVE "A"
SEE NOTE 1, DETAIL W/4.8

M.J.SOLID SLEEVE, SEE NOTE 2, DETAIL W/4.8

V-BIO POLYETHYLENE ENCASEMENT, SEE SPECIFICATIONS AND DETAIL W/2.8.

12" DIP SUMP

DIP (FLG.xPE)

DIP (FLG.xPE)

PLAN

30"x30" SQ. ALUMINUM HATCH (H-20 LOADING, SEE SPECIFICATIONS) FOR VALVE REMOVAL, SEE NOTE 1, DETAIL W/5.23.

FOR MIN. SEE DETAIL W/5.5

30"x30" SQ. ALUMINUM HATCH, SEE DETAIL W/5.5 (H-20 LOADING, SEE SPECIFICATIONS)

TOP SLAB, SEE NOTE 2

PROVIDE LIFTING HOOK OVER PRESSURE RELIEF VALVE WHEN ACCESS OPENING IS NOT PROVIDED. SEE DETAIL W/10.0

8'x8' VAULT, SEE DETAIL W/5.3

3/4" CORPORATION STOP

DIP (FLG.xPE)

2'-6" MAX.

PVC SCH. 80 HATCH DRAIN TO DRAIN TO GRAVEL PIT

PRESSURE RELIEF VALVE SEE NOTE 1, DETAIL W/4.8

GRAVEL PIT (1-CY OF #57 STONE) WRAP IN EROSION CONTROL GEOTEXTILE

10'-0" MAX. DEPTH
BOTTOM SLAB TO GRADE

FLG. GATE VALVES WITH HAND WHEELS (TYP. OF 4)

SLOPE FLOOR TO SUMP

V-BIO POLYETHYLENE ENCASEMENT, SEE SPECIFICATIONS AND DETAIL W/2.8.

DIP (FLG.xPE)

3/4" CORPORATION STOP

ALUMINUM LADDER SEE DETAIL M/16.0

6" MINIMUM GRANULAR BEDDING

RUBBER ANNULAR HYDROSTATIC SEALING DEVICES SEE SPECIFICATIONS

2'-0"

ELEVATION

12" DIP AND 12" MJ CAP

NOTES:

1. FOR PIPE AND PRESSURE RELIEF SIZES, PIPING LAYOUT AND NOTES, SEE DETAIL W/4.8
2. FOR TOP SLAB DETAIL, SEE DETAIL W/5.23.
2. FOR TOP SLAB DETAIL, SEE DETAIL W/5.23.
- FOR TOP SLAB DETAIL, SEE DETAIL W/5.23.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:


9/28/16

[Signature]
Chief Engineer


STANDARD DETAIL

DUEL PRESSURE RELIEF
VALVE VAULT

W
4.7

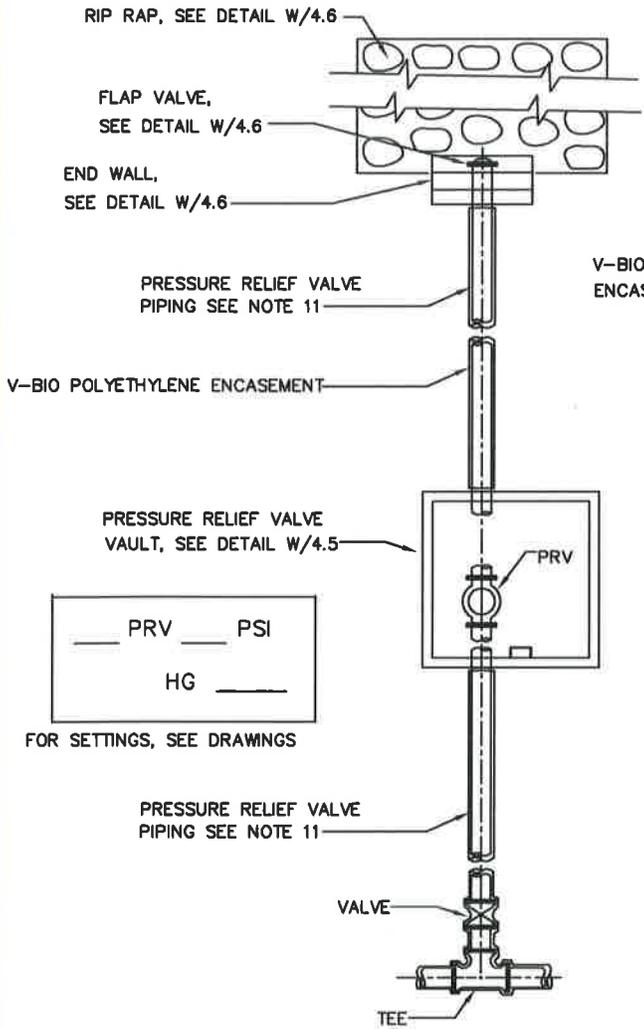

TYPICAL PIPING LAYOUT FOR DETAIL W/4.5

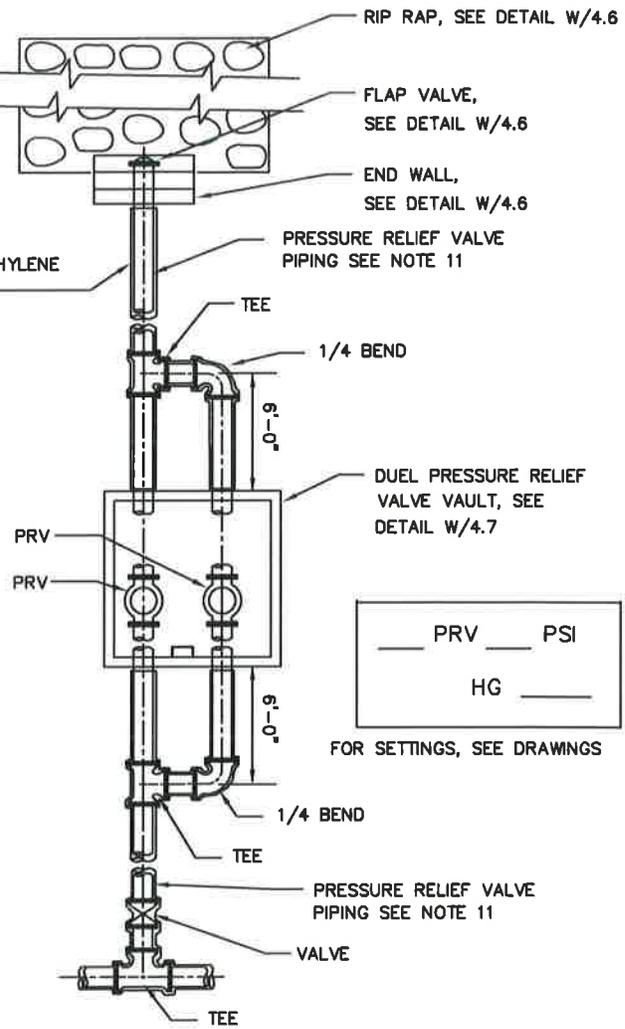

TYPICAL PIPING LAYOUT FOR DETAIL W/4.7

___ PRV ___ PSI
 ___ HG ___

FOR SETTINGS, SEE DRAWINGS


___ PRV ___ PSI
 ___ HG ___

FOR SETTINGS, SEE DRAWINGS


NOTES:

1. SIZE OF PRESSURE RELIEF VALVE AND PIPING SHALL BE 6" OR SMALLER, SEE DRAWINGS.
2. PROVIDE M.J. SOLID SLEEVE WHERE SHOWN WITH WEDGE ACTION RESTRAINER GLAND, SEE SPECIFICATIONS. TOLERANCE BETWEEN PIPE ENDS SHALL NOT EXCEED 1/2". DO NOT USE PIPE SPACERS, SEE SPECIFICATIONS.
3. ONLY DUCTILE IRON PIPE AND FITTINGS.
4. RESTRAIN ALL JOINTS, SEE SPECIFICATIONS AND BLOCK ALL FITTINGS.
5. PROVIDE EXTENSION STEMS AND VALVE BOXES FOR ALL BURIED VALVES, SEE DETAIL W/2.2.
6. THIS VALVE VAULT IS NOT FOR ELECTRICALLY CONTROLLED OR OPERATED VALVES.
7. STANDARD PRESSURE RELIEF VAULT IS BASED ON THE ASSUMPTIONS AND LIMITATIONS. IF THESE CONDITIONS ARE NOT MET, SPECIAL DESIGN IS REQUIRED.
 - a). ELEVATION OF GROUND WATER IS ASSUMED TO BE 2'-0" BELOW BOTTOM SLAB ELEVATION.
 - b). LOCATION OF VAULT IS ASSUMED TO BE LOCATED OUTSIDE THE ROAD RIGHT OF WAY.
8. PROVIDE LIFTING HOOKS OVER PRESSURE RELIEF VALVE WHEN HATCH IS NOT PROVIDED OVER THE PRESSURE RELIEF VALVE.
9. V-BIO POLYETHYLENE ENCASEMENT FOR ALL DUCTILE IRON PIPE AND FITTINGS. SEE DETAIL W/2.8 AT CONCRETE INTERFACE.
10. PROVIDE RUBBER ANNULAR HYDROSTATIC SEALING DEVICES FOR ALL PIPE THROUGH WALL CONNECTIONS, SEE SPECIFICATIONS.
11. SEE DRAWINGS FOR PLAN AND PROFILE OF PRESSURE RELIEF PIPING.
12. DO NOT LOCATE VAULT IN PAVED AREA.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u> Chief Engineer	STANDARD DETAIL PRESSURE RELIEF VALVE VAULT PIPING PLAN	<table style="margin: 0 auto;"> <tr><td style="text-align: center;">W</td></tr> <tr><td style="text-align: center;">4.8</td></tr> </table>	W	4.8
W					
4.8					

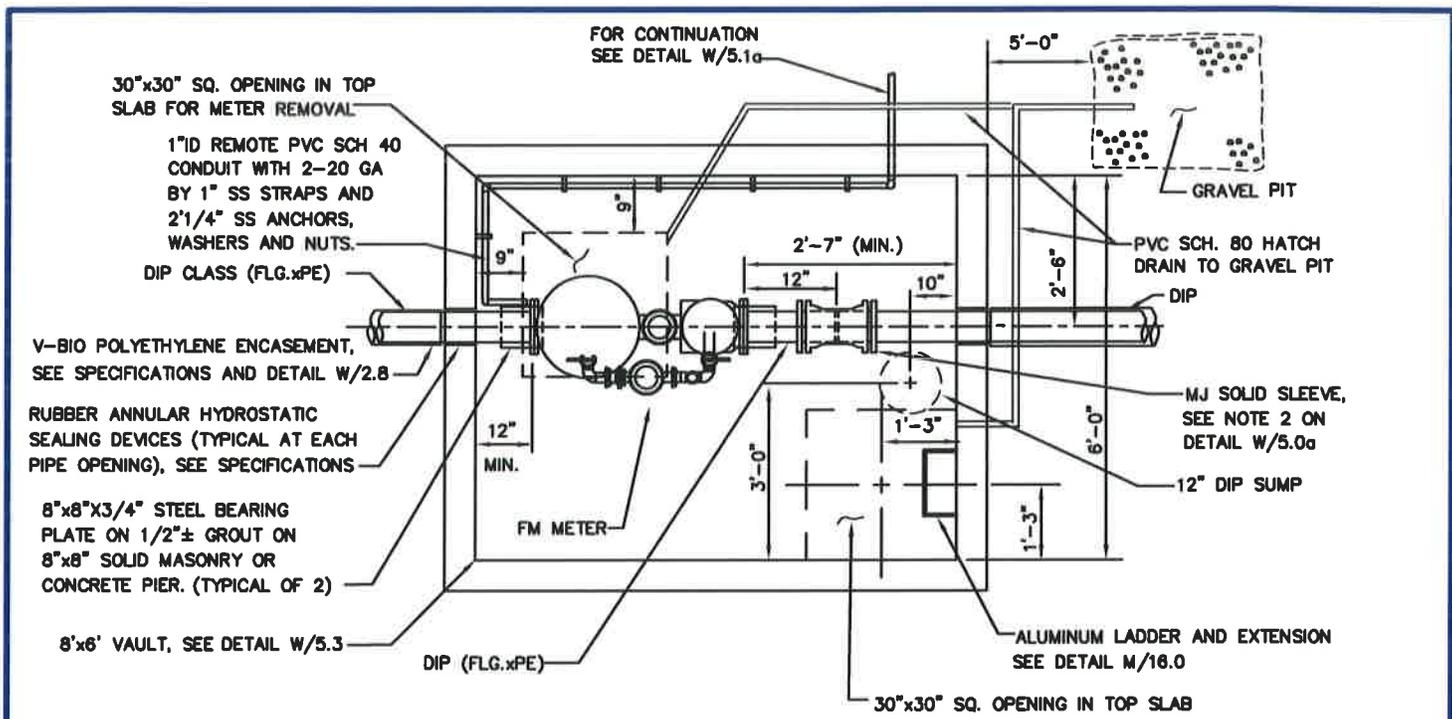

PLAN

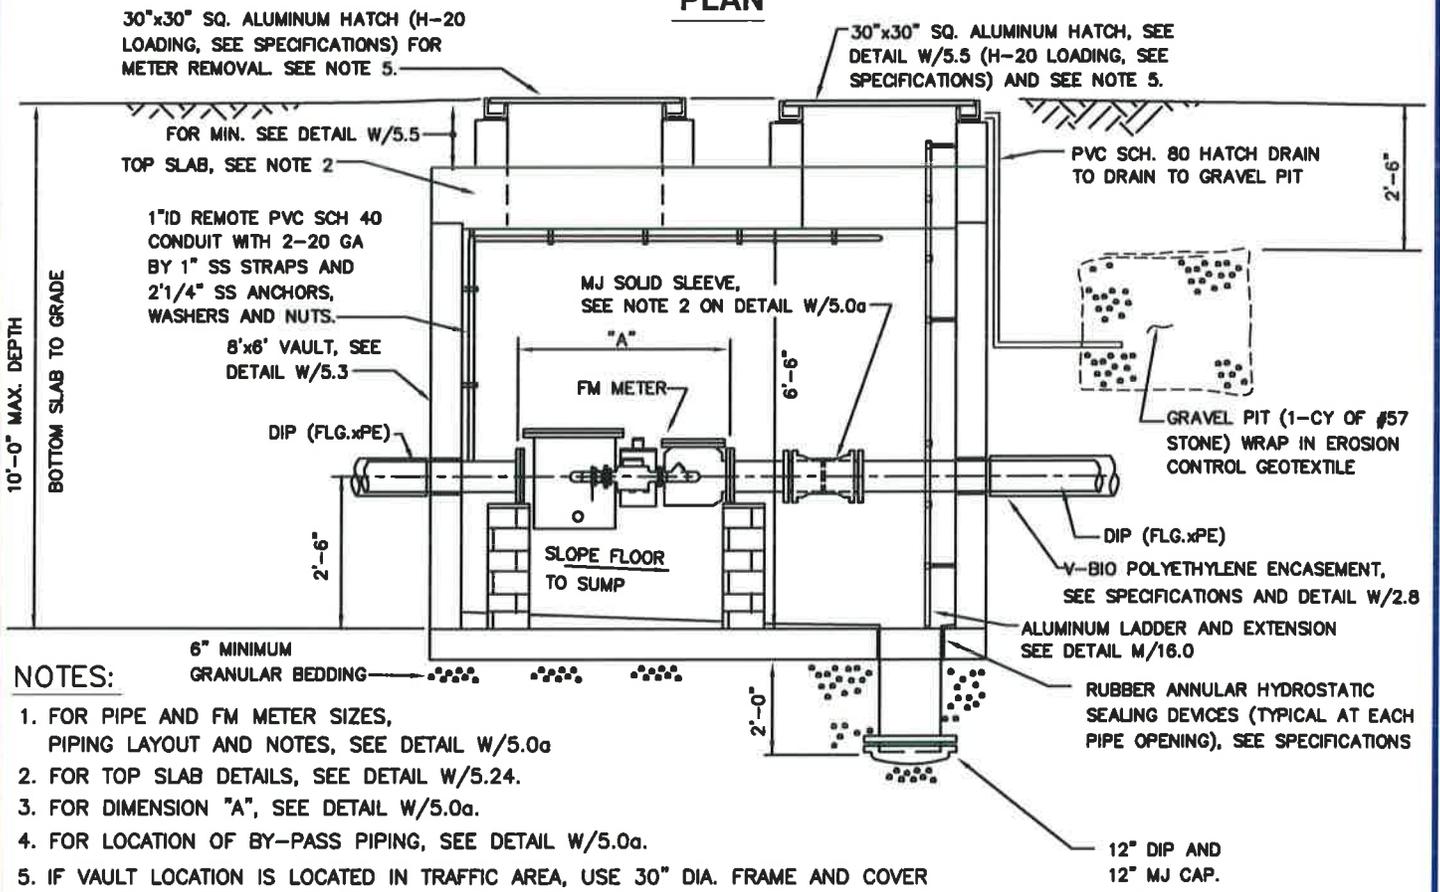


ELEVATION

NOTES:

1. FOR PIPE AND FM METER SIZES, PIPING LAYOUT AND NOTES, SEE DETAIL W/5.0a
2. FOR TOP SLAB DETAILS, SEE DETAIL W/5.24.
3. FOR DIMENSION "A", SEE DETAIL W/5.0a.
4. FOR LOCATION OF BY-PASS PIPING, SEE DETAIL W/5.0a.
5. IF VAULT LOCATION IS LOCATED IN TRAFFIC AREA, USE 30" DIA. FRAME AND COVER AND REMOTE READING DEVICE, FOR LOCATION SEE W/5.0a.
6. FOR REMOTE READING DEVICE, SEE DETAIL W/5.0e

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <i>9/28/16</i> Chief Engineer	STANDARD DETAIL 4-INCH, 6-INCH AND 8-INCH F.M. METER VAULT	<table style="margin: 0 auto;"> <tr><td style="text-align: center;">W</td></tr> <tr><td style="text-align: center;">5.0</td></tr> </table>	W	5.0
W					
5.0					

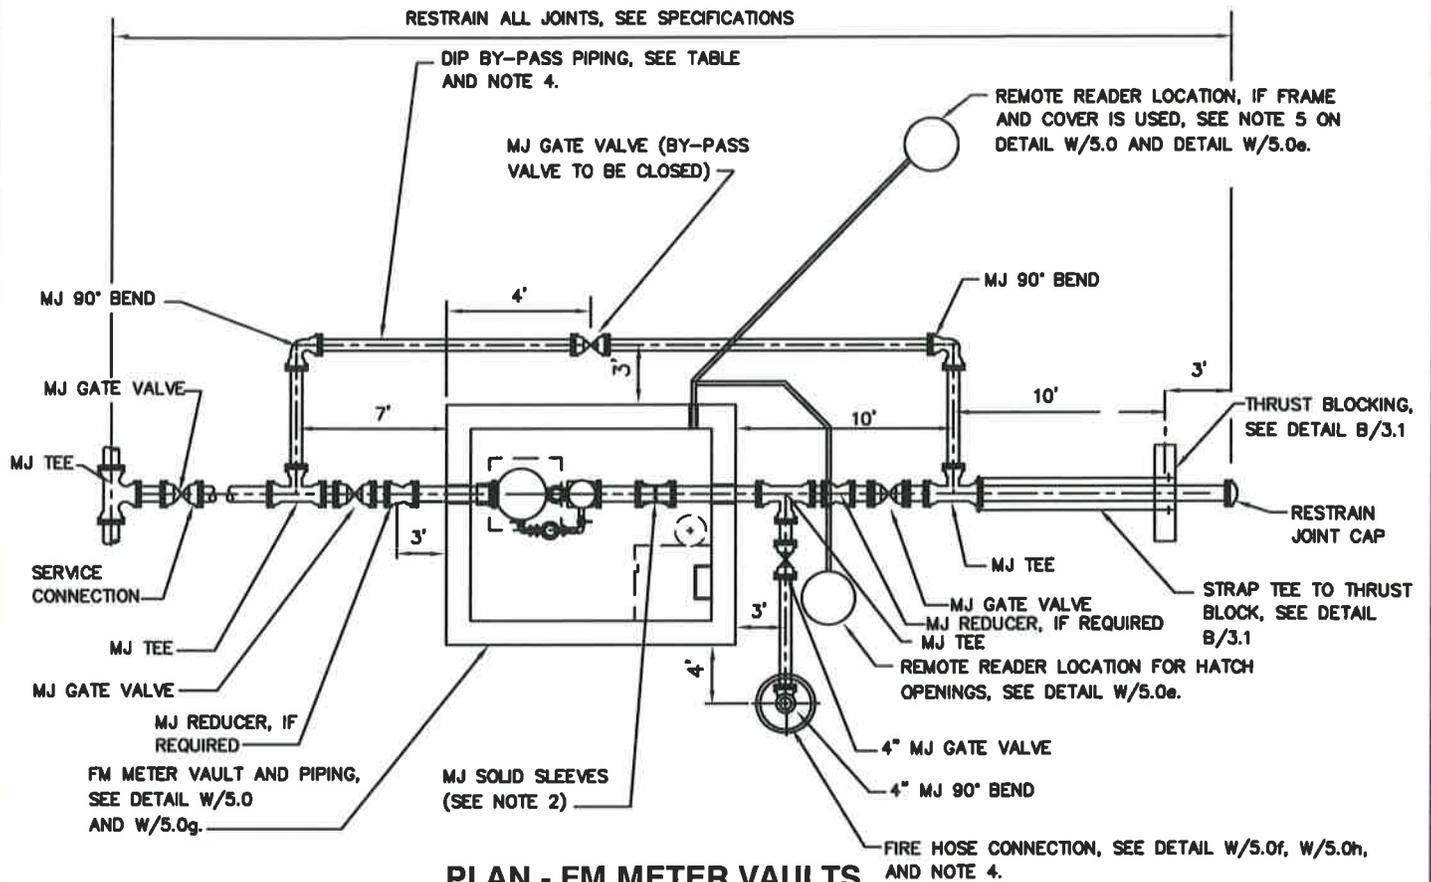

**PLAN - FM METER VAULTS
TYPICAL PIPING LAYOUT**

NOTES:

1. FOR FM METER VAULT AND PIPING DETAILS, SEE DETAIL W/5.0. AND W/5.0g
2. PROVIDE M.J. SOLID SLEEVE WHERE SHOWN WITH WEDGE ACTION RESTRAINER GLAND, SEE SPECIFICATIONS. TOLERANCE BETWEEN PIPE ENDS SHALL NOT EXCEED 1/2". DO NOT USE PIPE SPACERS, SEE SPECIFICATIONS.
3. ONLY DUCTILE IRON PIPE AND FITTINGS, EXCEPT AS NOTED. SEE DRAWINGS FOR SIZES.
4. RESTRAIN ALL JOINTS ON BY-PASS PIPING FROM TEE TO TEE WITH WEDGE ACTION RESTRAINER GLANDS, SEE SPECIFICATION. RESTRAIN ALL JOINTS ON FIRE HOSE CONNECTION WITH WEDGE ACTION RESTRAINER GLANDS.
5. PROVIDE EXTENSION STEMS AND VALVE BOXES FOR ALL BURIED VALVES, SEE DETAIL W/2.2.
6. POLYETHYLENE ENCASEMENT FOR ALL DUCTILE IRON PIPE AND FITTINGS. SEE DETAIL W/2.8 FOR CONCRETE INTERFACE.
7. PROVIDE RUBBER ANNULAR HYDROSTATIC SEALING DEVICES FOR ALL PIPE THROUGH WALL CONNECTIONS, SEE SPECIFICATIONS.
8. WHEN 12" FM METERS ARE REQUIRED, USE 10" FM, SEE W/5.0i. SERVICE PIPING AND BY-PASS SHALL BE 12"DIA.

BY-PIPE SIZE	
FM METER SIZE	BY-PASS PIPE SIZE
4"	4"
6"	6"
8"	8"
10"	10"

"A" DIMENSION (SEE DETAIL W/5.0)	
FM METER SIZE	"A" (LENGTH OF METER)
4"	33"
6"	45"
8"	53"
10"	68"


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16


Chief Engineer

STANDARD DETAIL
4-INCH, 6-INCH, 8-INCH AND 10-INCH
F.M. METER VAULT PIPING LAYOUT

W
5.0a

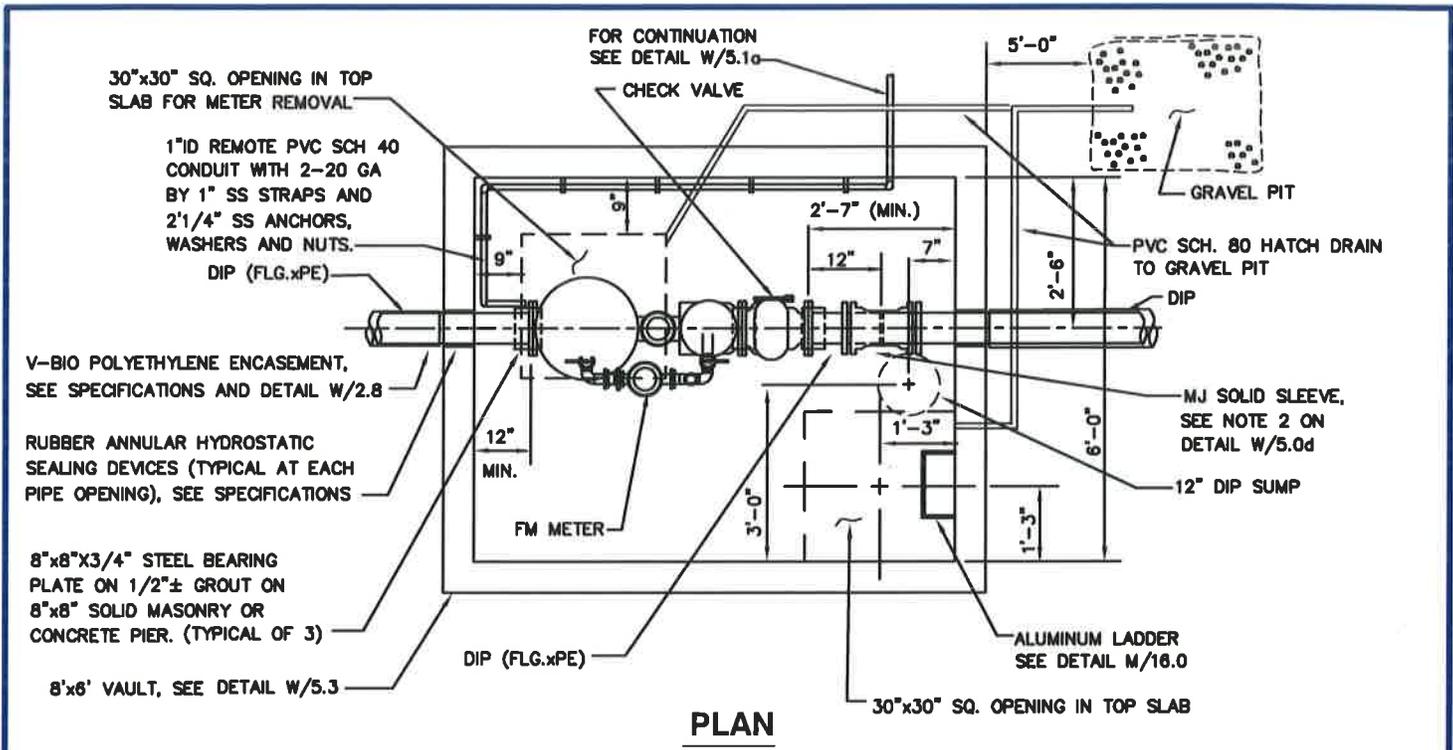

PLAN

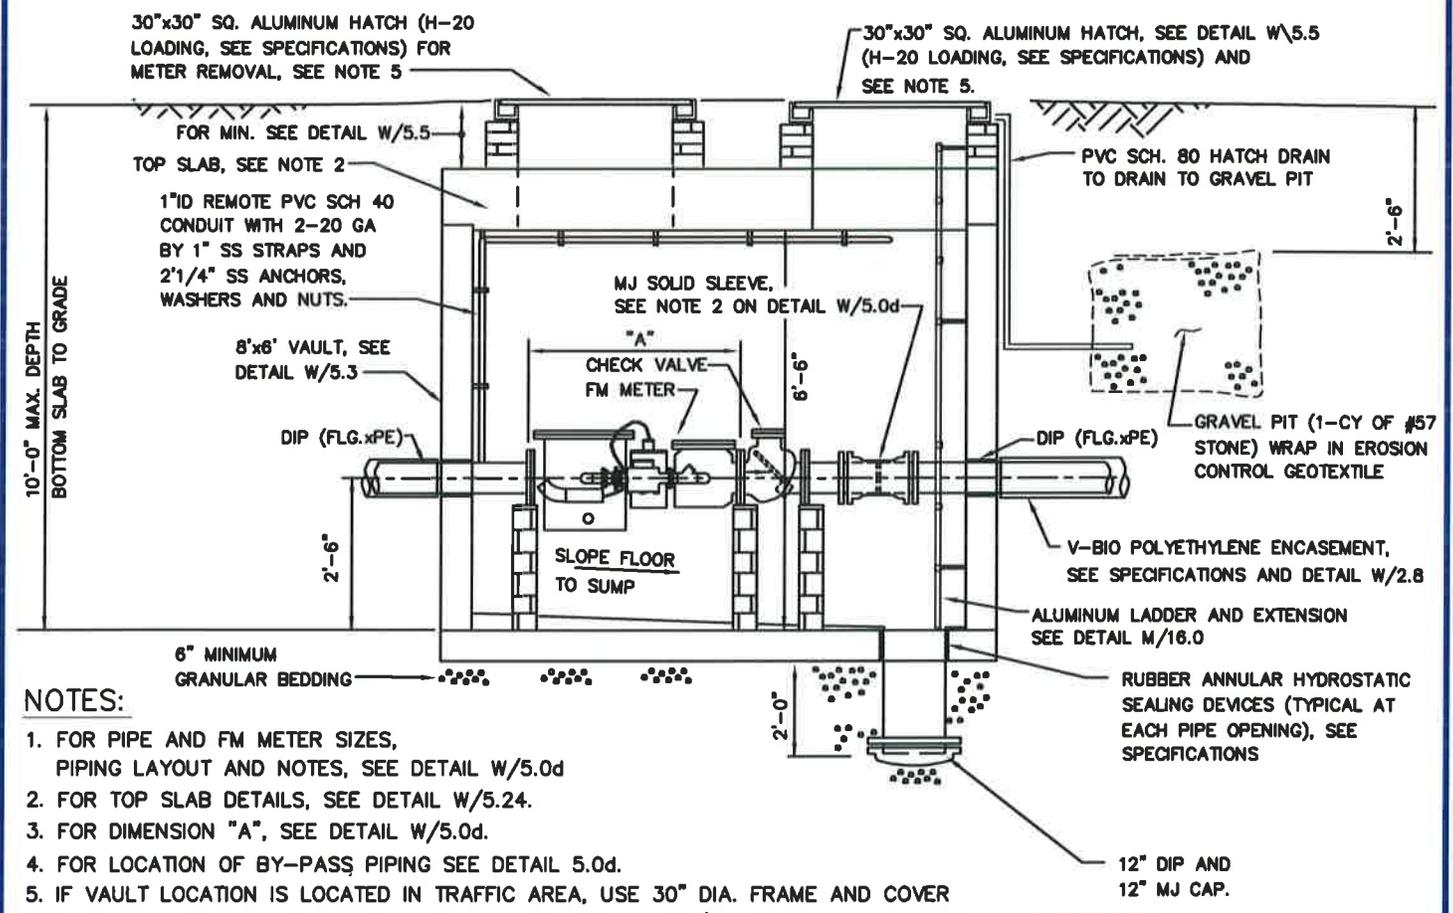


ELEVATION


NOTES:

1. FOR PIPE AND FM METER SIZES, PIPING LAYOUT AND NOTES, SEE DETAIL W/5.0d
2. FOR TOP SLAB DETAILS, SEE DETAIL W/5.24.
3. FOR DIMENSION "A", SEE DETAIL W/5.0d.
4. FOR LOCATION OF BY-PASS PIPING SEE DETAIL 5.0d.
5. IF VAULT LOCATION IS LOCATED IN TRAFFIC AREA, USE 30" DIA. FRAME AND COVER AND REMOTE READING DEVICE, FOR LOCATION SEE DETAIL W/5.0a.
6. FOR REMOTE READING DEVICE, SEE DETAIL W/5.0e.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u> Chief Engineer	STANDARD DETAIL 4-INCH FM METER WITH CHECK VALVE VAULT	$\frac{W}{5.0b}$
--	--	--	------------------

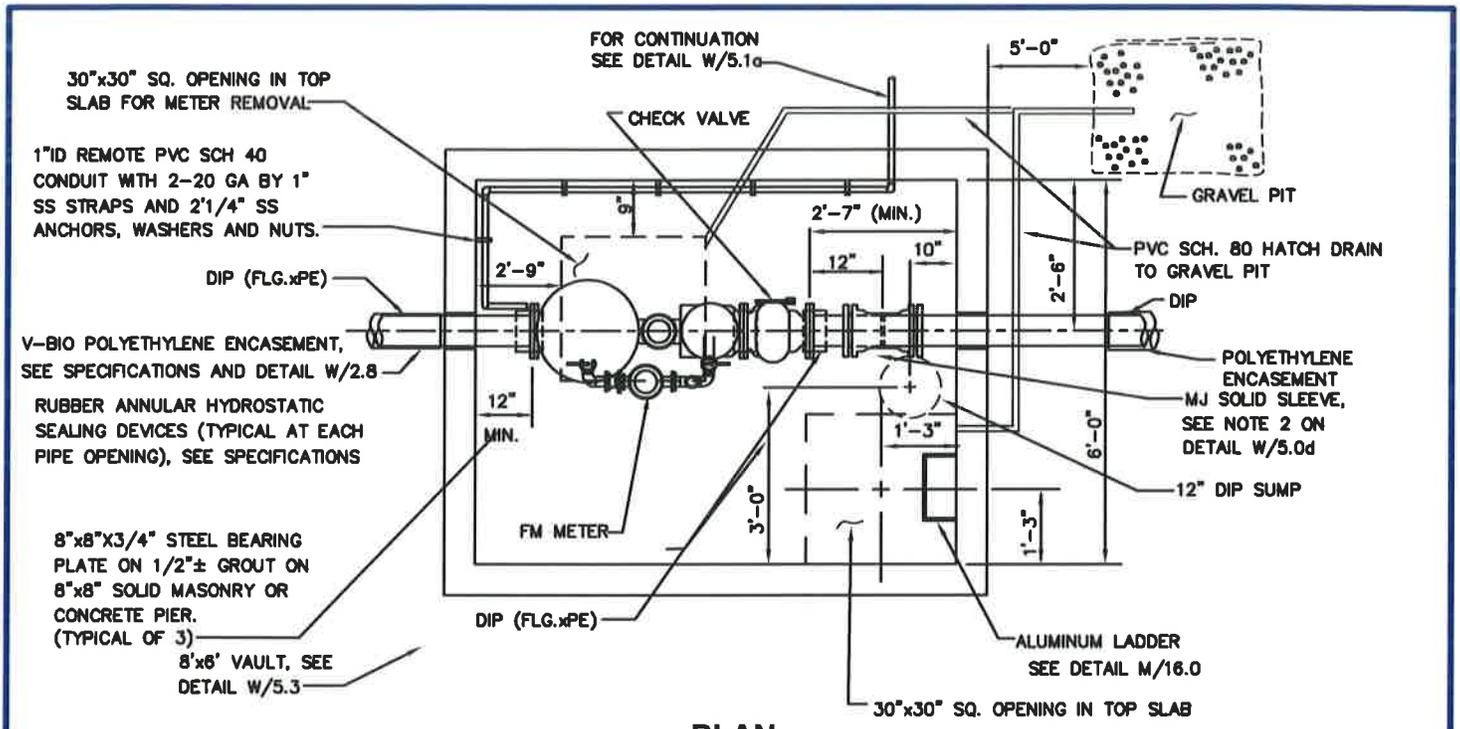

PLAN

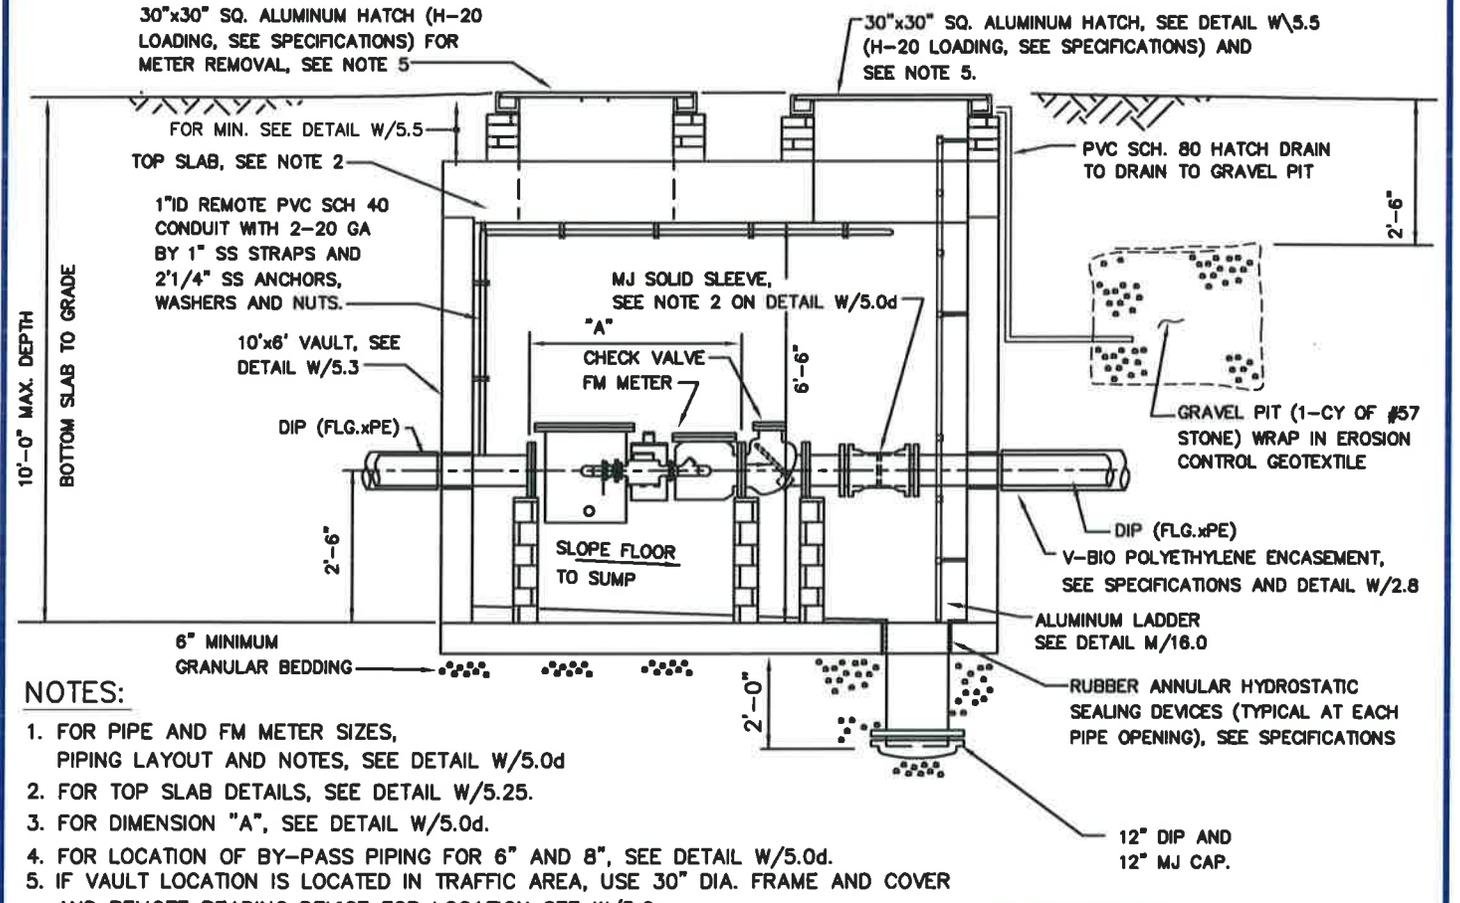

ELEVATION

NOTES:

1. FOR PIPE AND FM METER SIZES, PIPING LAYOUT AND NOTES, SEE DETAIL W/5.0d
2. FOR TOP SLAB DETAILS, SEE DETAIL W/5.25.
3. FOR DIMENSION "A", SEE DETAIL W/5.0d.
4. FOR LOCATION OF BY-PASS PIPING FOR 6" AND 8", SEE DETAIL W/5.0d.
5. IF VAULT LOCATION IS LOCATED IN TRAFFIC AREA, USE 30" DIA. FRAME AND COVER AND REMOTE READING DEVICE FOR LOCATION SEE W/5.0a.
6. FOR REMOTE READING DEVICE, SEE DETAIL W/5.0e.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: *9/28/16*

Chief Engineer

STANDARD DETAIL
**6-INCH AND 8-INCH FM METER
WITH CHECK VALVE VAULT**

W
5.0c

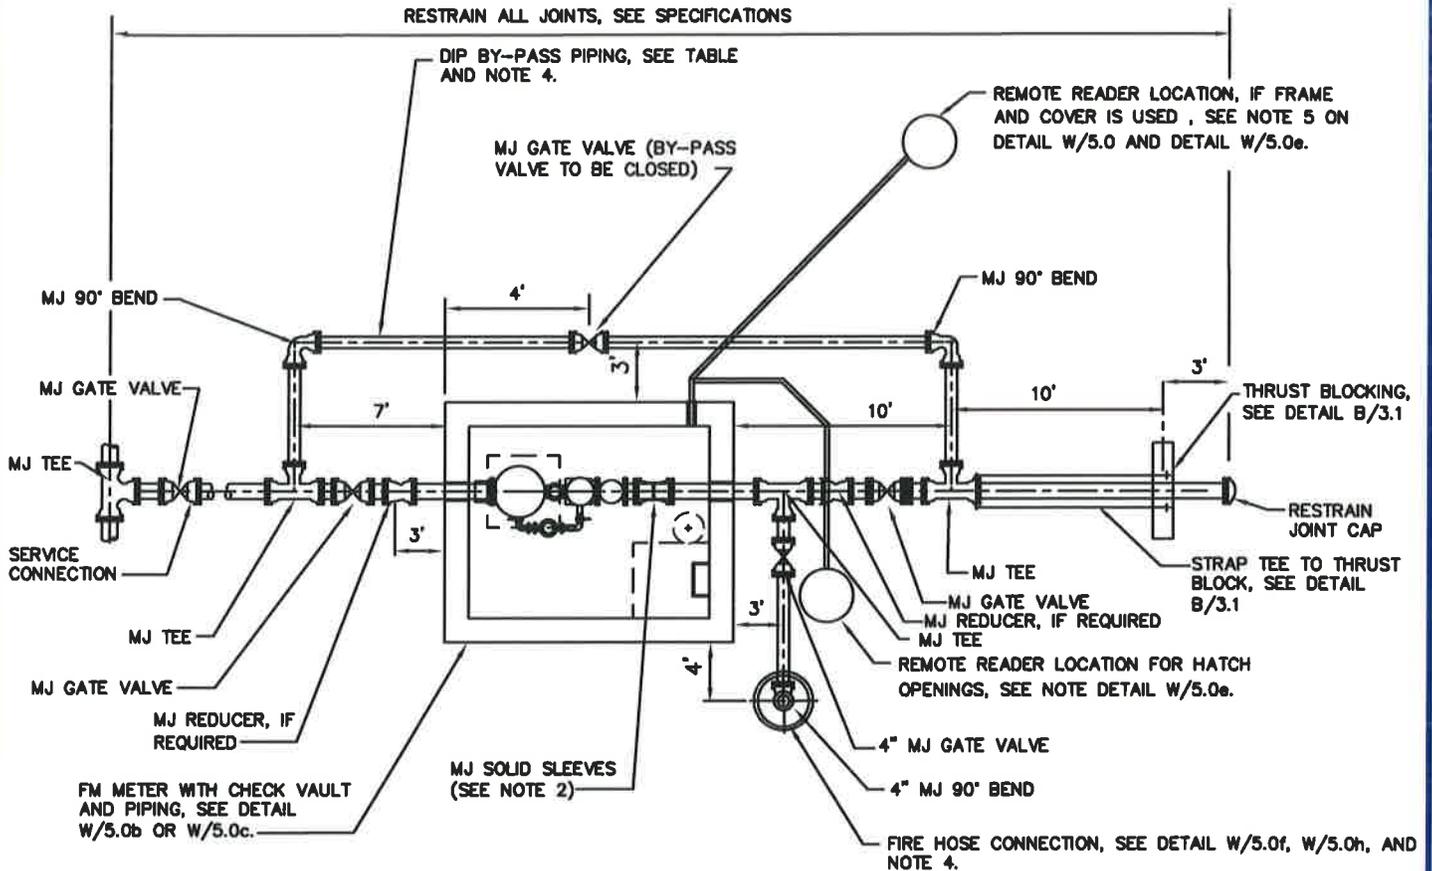

**PLAN - FM METER WITH CHECK VALVE IN VAULT
TYPICAL PIPING LAYOUT**

NOTES:

1. FOR FM METER WITH CHECK VALVE VAULT AND PIPING DETAILS, SEE DETAIL W/5.0b and w/5.0c.
2. PROVIDE M.J. SOLID SLEEVE WHERE SHOWN WITH WEDGE ACTION RESTRAINER GLAND, SEE SPECIFICATIONS. TOLERANCE BETWEEN PIPE ENDS SHALL NOT EXCEED 1/2". DO NOT USE PIPE SPACERS, SEE SPECIFICATIONS.
3. ONLY DUCTILE IRON PIPE AND FITTINGS, EXCEPT AS NOTED. SEE DRAWINGS FOR SIZES.
4. RESTRAIN ALL JOINTS ON BY-PASS PIPING FROM TEE TO TEE WITH WEDGE ACTION RESTRAINER GLANDS, SEE SPECIFICATIONS. RESTRAIN ALL JOINTS ON FIRE HOSE CONNECTION PIPING WITH WEDGE ACTION RESTRAINER GLANDS, SEE SPECIFICATIONS.
5. PROVIDE EXTENSION STEMS AND VALVE BOXES FOR ALL BURIED VALVES, SEE DETAIL W/2.2.
6. V-BIO POLYETHYLENE ENCASUREMENT FOR ALL DUCTILE IRON PIPE AND FITTINGS. SEE DETAIL W/2.8 FOR CONCRETE INTERFACE.
7. PROVIDE RUBBER ANNULAR HYDROSTATIC SEALING DEVICES FOR ALL PIPE THROUGH WALL CONNECTIONS, SEE SPECIFICATIONS.

BY-PIPE SIZE	
FM METER SIZE	BY-PASS PIPE SIZE
4"	4"
6"	6"
8"	8"

"A" DIMENSION (SEE DETAIL W/5.0b OR W/5.0c)	
FM METER SIZE	"A" (LENGTH OF METER)
4"	33"
6"	45"
8"	53"

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
4-INCH, 6-INCH AND 8-INCH
F.M. METER WITH CHECK VALVE
IN VAULT
PIPING LAYOUT

W
5.0d

11-1/2" SINGLE RECESS METER FRAME AND COVER.
SET FLUSH TO FINISHED GRADE.

REMOTE READING DEVICE, SEE SPECIFICATIONS

FINISHED GRADE

PLASTIC METER BOX
EXTENSION, IF REQUIRED
TO ADJUST METER FRAME AND
COVER TO FINISHED GRADE

20" DIAMETER

6"

2" DIA. PVC PIPE TO METER VAULT
OR HOUSING
(MIN. 2'-0" OF COVER)

24" DIAMETER

REMOTE READING CABLE
SEE NOTE 3.

24" DIAMETER TAPERED PLASTIC
METER BOX, 30" LENGTH

8" MINIMUM
BORROW AGGREGATE

6" MINIMUM

6"

6"

MINIMUM

UNDISTURBED FIRM SUBGRADE
OR STRUCTURAL FILL

BORROW AGGREGATE ASTM C33,
COARSE AGGREGATE SIZE NUMBER 8.

NOTES:

1. METER SETTING FOR NON-TRAFFIC AREAS ONLY. DO NOT LOCATE IN SIDEWALK OR DRIVEWAY, UNLESS OTHERWISE NOTED ON THE DRAWINGS.
2. COMPACT BACKFILL AND AGGREGATE BASE AS STRUCTURAL FILL.
3. REMOTE READING CABLE WITHOUT SPLICES THROUGH CONDUIT PIPING.
4. WHEN TWO REMOTE READING DEVICES ARE REQUIRED, USE 11-1/2" DOUBLE RECESS METER FRAME AND COVER.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:


9/28/16

Chief Engineer

STANDARD DETAIL

REMOTE READING DEVICE
FOR
METER LOCATED IN ROADWAYS


W
5.0e

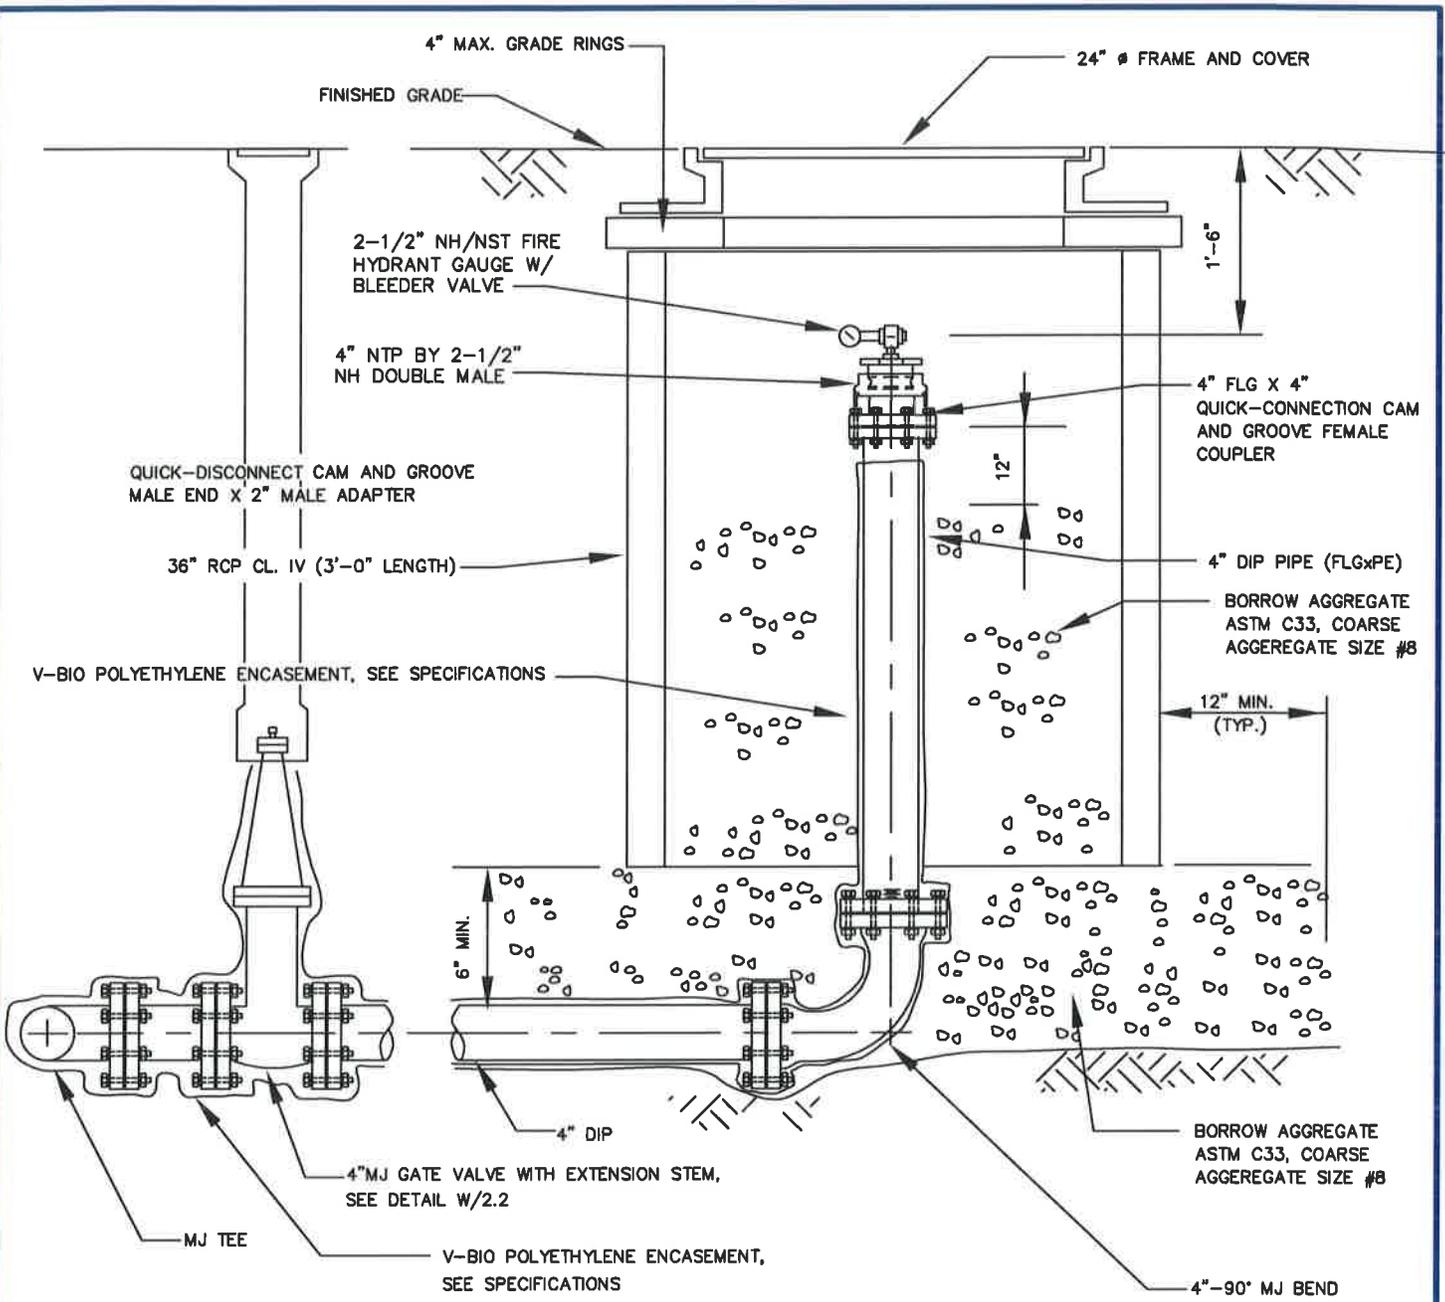


NOTES:

1. FIRE HYDRANT HOSE CONNECTION SETTING FOR NON-TRAFFIC AREAS ONLY, DO NOT LOCATE IN SIDEWALK OR DRIVEWAY, UNLESS OTHERWISE NOTED ON THE DRAWINGS.
2. COMPACT BACKFILL AND AGGREGATE BASE AS STRUCTURAL FILL.
3. QUICK-DISCONNECT CAM AND GROOVE FITTINGS SHALL BE BRASS RATED AT 150 PSI AND IN ACCORDANCE WITH US MILITARY SPECIFICATIONS MIL-C-27487/US FEDERAL STANDARD A-A-59326.
4. RESTRAIN ALL JOINTS FROM MJ TEE TO 4" COMPANION FLANGED WITH WEDGE ACTION RESTRAINER GLANDS, SEE SPECIFICATIONS

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: 9/28/16 Chief Engineer	STANDARD DETAIL FIRE HOSE CONNECTION FOR FM METER, ULTRASONIC METER, AND DETECTOR CHECK VAULT LAYOUTS	W <hr style="width: 50%; margin: 0 auto;"/> 5.0f
--	--	---	---

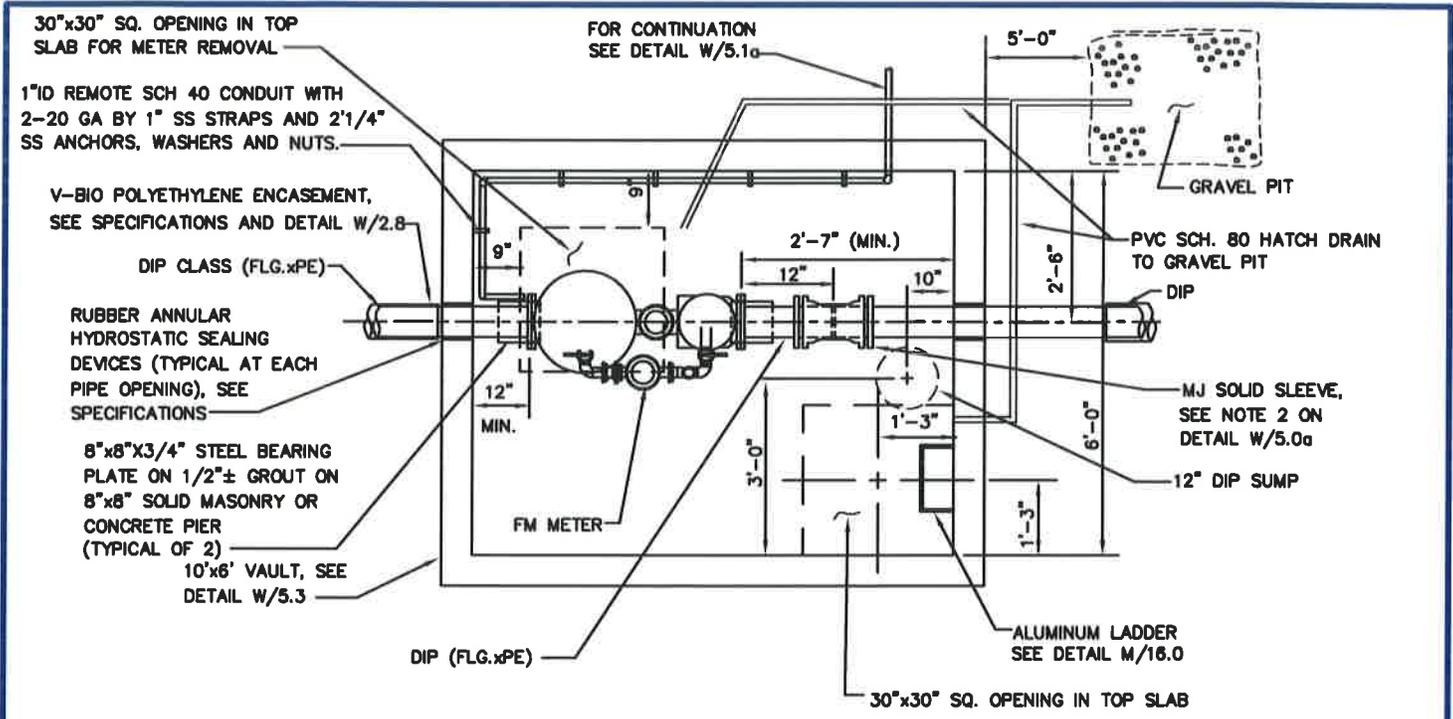

PLAN

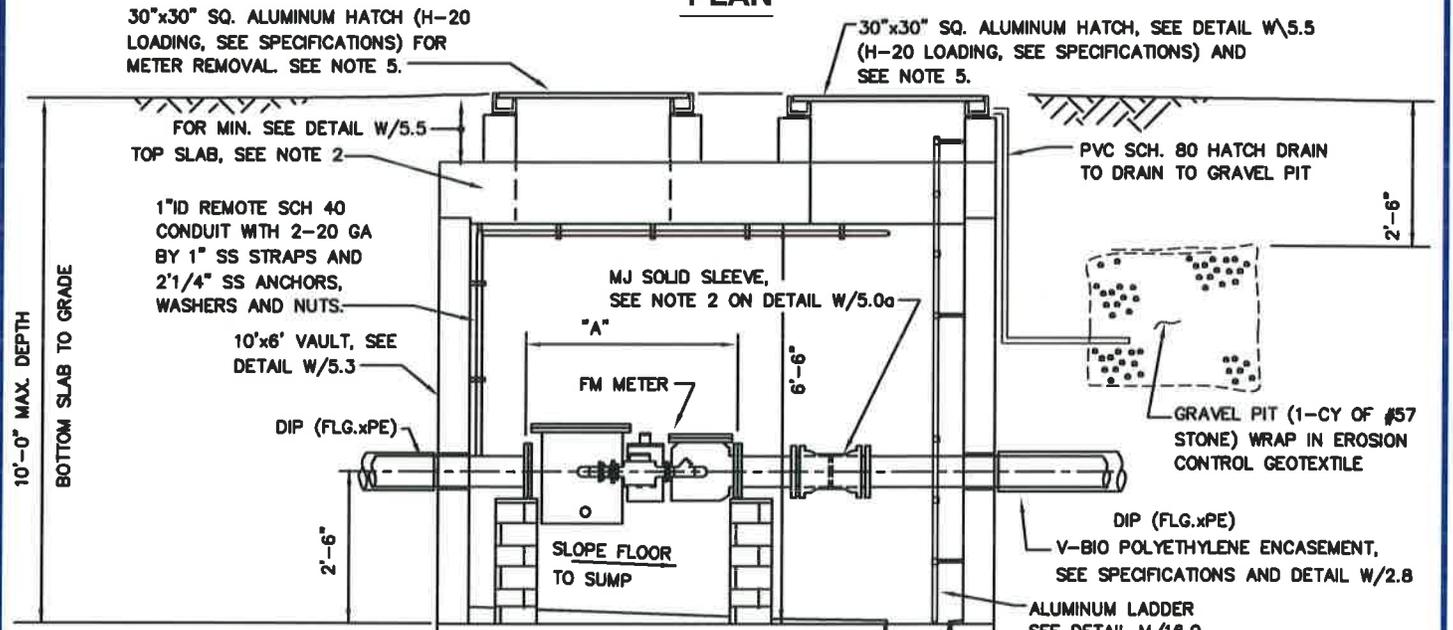

ELEVATION

NOTES:

1. FOR PIPE AND FM METER SIZES, PIPING LAYOUT AND NOTES, SEE DETAIL W/5.0a
2. FOR TOP SLAB DETAILS, SEE DETAIL W/5.25.
3. FOR DIMENSION "A", SEE DETAIL W/5.0a.
4. FOR LOCATION OF BY-PASS PIPING, SEE DETAIL W/5.0a.
5. IF VAULT LOCATION IS LOCATED IN TRAFFIC AREA, USE 30" DIA. FRAME AND COVER AND SEE DETAIL W/5.0e.
6. FOR 12" DIP, USE 10" FM METER WITH 12" SERVICE CONNECTION AND 12" BY-PASS PIPING.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
**10-INCH
F.M. METER VAULT**

W

5.0g

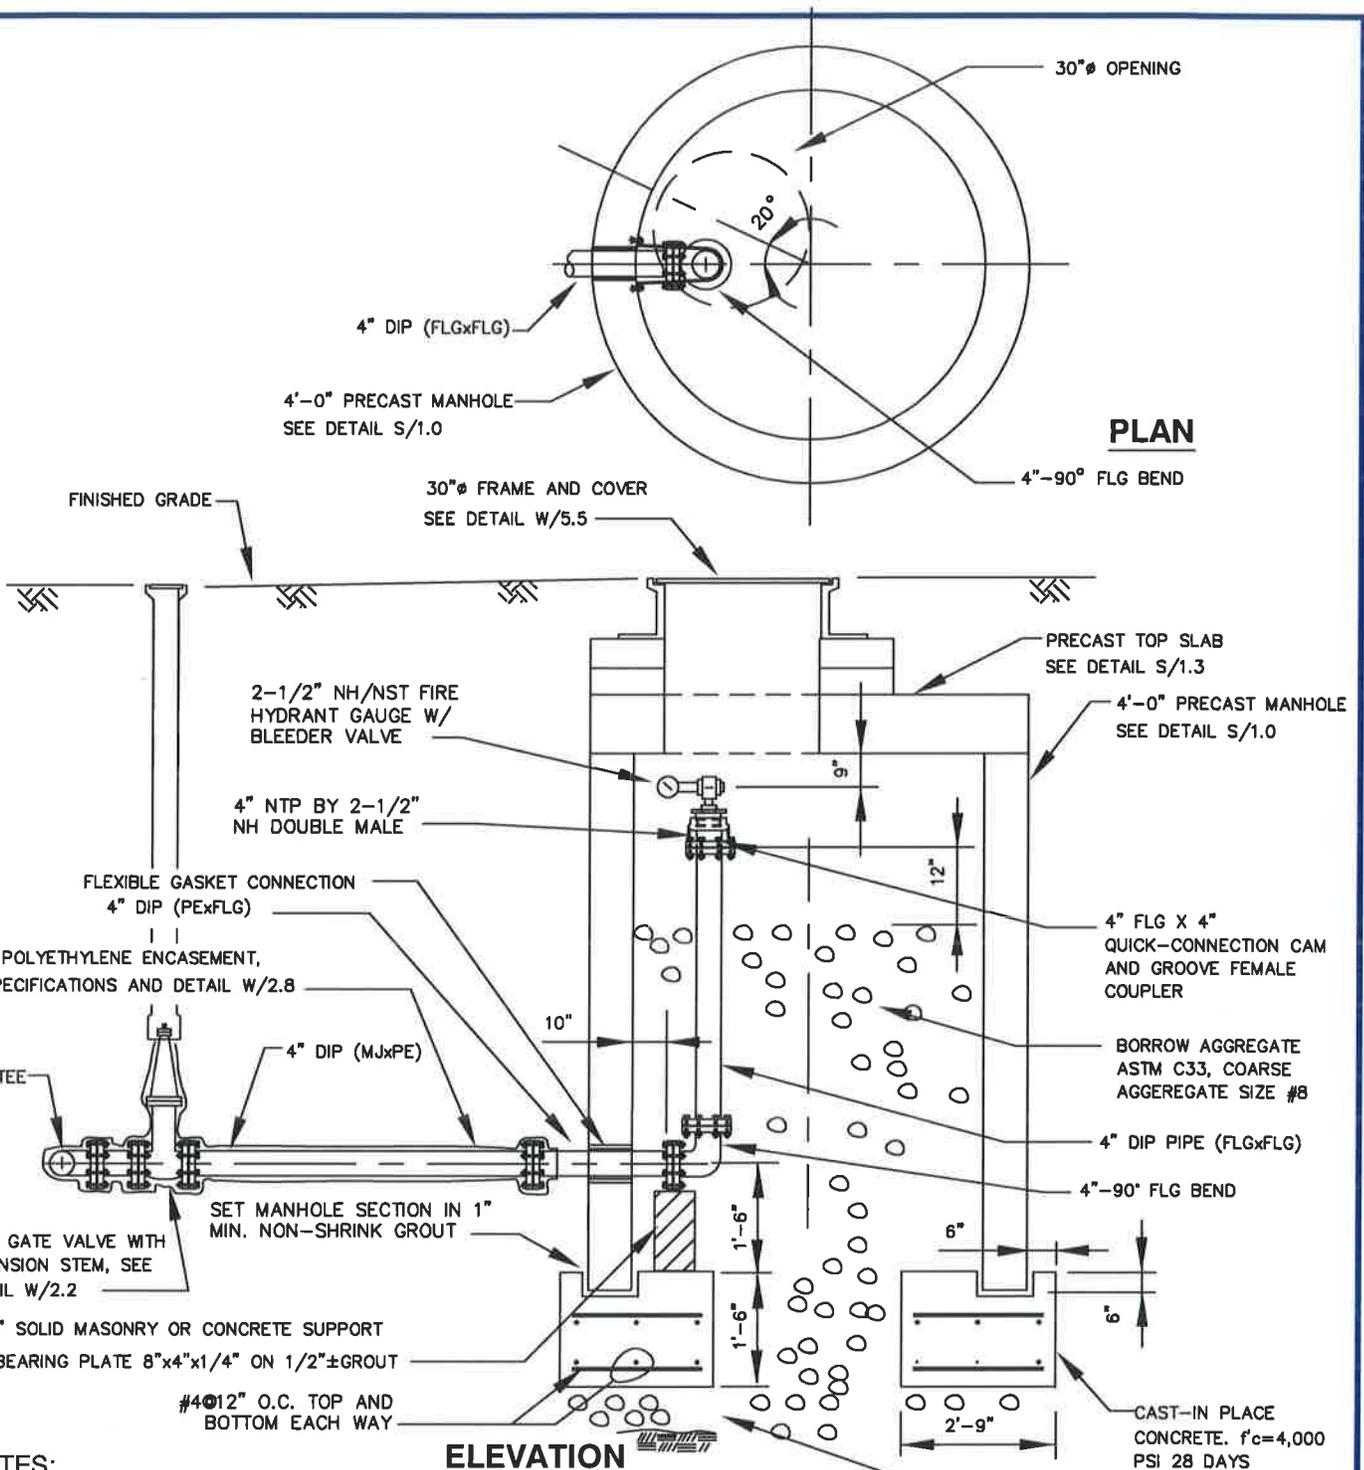


PLAN

ELEVATION


NOTES:

1. FIRE HYDRANT HOSE CONNECTION SETTING FOR TRAFFIC AREAS ONLY.
2. QUICK-DISCONNECT CAM AND GROOVE FITTINGS SHALL BE BRASS RATED AT 150 PSI AND IN ACCORDANCE WITH US MILITARY SPECIFICATIONS MIL-C-27487/US FEDERAL STANDARD A-A-59326.
3. RESTRAIN ALL JOINTS FROM MJ TEE TO 4"-90 FLANGED BEND WITH WEDGE ACTION RESTRAINER GLANDS, SEE SPECIFICATIONS.
4. COMPACT BACKFILL AND AGGREGATE BASE AS STRUCTURAL FILL.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u>  Chief Engineer	STANDARD DETAIL FIRE HOSE CONNECTION IN TRAFFIC AREAS FOR FM METER ULTRASONIC AND DETECTOR CHECK VAULT LAYOUTS	W <hr style="width: 50%; margin: 0 auto;"/> 5.0h
--	---	--	---

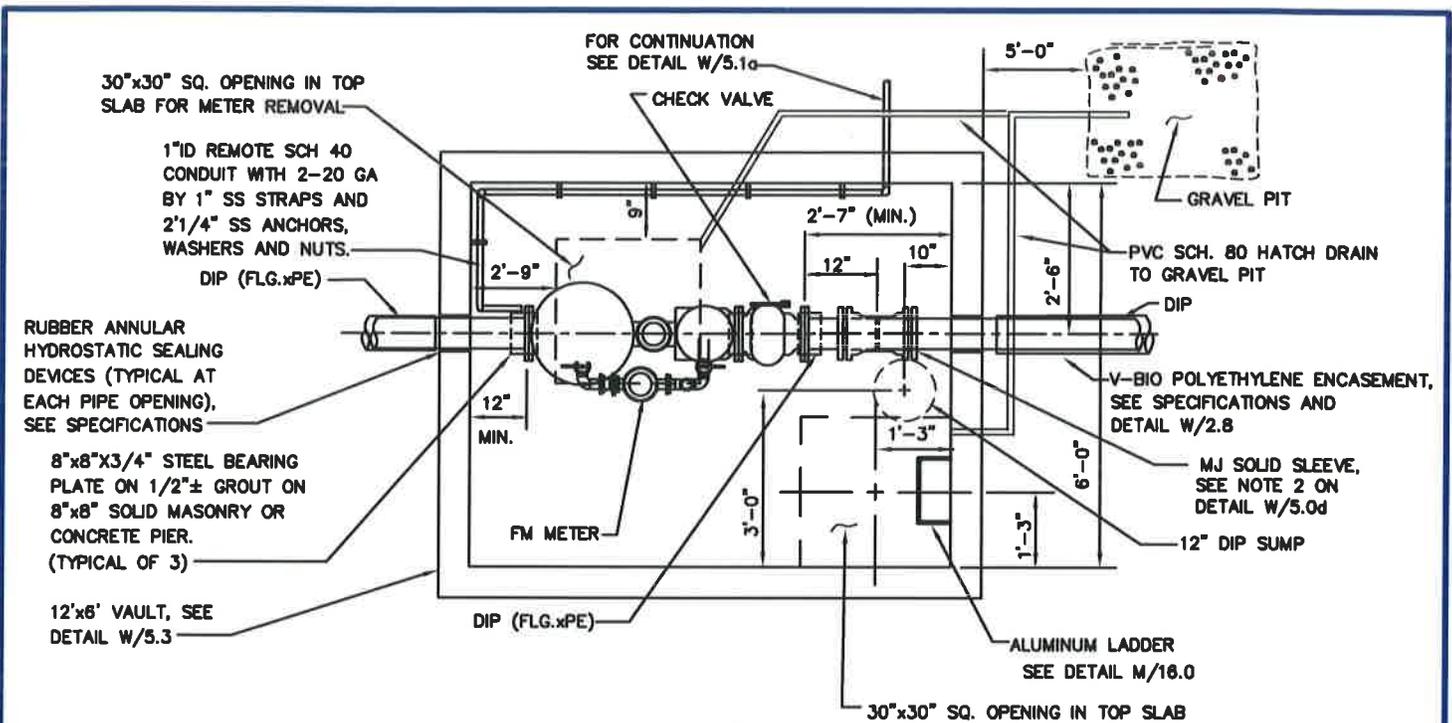

PLAN

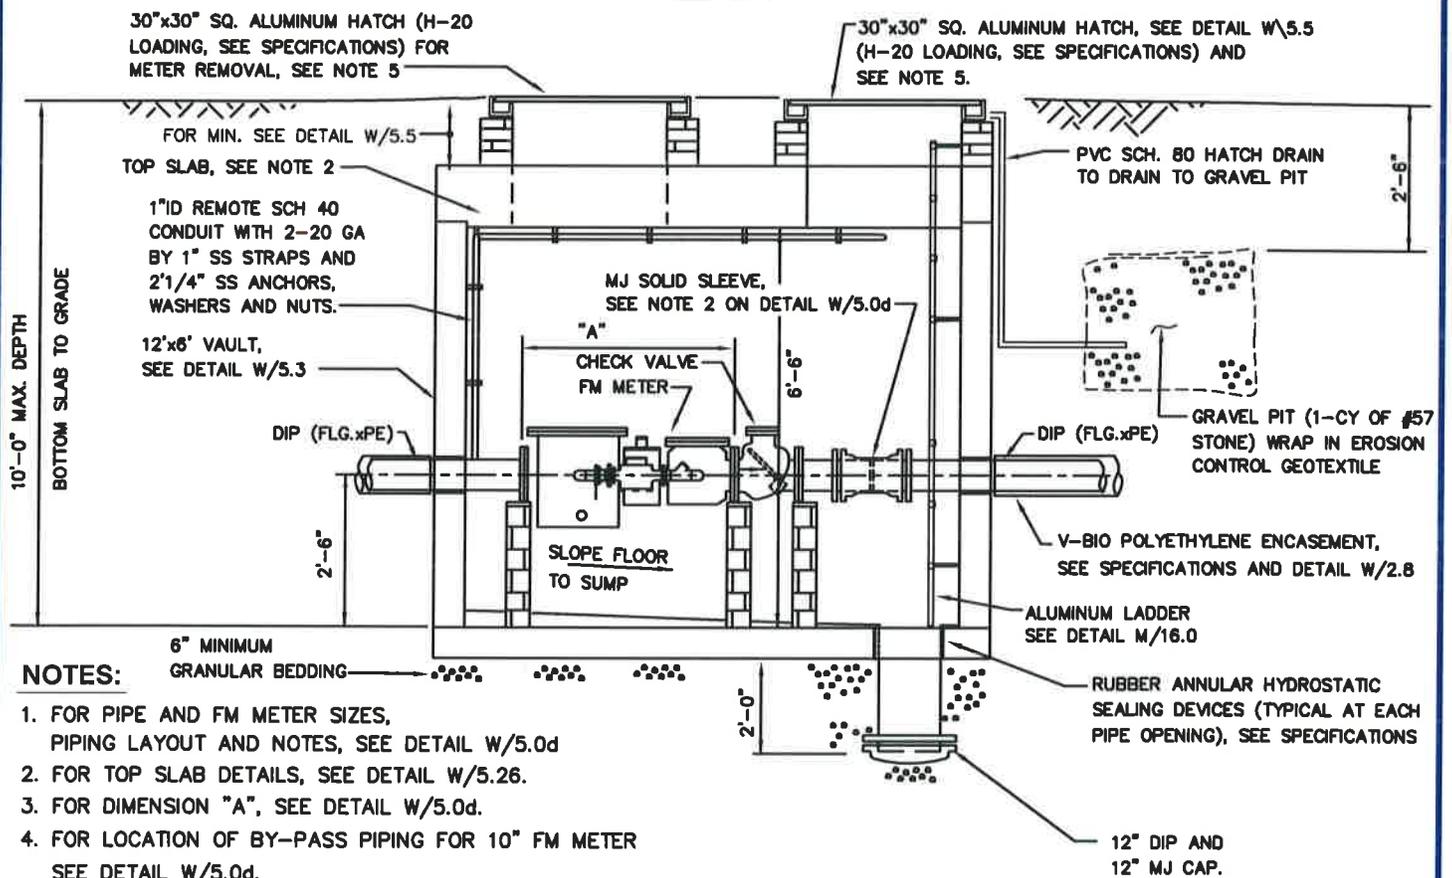

ELEVATION

NOTES:

1. FOR PIPE AND FM METER SIZES, PIPING LAYOUT AND NOTES, SEE DETAIL W/5.0d
2. FOR TOP SLAB DETAILS, SEE DETAIL W/5.26.
3. FOR DIMENSION "A", SEE DETAIL W/5.0d.
4. FOR LOCATION OF BY-PASS PIPING FOR 10" FM METER SEE DETAIL W/5.0d.
5. IF VAULT LOCATION IS LOCATED IN TRAFFIC AREA, USE 30" DIA. FRAME AND COVER, SEE DETAIL W/5.0e.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: 9/28/16

Chief Engineer


STANDARD DETAIL
**10-INCH FM METER
WITH CHECK VALVE VAULT**

W

5.0i

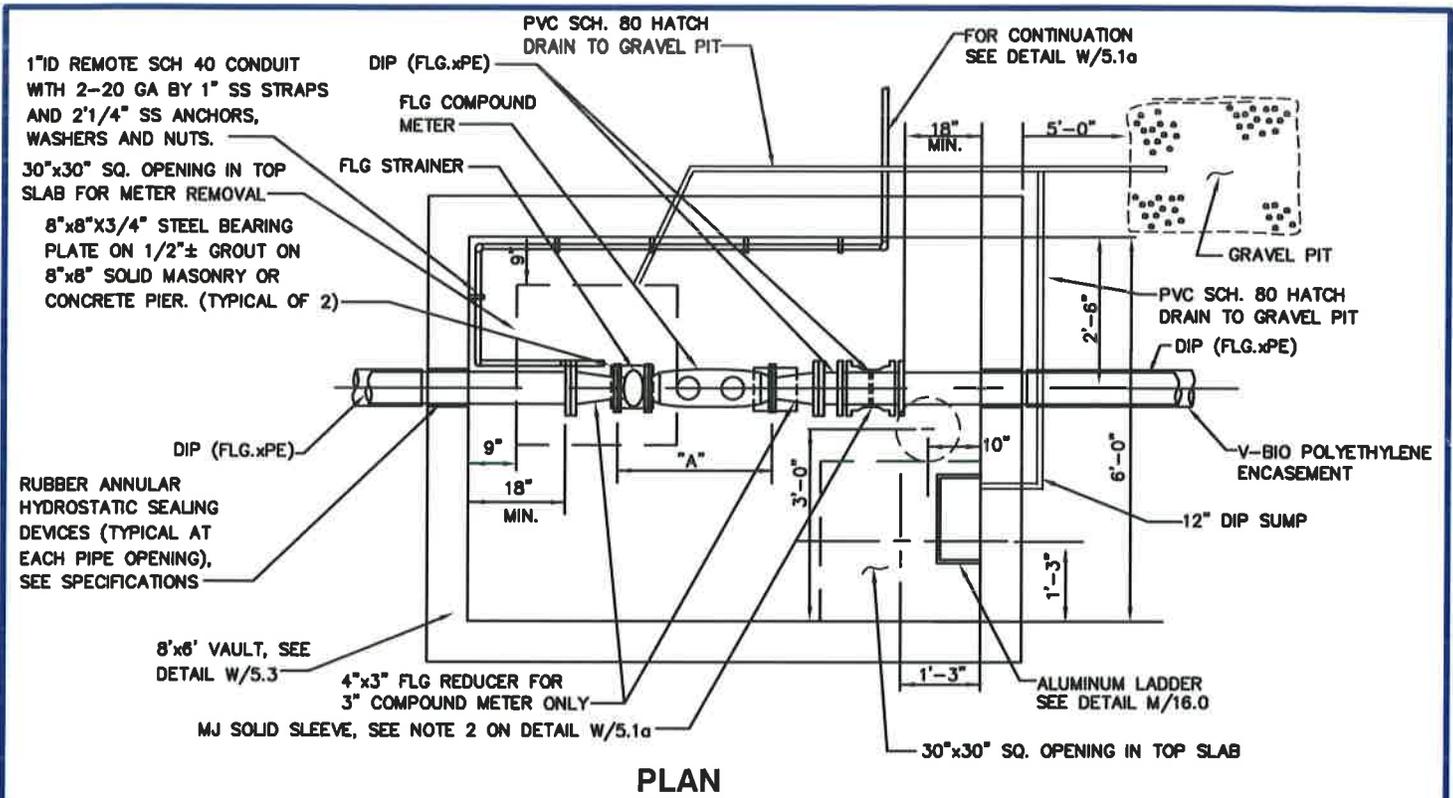

PLAN

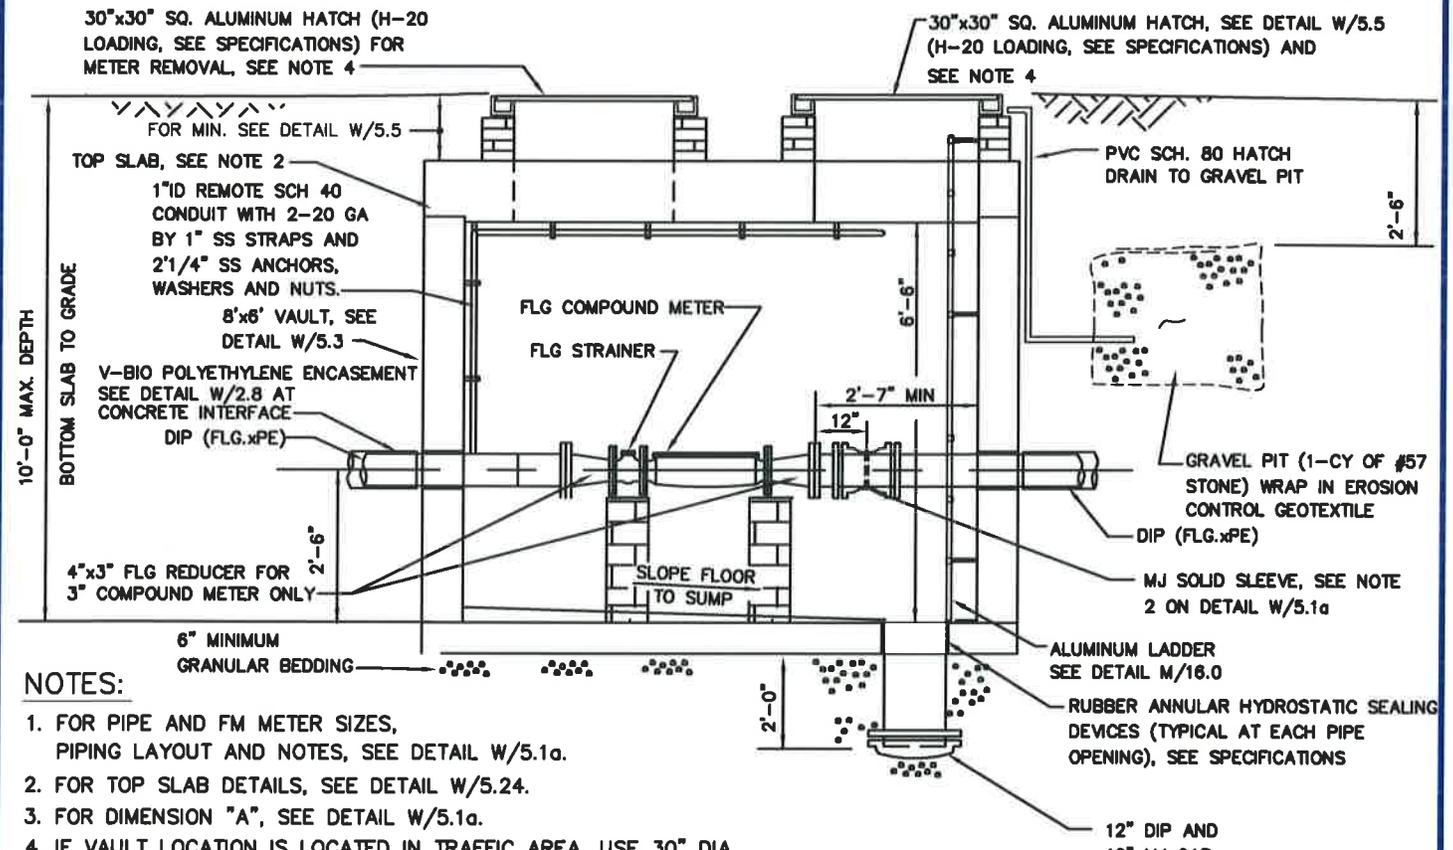

ELEVATION

NOTES:

1. FOR PIPE AND FM METER SIZES, PIPING LAYOUT AND NOTES, SEE DETAIL W/5.1a.
2. FOR TOP SLAB DETAILS, SEE DETAIL W/5.24.
3. FOR DIMENSION "A", SEE DETAIL W/5.1a.
4. IF VAULT LOCATION IS LOCATED IN TRAFFIC AREA, USE 30" DIA. FRAME AND COVER FOR LOCATION SEE DETAIL W/5.1a.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: *9/28/16*

Chief Engineer

STANDARD DETAIL
3-INCH, 4-INCH, AND 6-INCH
COMPOUND METER VAULT

W
5.1

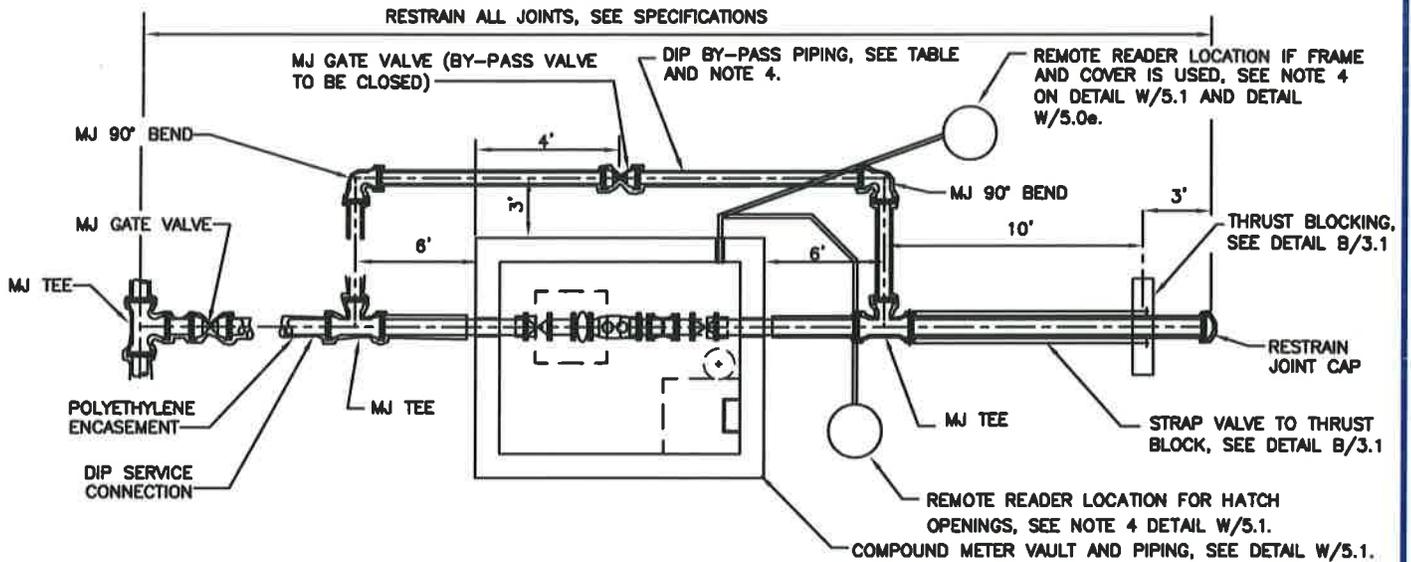

**PLAN - COMPOUND METER VAULT
TYPICAL PIPING LAYOUT**

NOTES:

1. FOR COMPOUND METER VAULT AND PIPING DETAILS, SEE DETAIL W/5.1.
2. PROVIDE M.J. SOLID SLEEVE WHERE SHOWN WITH WEDGE ACTION RESTRAINER GLANDS, SEE SPECIFICATIONS. TOLERANCE BETWEEN PIPE ENDS SHALL NOT EXCEED 1/2". DO NOT USE PIPE SPACERS, SEE SPECIFICATIONS.
3. ONLY DUCTILE IRON PIPE AND FITTINGS, EXCEPT AS NOTED. SEE DRAWINGS FOR SIZES.
4. RESTRAIN ALL JOINTS DIP BY-PASS PIPING, FROM TEE TO TEE WITH WEDGE ACTION RESTRAINER GLANDS, SEE SPECIFICATIONS.
5. PROVIDE EXTENSION STEMS AND VALVE BOXES FOR ALL BURIED VALVES, SEE DETAIL W/2.2.
6. V-BIO POLYETHYLENE ENCASEMENT FOR ALL DUCTILE IRON PIPE AND FITTINGS. SEE DETAIL W/2.8 AT CONCRETE INTERFACE.
7. PROVIDE RUBBER ANNULAR HYDROSTATIC SEALING DEVICES FOR ALL PIPE THROUGH WALL CONNECTIONS, SEE SPECIFICATIONS.

BY-PIPE SIZE	
COMPOUND METER SIZE	BY-PASS PIPE SIZE
3"	2"
4"	2"
6"	4"

"A" DIMENSION (SEE DETAIL W/5.1, W/5.1a AND W/5.1b)	
COMPOUND METER SIZE	"A" (LENGTH OF METER AND STRAINER)
3"	24"
4"	29"
6"	36.5"

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:


9/28/16

Chief Engineer


STANDARD DETAIL

3-INCH, 4-INCH AND 6-INCH
COMPOUND METER VAULT
PIPING LAYOUT

W
5.1a

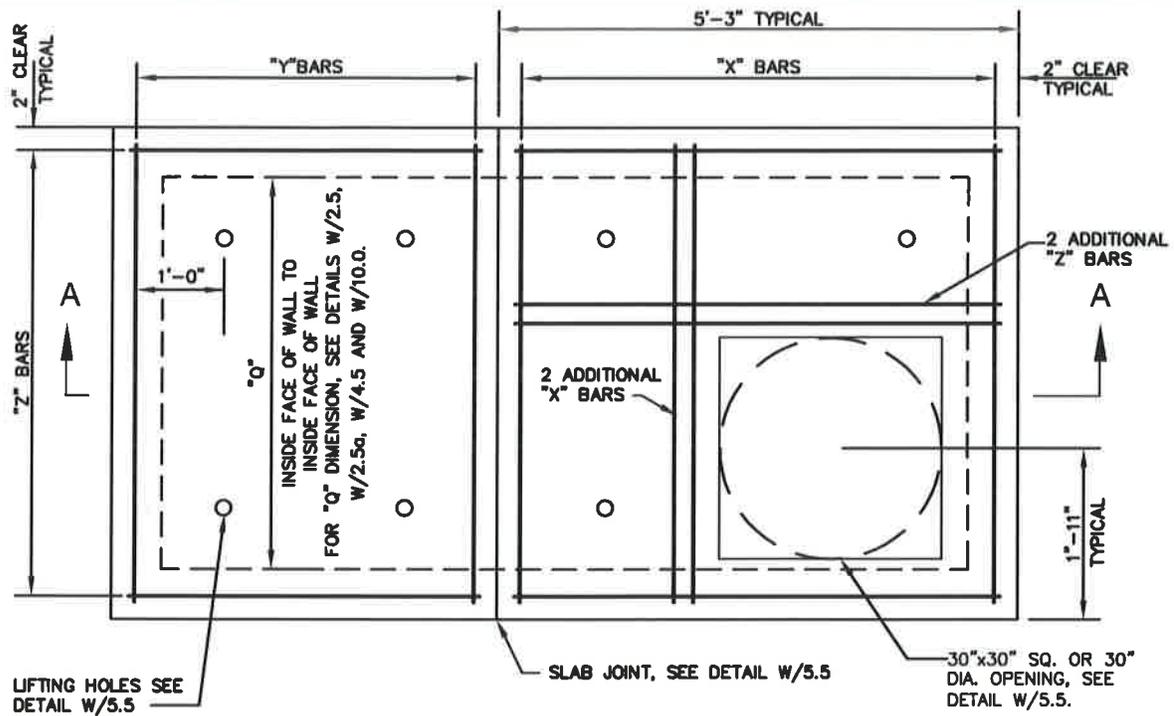

PLAN VIEW: TOP SLAB FOR CAST IN PLACE VAULTS

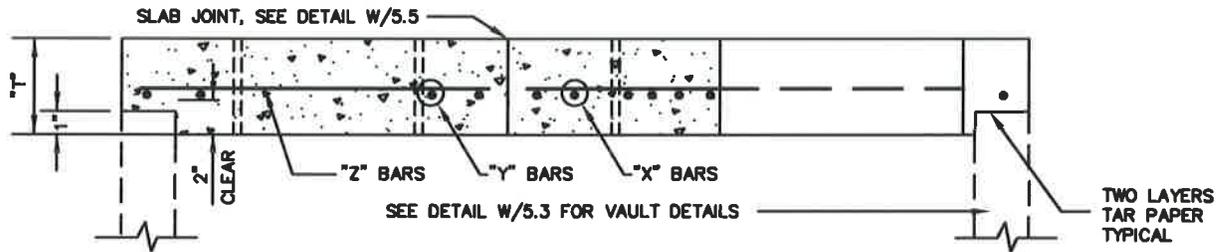

SECTION A-A

NOTE:


1. FOR CAST IN PLACE CONCRETE TOP SLAB THICKNESS AND REINFORCING, SEE DETAIL W/5.21.
2. FOR ADDITIONAL NOTES, SEE DETAIL W/5.21.


WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u>  Chief Engineer	STANDARD DETAIL CAST IN PLACE CONCRETE TOP SLAB REINFORCING DETAILS	<u>W</u> 5.2
--	---	--	-----------------

CAST IN PLACE CONCRETE TOP SLAB THICKNESS AND REINFORCING				
"Q" SEE DETAIL W/5.2	"T" SEE DETAIL W/5.2	"X" BARS SEE DETAIL W/5.2	"Y" BARS SEE DETAIL W/5.2	"Z" BARS SEE DETAIL W/5.2
4'-0"	8"	#7 @ 8" C/C	#5 @ 6" C/C	#5 @ 6" C/C
5'-0"	9"	#7 @ 7" C/C	#5 @ 6" C/C	#6 @ 6" C/C
6'-0"	10"	#7 @ 7" C/C	#5 @ 6" C/C	#6 @ 6" C/C
7'-0"	11"	#7 @ 7" C/C	#5 @ 6" C/C	#6 @ 6" C/C
8'-0"	12"	#7 @ 7" C/C	#5 @ 6" C/C	#6 @ 6" C/C
9'-0"	13"	#7 @ 7" C/C	#5 @ 6" C/C	#6 @ 6" C/C
10'-0"	14"	#7 @ 6" C/C	#6 @ 8" C/C	#6 @ 6" C/C


CAST IN PLACE CONCRETE TOP SLAB NOTES

1. $f'_c = 4000$ PSI. @ 28 DAYS
2. $f_y = 60,000$ PSI.
3. TOP SLABS ARE DESIGNED FOR THE FOLLOWING CONDITIONS:
 - A. H2O LOADING & 1'-0" COVER + IMPACT (WATER TABLE 4'-0" BELOW FINISHED GRADE)
 - B. 5'-0" COVER & 2'-0" SURCHARGE. (WATER TABLE 4'-0" BELOW FINISHED GRADE)
4. CONTRACTOR MAY USE PRECAST TOP SLABS, SEE SPECIFICATIONS FOR SUBMITTAL REQUIREMENTS..
5. PROVIDE 5" ϕ HOLE IN TOP SLAB CENTERED OVER VALVE OPERATING NUTS, SEE DETAIL W/5.5.
6. FOR ADDITIONAL INFORMATION, SEE DETAILS W/2.4, W/4.5 AND W/10.0.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u>  Chief Engineer	STANDARD DETAIL CAST IN PLACE CONCRETE TOP SLAB REINFORCING DETAILS	$\frac{W}{5.21}$
--	---	--	------------------

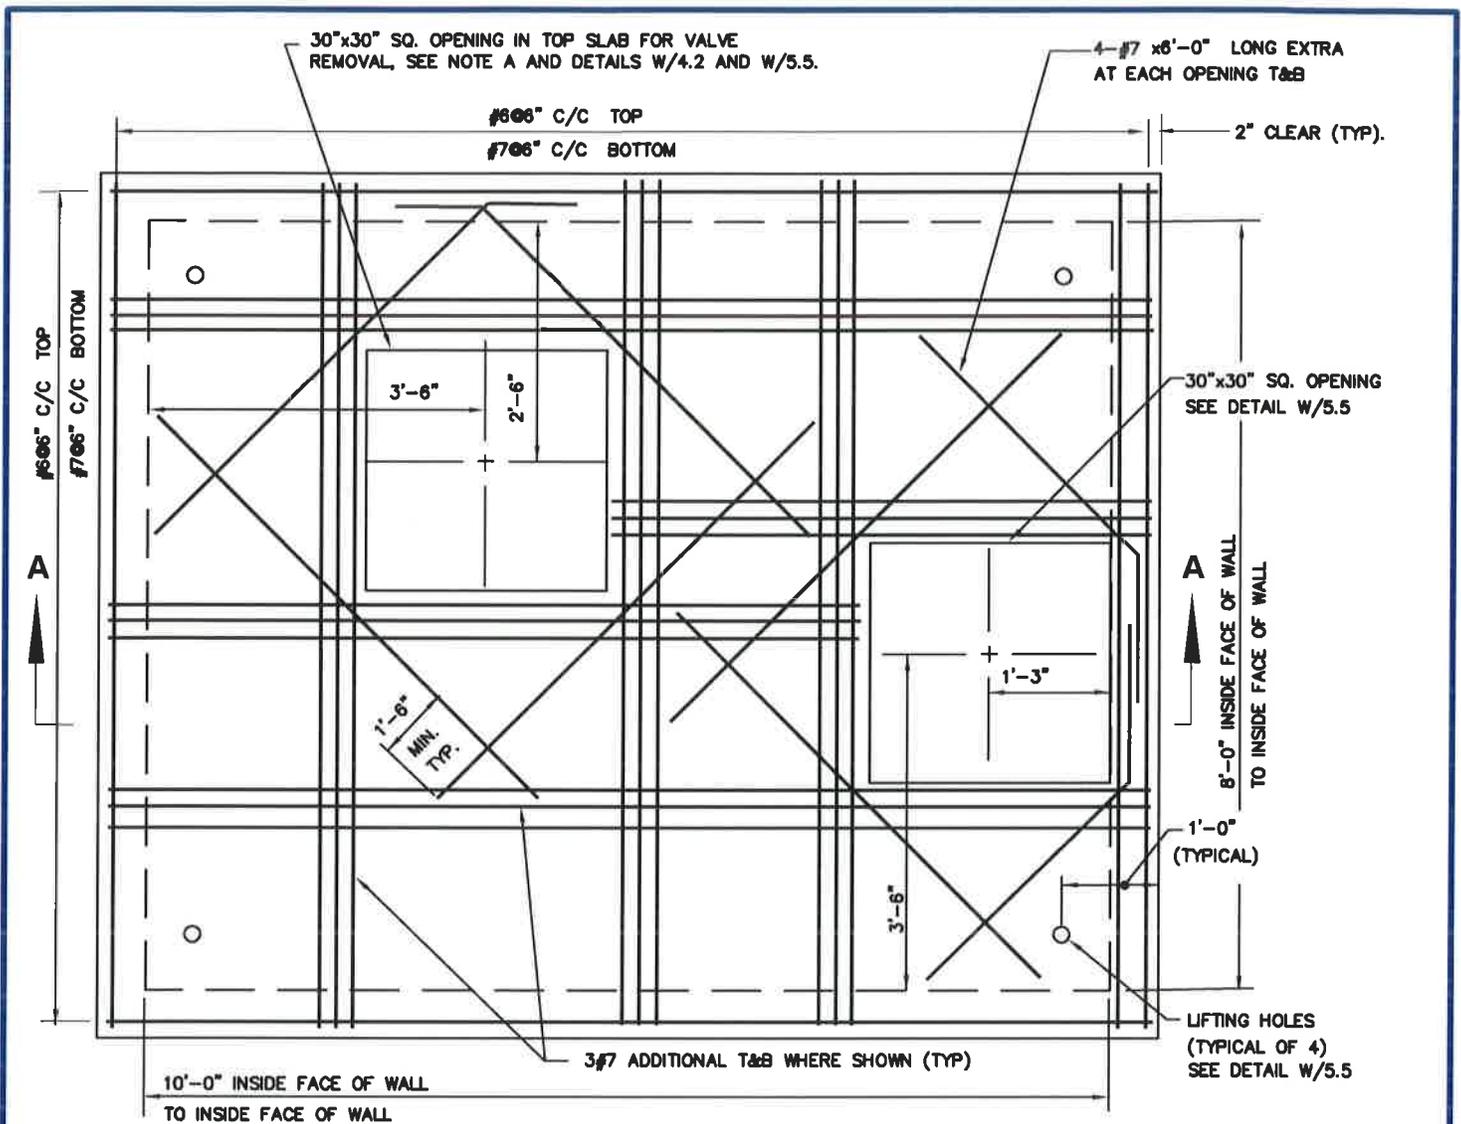

PLAN

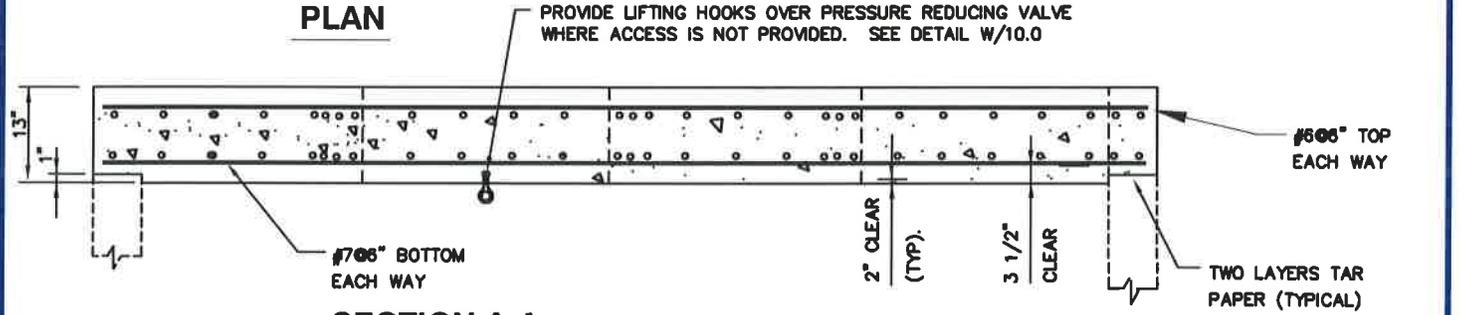

SECTION A-A

CAST IN PLACE CONCRETE TOP SLAB NOTES


1. $f'_c = 4000$ PSI. @ 28 DAYS
2. $f_y = 60,000$ PSI.
3. TOP SLABS ARE DESIGNED FOR THE FOLLOWING CONDITIONS:
 - a). H2OLL + 0% IMPACT+ 3.5' MAXIMUM EARTH COVER
 - b). H2OLL + 30% IMPACT+ 1' EARTH COVER
4. CONTRACTOR MAY USE PRECAST TOP SLABS, SEE SPECIFICATIONS FOR SUBMITTAL REQUIREMENTS.
5. FOR ADDITIONAL INFORMATION, SEE DETAIL W/4.2.

VALVE REMOVAL OPENING NOTES:

- A. FOR 4" VALVE NO OPENINGS ARE REQUIRED. PROVIDE 1 PIECE TOP SLAB REINFORCED AS PER DETAIL W/5.2


WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: 9/28/16 <hr style="width: 100%;"/> Chief Engineer	STANDARD DETAIL CAST IN PLACE CONCRETE TOP SLAB FOR TYPE "1" LAYOUT PRESSURE REDUCING VALVE VAULTS	W <hr style="width: 50%;"/> 5.22
--	---	--	-------------------------------------

30"x30" SQ. OPENING IN TOP SLAB FOR VALVE REMOVAL, SEE NOTE A AND DETAILS W/4.3 AND W/5.5.

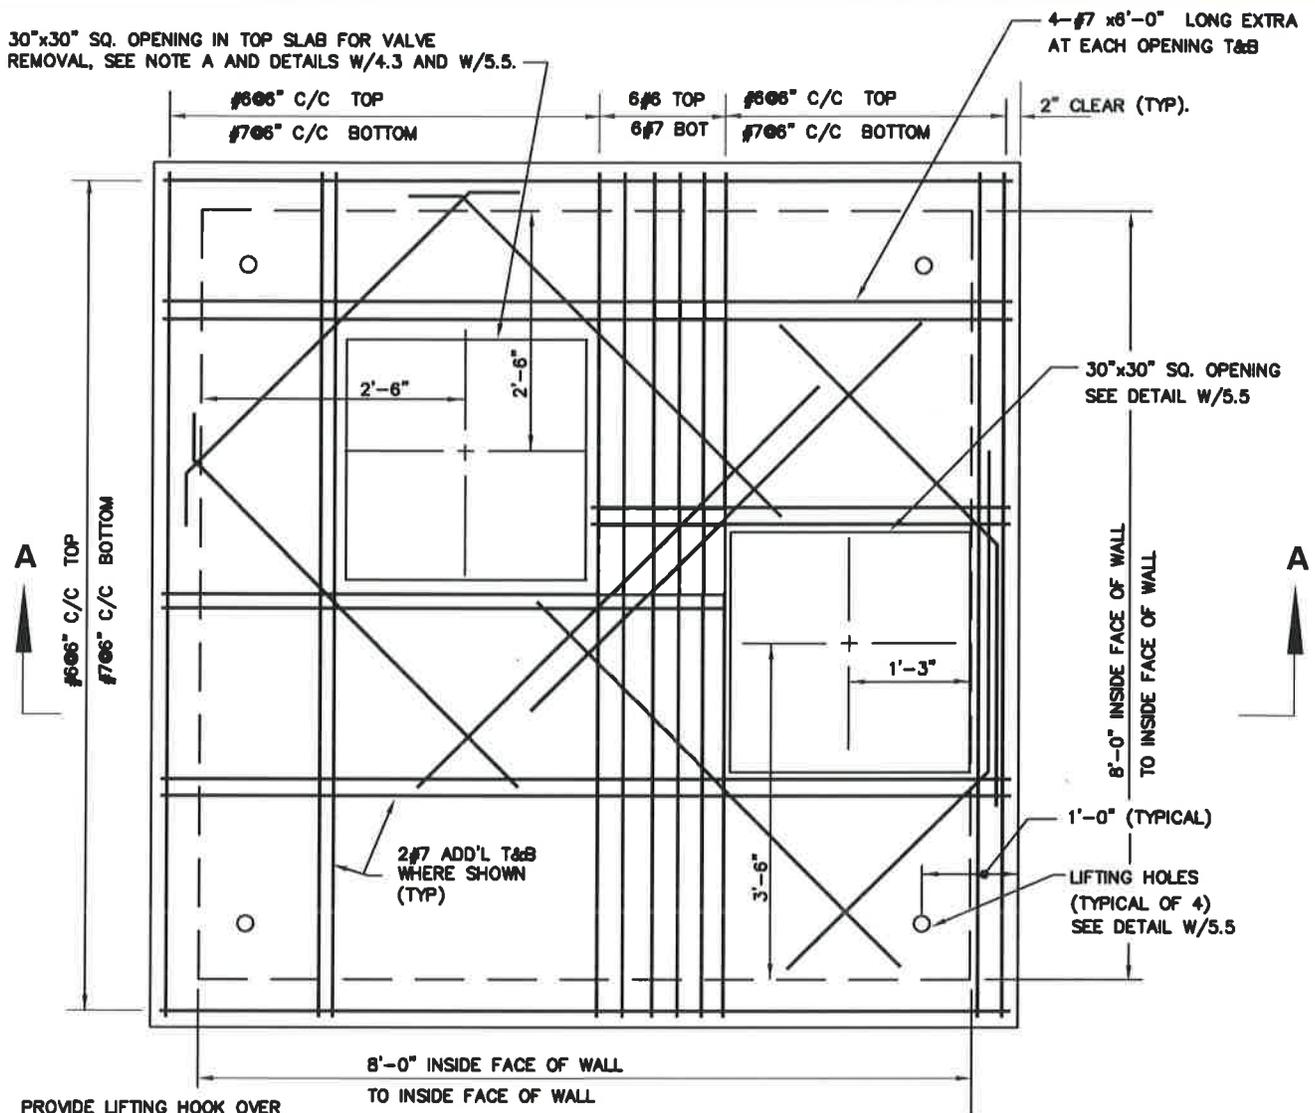

PLAN

PROVIDE LIFTING HOOK OVER PRESSURE REDUCING VALVE WHERE ACCESS OPENING IS NOT PROVIDED. SEE DETAIL W/10.0

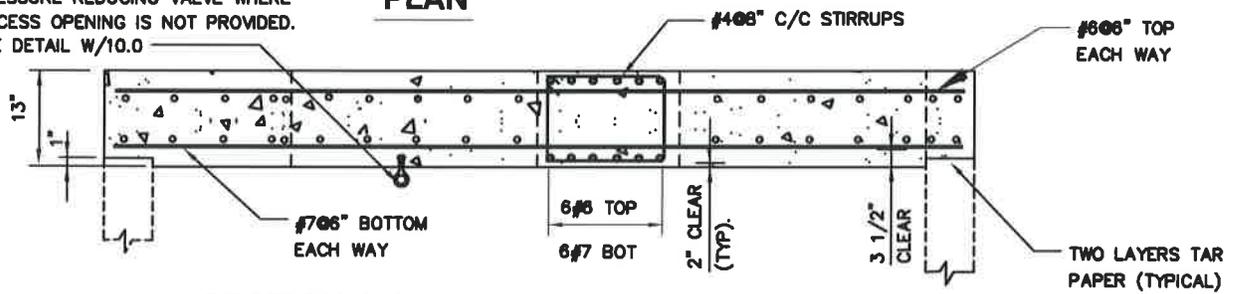

SECTION A-A

CAST IN PLACE CONCRETE TOP SLAB NOTES

1. $f'_c = 4000$ PSI. \odot 28 DAYS
2. $f_y = 60,000$ PSI.
3. TOP SLABS ARE DESIGNED FOR THE FOLLOWING CONDITIONS:
 - a). H2OLL + 0% IMPACT+ 3.5' MAXIMUM EARTH COVER
 - b). H2OLL + 30% IMPACT+ 1' EARTH COVER
4. CONTRACTOR MAY USE PRECAST TOP SLABS, SEE SPECIFICATIONS FOR SUBMITTAL REQUIREMENTS.
5. FOR ADDITIONAL INFORMATION, SEE DETAILS W/4.3 AND W/4.7.

VALVE REMOVAL OPENING NOTES:

- A. FOR 4" VALVE NO OPENINGS ARE REQUIRED. PROVIDE 1 PIECE TOP SLAB REINFORCED AS PER DETAIL W/5.2

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: 9/23/16

Chief Engineer


STANDARD DETAIL
CAST IN PLACE CONCRETE TOP
SLAB FOR DUEL PRESSURE RELIEF
AND TYPE "2" LAYOUT PRESSURE
REDUCING VALVE VAULTS

W
5.23

30"x30" SQ. OR 30' DIA. OPENING IN TOP SLAB FOR VALVE REMOVAL, SEE DETAILS W/5.0 AND W/5.5.

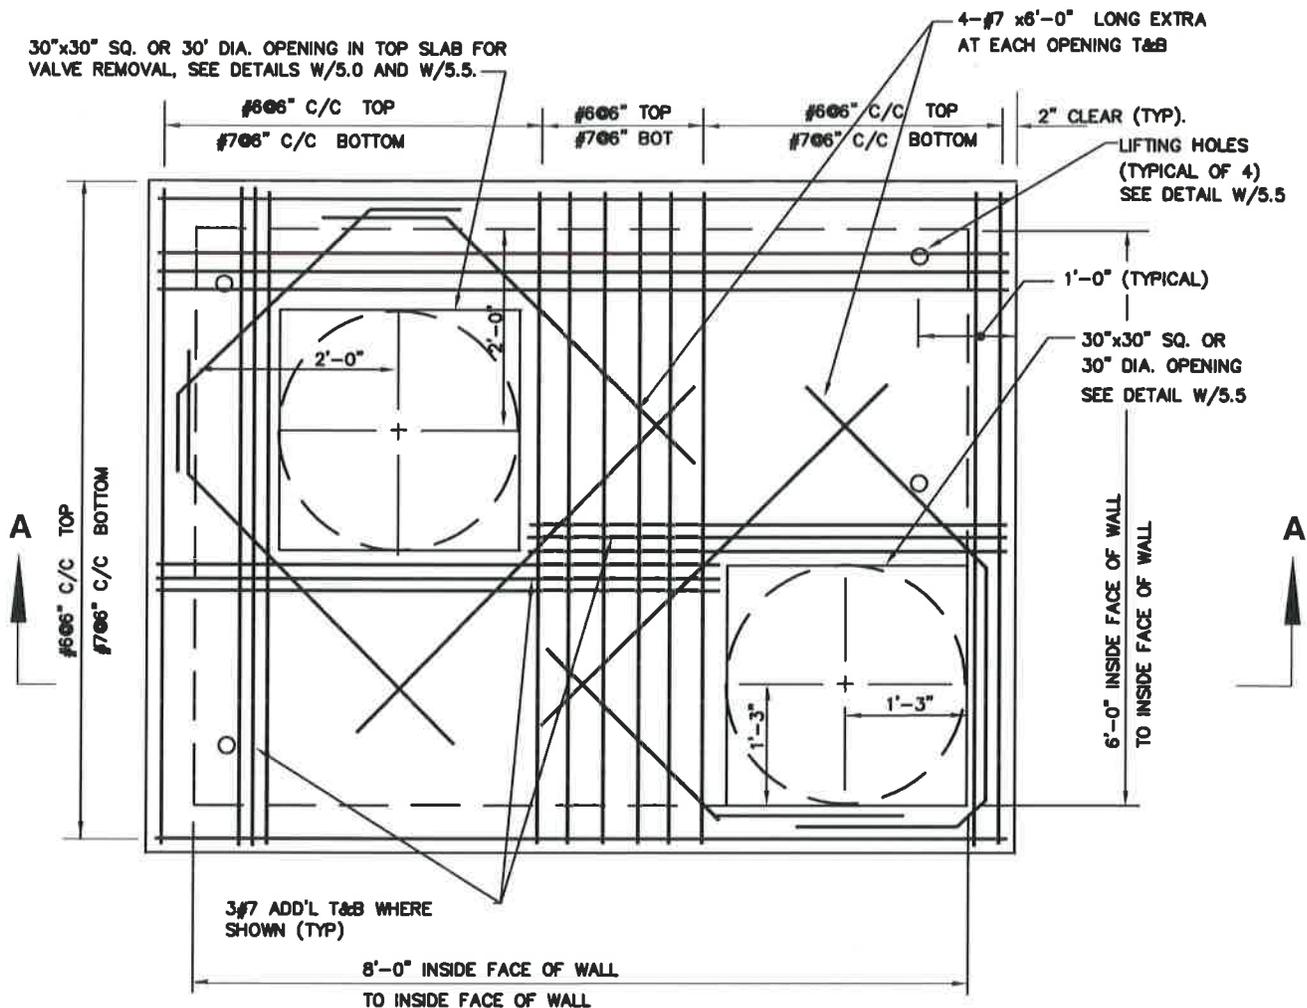

PLAN

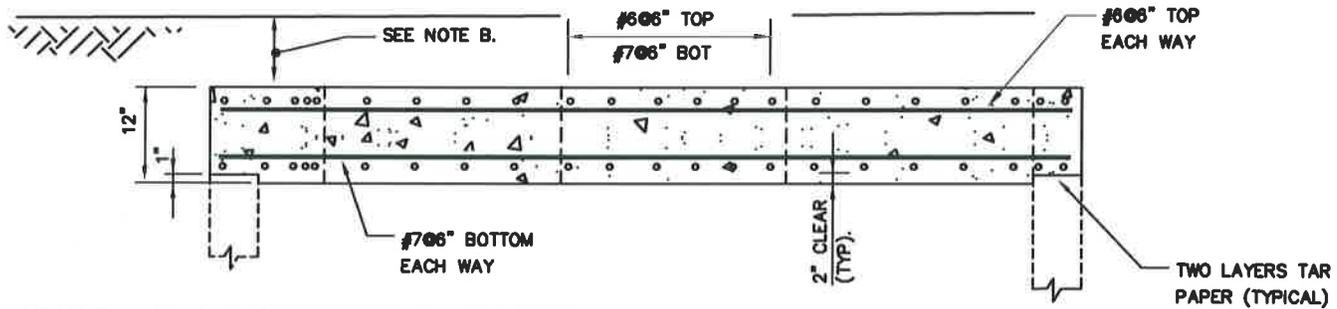

SECTION A-A

CAST IN PLACE CONCRETE TOP SLAB NOTES:

1. $f'_c = 4000$ PSI. @ 28 DAYS
2. $f_y = 60,000$ PSI.
3. TOP SLABS ARE DESIGNED FOR THE FOLLOWING CONDITIONS:
 - a). H2OLL + 0% IMPACT+ 3.5' MAXIMUM EARTH COVER
 - b). H2OLL + 30% IMPACT+ 1' EARTH COVER
4. CONTRACTOR MAY USE PRECAST TOP SLABS, SEE SPECIFICATIONS FOR SUBMITTAL REQUIREMENTS.

NOTE:

- A. FOR DETAILS OF FM METERS SEE DETAILS W/5.0, W/5.0b, DETECTOR CHECK VALVE SEE W/12.0 AND ULTRASONIC METER SEE W/14.0.
- B. 2'-6" MAXIMUM COVER OVER TOP SLAB, FOR MINIMUM COVER, SEE DETAIL W/5.5

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: 9/28/16

Chief Engineer


STANDARD DETAIL
CAST IN PLACE CONCRETE
TOP SLAB FOR FM METER
COMPOUND, ULTRASONIC METER
AND DETECTOR CHECK VAULTS

W
5.24

30"x30" SQ. OR 30" DIA. OPENING IN TOP SLAB FOR METER/VALVE REMOVAL, SEE DETAIL W/5.5.

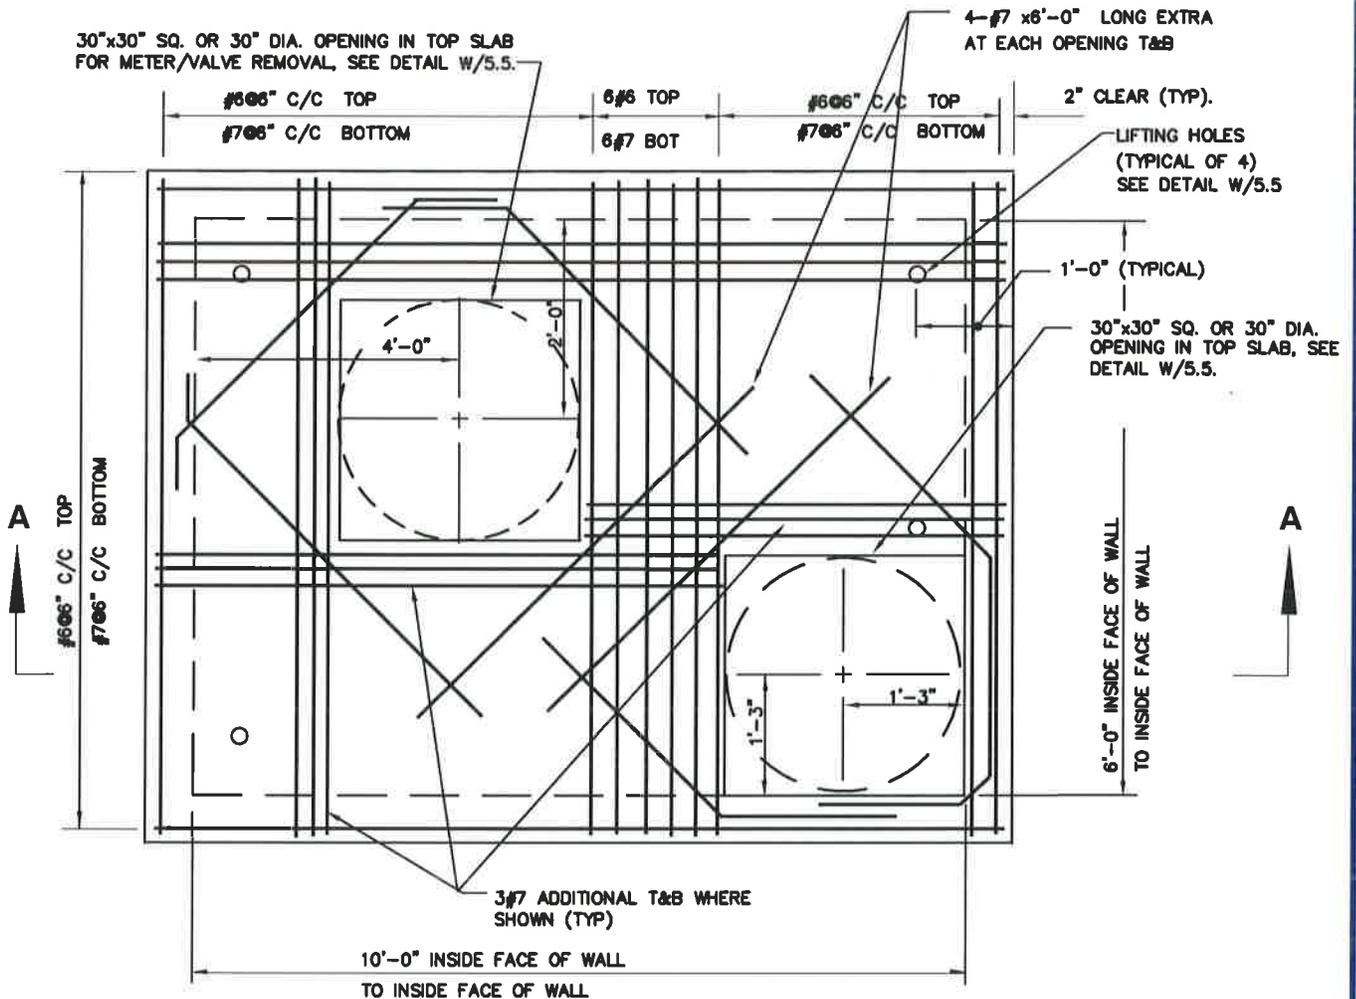

PLAN

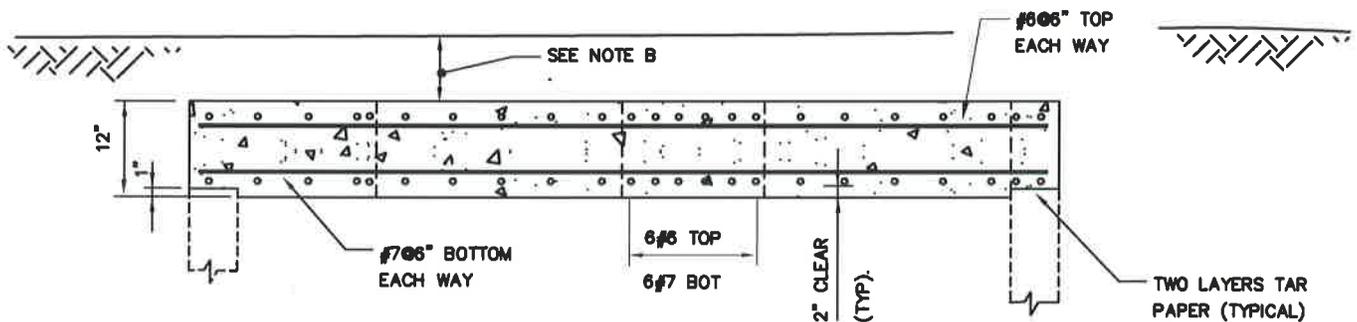

CAST IN PLACE CONCRETE TOP SLAB NOTES:

1. $f'_c = 4000$ PSI. @ 28 DAYS
2. $f_y = 60,000$ PSI.
3. TOP SLABS ARE DESIGNED FOR THE FOLLOWING CONDITIONS:
 - a). H2OLL + 0% IMPACT+ 3.5' MAXIMUM EARTH COVER
 - b). H2OLL + 30% IMPACT+ 1' EARTH COVER
4. CONTRACTOR MAY USE PRECAST TOP SLABS, SEE SPECIFICATIONS FOR SUBMITTAL REQUIREMENTS.

SECTION A-A

NOTE:

- A. FOR DETAILS OF COMPOUND METERS SEE DETAIL W/5.1. FOR 10" FM METERS SEE DETAIL W/5.0g AND 6" & 8" FM METER WITH CHECK VALVE, SEE W/5.0c. AND 10" ULTRASONIC METER, SEE W/14.0a.
- B. 2'-6" MAXIMUM COVER OVER TOP SLAB, FOR MINIMUM COVER, SEE DETAIL W/5.5.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16


Chief Engineer

STANDARD DETAIL
CAST IN PLACE
CONCRETE TOP SLAB FOR
ULTRASONIC METER AND
FM METER W/ CHECK VALVE VAULT


W
5.25

30"x30" SQ. OR 30" DIA. OPENING IN TOP SLAB FOR METER/VALVE REMOVAL, SEE DETAIL W/5.5.

4-#7 x8'-0" LONG EXTRA AT EACH OPENING T&B

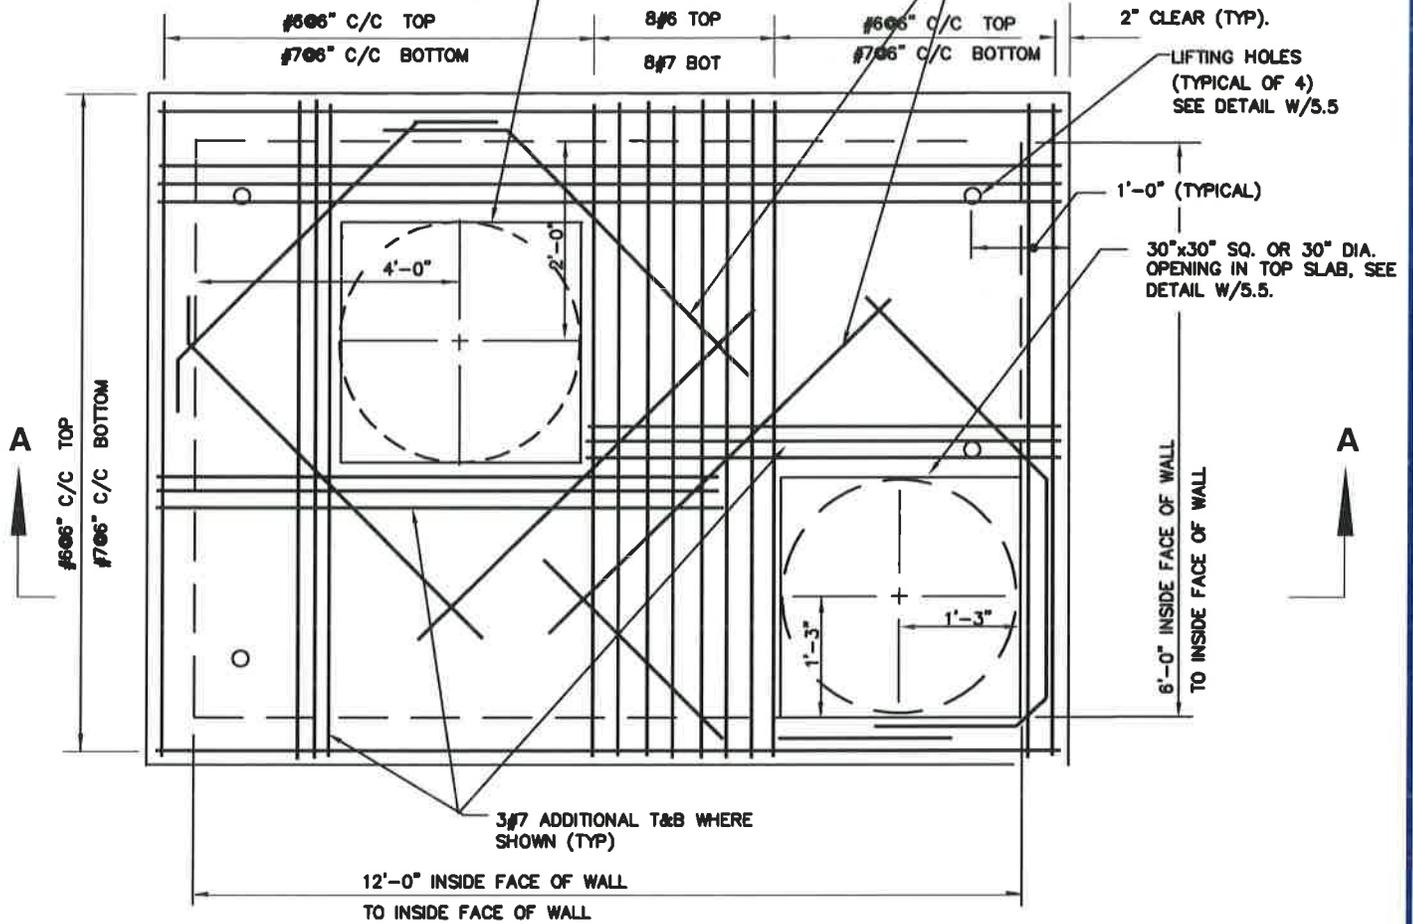

PLAN

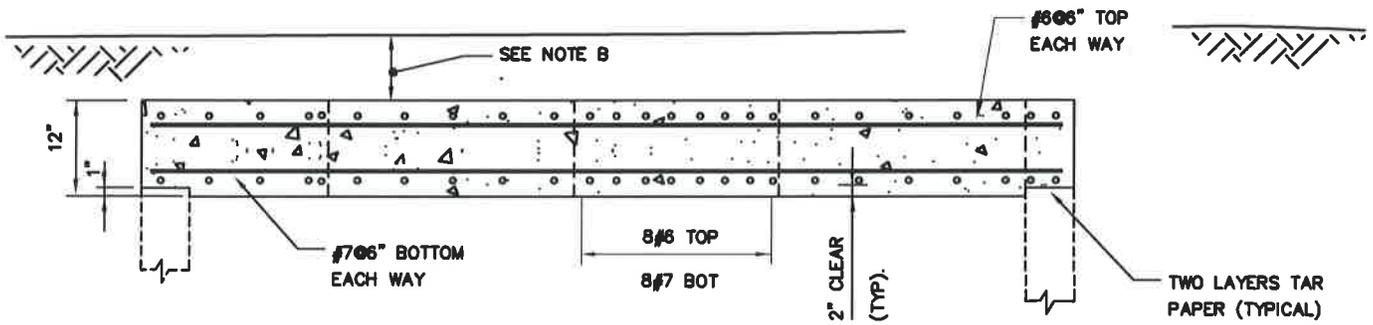

SECTION A-A

CAST IN PLACE CONCRETE TOP SLAB NOTES:

1. $f'_c = 4000$ PSI. @ 28 DAYS
2. $f_y = 60,000$ PSI.
3. TOP SLABS ARE DESIGNED FOR THE FOLLOWING CONDITIONS:
 - a). H2OLL + 0% IMPACT+ 3.5' MAXIMUM EARTH COVER
 - b). H2OLL + 30% IMPACT+ 1' EARTH COVER
4. CONTRACTOR MAY USE PRECAST TOP SLABS, SEE SPECIFICATIONS FOR SUBMITTAL REQUIREMENTS.

NOTE:

- A. FOR DETAIL OF 10-INCH FM METER WITH CHECK VALVE SEE DETAIL W/5.01.
- B. 2'-6" MAXIMUM COVER OVER TOP SLAB, FOR MINIMUM COVER, SEE DETAIL W/5.5

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
CAST IN PLACE
CONCRETE TOP SLAB FOR
10-INCH FM METER
WITH CHECK VALVE VAULT


W
5.26

PIPING, SEE DETAIL W/5.4
NOTE 6 AND 7

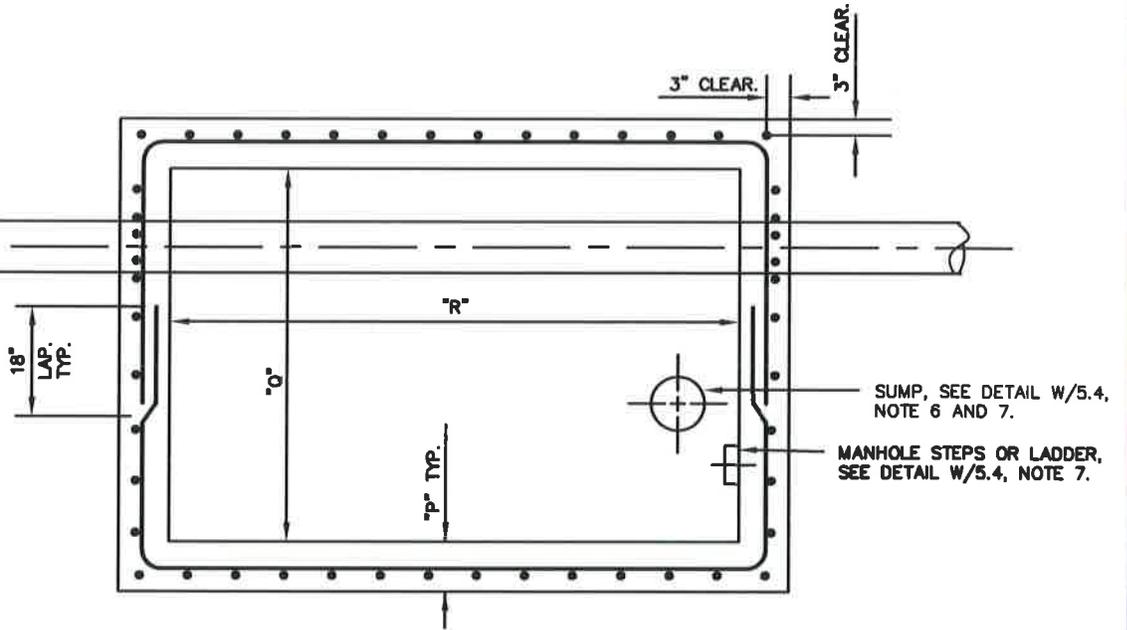

PLAN OF VAULT-TOP SLAB REMOVED

FOR TOP SLAB REINFORCING, SEE DETAILS W/5.2
W/5.22, W/5.23, W/5.24, W/5.25 AND W/5.28

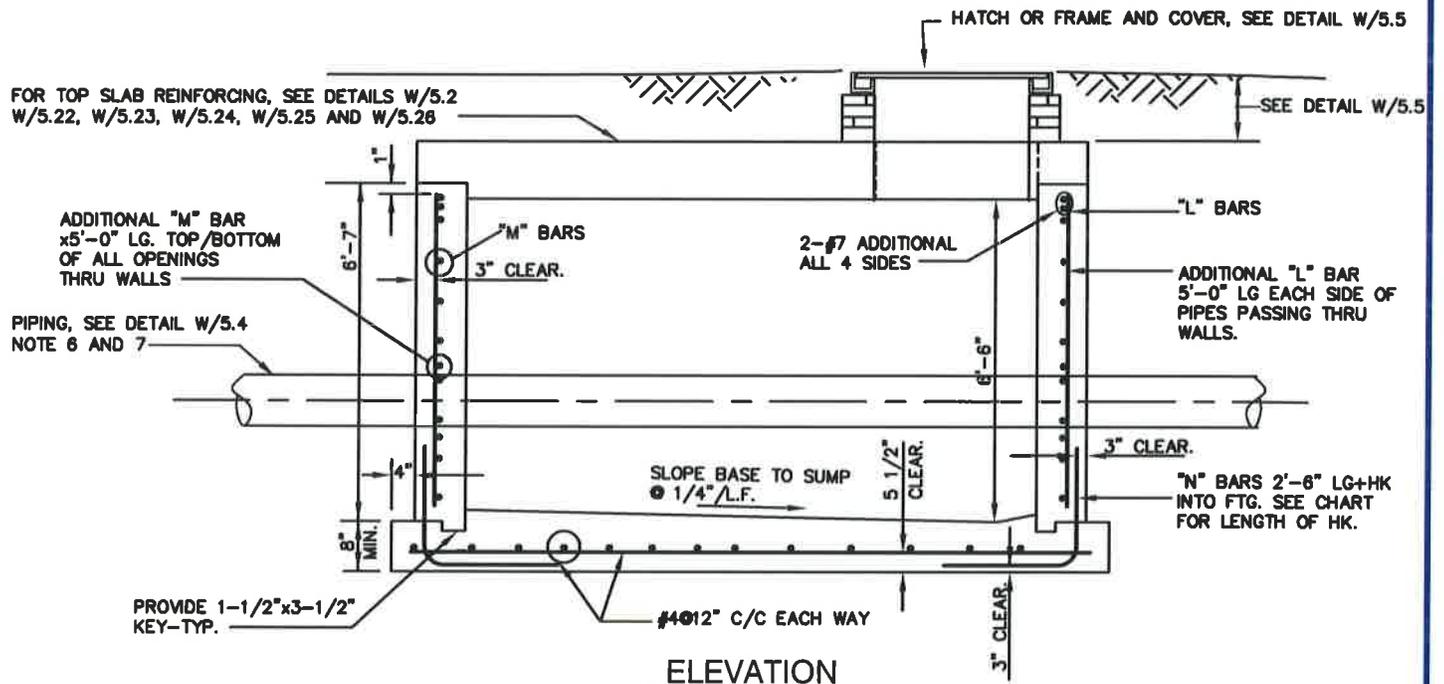

ELEVATION

NOTE:

1. FOR ADDITIONAL NOTES AND REINFORCING, SEE DETAIL W/5.4.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
CAST IN PLACE
CONCRETE VAULT

W
5.3


"P"	"Q"	"R"	"L"	"M"	"N"
8"	6'-0"	6'-0"	#4@12"	#4@12"	#5@12"+2'-0" HK
8"	6'-0"	8'-0"	#4@12"	#4@12"	#5@12"+3'-0" HK
8"	6'-0"	10'-0"	#4@10"	#4@12"	#5@12"+3'-0" HK
8"	6'-0"	12'-0"	#4@10"	#4@12"	#5@12"+3'-0" HK
8"	8'-0"	8'-0"	#4@10"	#4@12"	#5@10"+3'-0" HK
8"	8'-0"	10'-0"	#4@8"	#4@12"	#5@8"+3'-0" HK
8"	8'-0"	12'-0"	#4@6"	#4@12"	#5@6"+4'-0" HK

NOTES:

1. FOR VAULT DETAILS SEE DETAIL W/5.3.
2. $f'_c = 4,000\text{PSI} @ 28 \text{ DAYS.}$
3. $f'_y = 60,000\text{PSI.}$
4. VAULTS ARE DESIGNED FOR THE FOLLOWING CONDITIONS:
 - a. H₂O LOADING AND 1'-0" COVER PLUS IMPACT (WATER TABLE 4'-0" BELOW FINISHED GRADE)
 - b. 5'-0" COVER PLUS 2'-0" SURCHARGE (WATER TABLE 4'-0" BELOW FINISHED GRADE)
5. CONTRACTOR MAY USE PRECAST VAULTS SEE THE FOLLOWING:
 - a. SEE SPECIFICATIONS FOR SUBMITTAL REQUIREMENTS.
 - b. PRECAST VAULTS SHALL BE ONE PIECE UNIT FOR WALLS AND BOTTOM SLAB.
6. PROVIDE RUBBER ANNUAL HYDROSTATIC SEALING FOR ALL PIPES THROUGH WALLS AND BOTTOM SLABS CONNECTIONS, SEE SPECIFICATIONS.
7. FOR PIPING LAYOUTS AND OTHER REQUIREMENTS SEE DETAILS W/4.2, W/4.3, W/4.5, W/5.0, W/5.0b, W/5.0c, W/5.1, W/5.1a, W/10.0, W/12.0, W/14.0 AND W/14.0a.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: _____

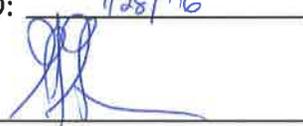
9/28/16


Chief Engineer


STANDARD DETAIL

CAST IN PLACE
CONCRETE VAULTS NOTES

W
5.4

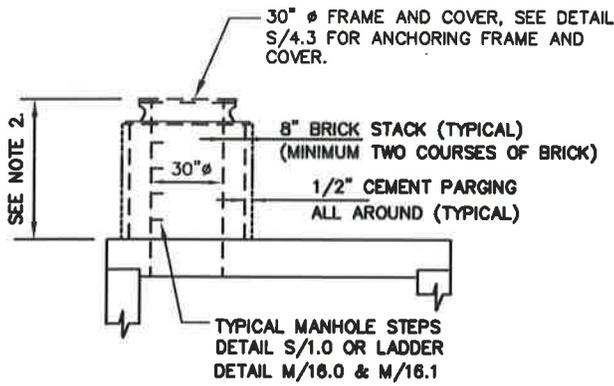

MANHOLE FRAME AND COVER STACK DETAIL

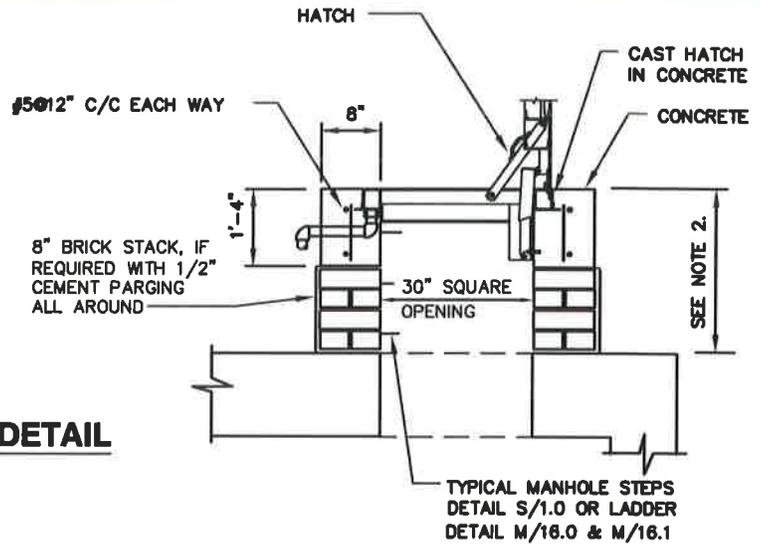


HATCH STACK DETAIL


NON-TRAFFIC LOCATION ONLY

NOTE:

1. DO NOT USE HATCHES WHERE VAULTS ARE LOCATED IN A STREET OR OTHER LOCATIONS SUBJECTED TO TRAFFIC
2. FOR MAXIMUM COVER OVER TOP SLAB SEE DETAILS W/2.4, W/2.4a, W/2.6, W/5.21, W/5.22, W/5.23, W/5.24, W/5.25 AND W/10.7.
3. FOR MINIMUM COVER OVER TOP SLAB. HATCHES 1'-4" MINIMUM AND FRAME AND COVERS 1'-3" MINIMUM.

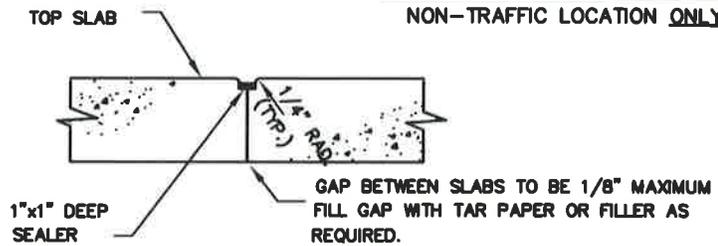


SLAB JOINT DETAIL

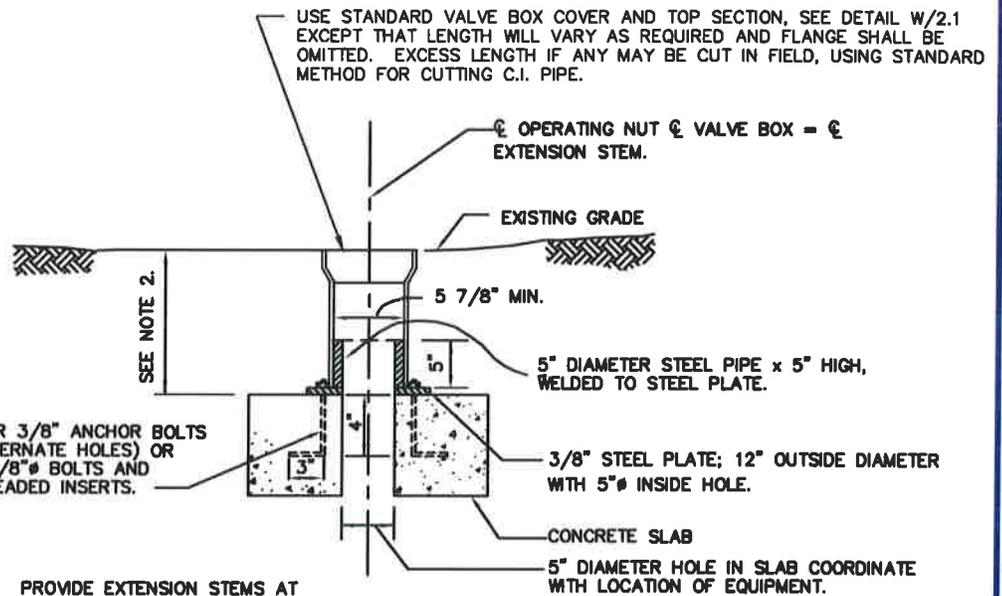

VALVE BOX SLAB OPENING

PROVIDE RUBBER PLUGS AT ALL HOLES.



LIFTING HOLE DETAIL

2" ϕ HOLE IN SLAB. SEE STANDARD DETAILS FOR LOCATION.

PROVIDE EXTENSION STEMS AT ALL VALVE BOXES.

FOUR 3/8" ANCHOR BOLTS (ALTERNATE HOLES) OR 4-3/8" ϕ BOLTS AND THREADED INSERTS.

OPERATING NUT & VALVE BOX - EXTENSION STEM.

EXISTING GRADE

5 7/8" MIN.

5" DIAMETER STEEL PIPE x 5" HIGH, WELDED TO STEEL PLATE.

3/8" STEEL PLATE; 12" OUTSIDE DIAMETER WITH 5" ϕ INSIDE HOLE.

CONCRETE SLAB

5" DIAMETER HOLE IN SLAB COORDINATE WITH LOCATION OF EQUIPMENT.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:


9/28/16

Chief Engineer

STANDARD DETAIL

TOP SLAB DETAILS
FOR VAULTS

W
5.5

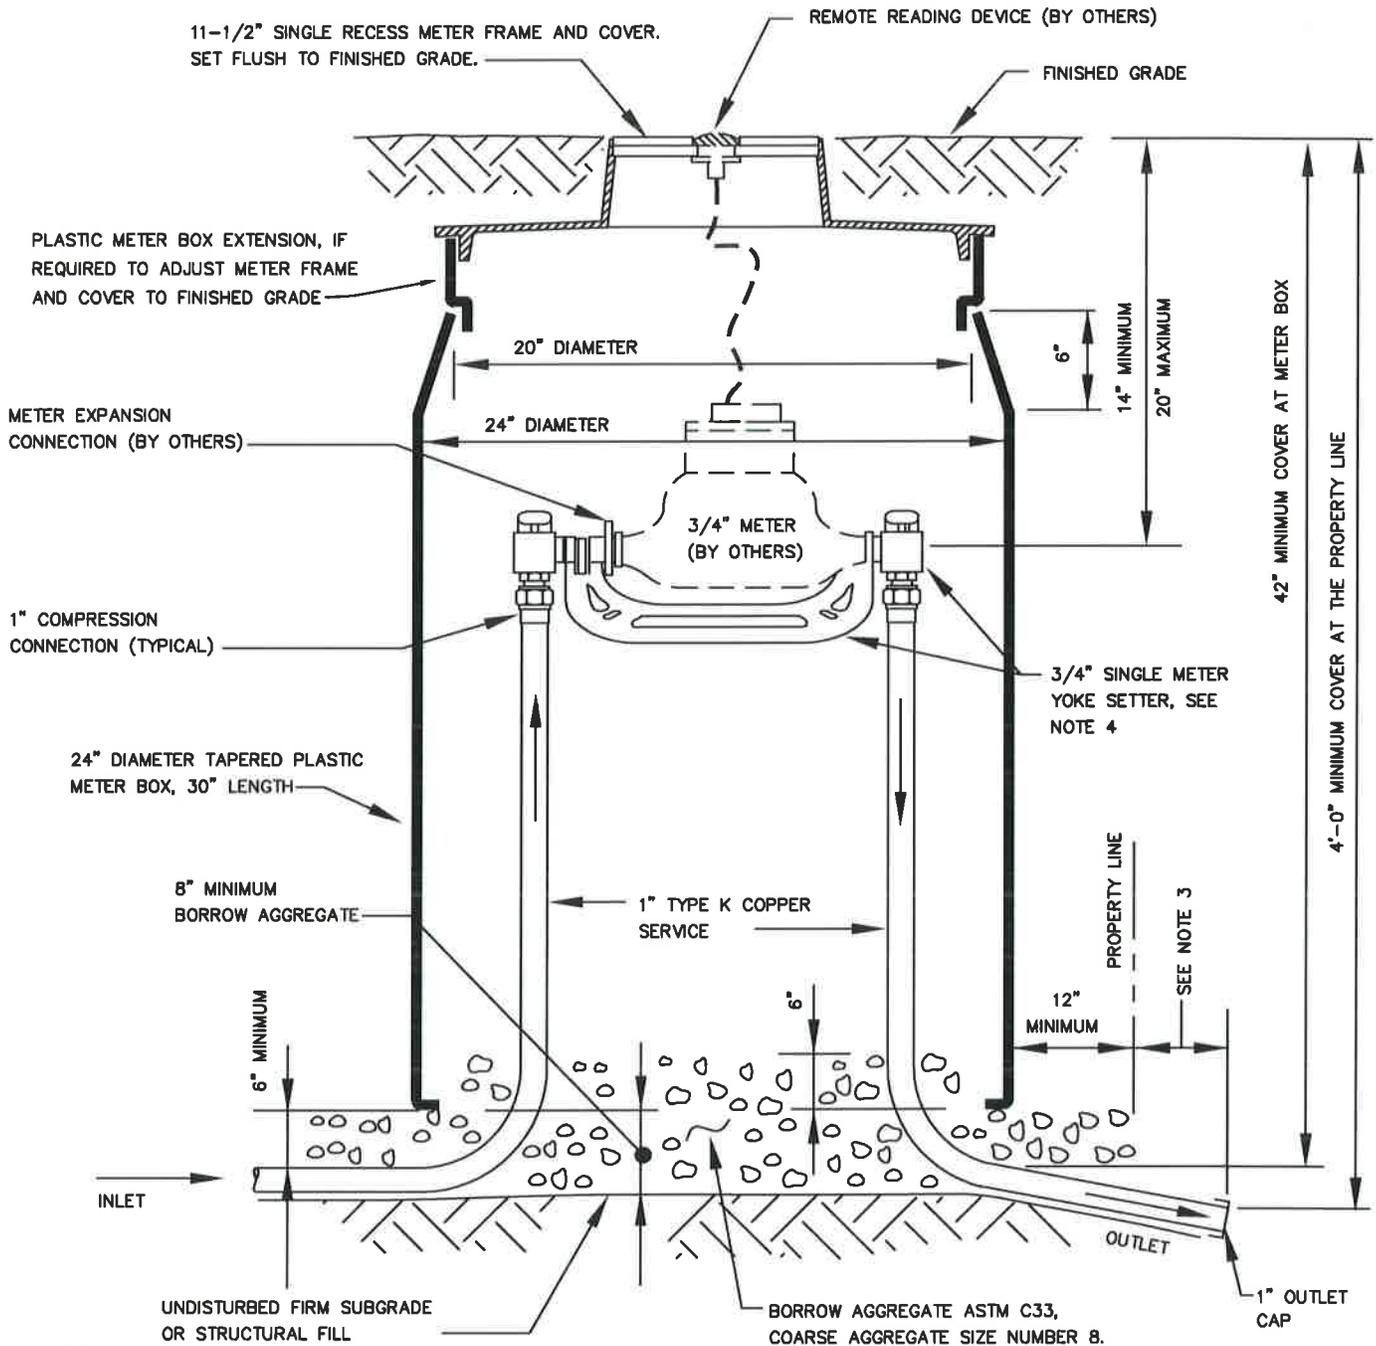

NOTES:

1. METER SETTING FOR NON-TRAFFIC AREAS ONLY, DO NOT LOCATE IN SIDEWALK OR DRIVEWAY, UNLESS OTHERWISE NOTED ON THE DRAWINGS.
2. COMPACT BACKFILL AND AGGREGATE BASE AS STRUCTURAL FILL.
3. EXTEND COPPER SERVICE OUTLET 3'-0" MINIMUM BEYOND METER BOX AS SHOWN OR PROPERTY LINE, WHICHEVER IS GREATER.
4. 3/4" SINGLE METER YOKE SETTER IS COMPLETE ONE-PIECE FACTORY ASSEMBLED, INCLUDING TWO ANGLE BALL VALVES AND YOKE.
5. FOR REPLACEMENT OF EXISTING WATER HOUSE CONNECTION ONLY.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
**3/4-INCH METER SETTING
FOR
1-INCH SERVICE**


W
5.6

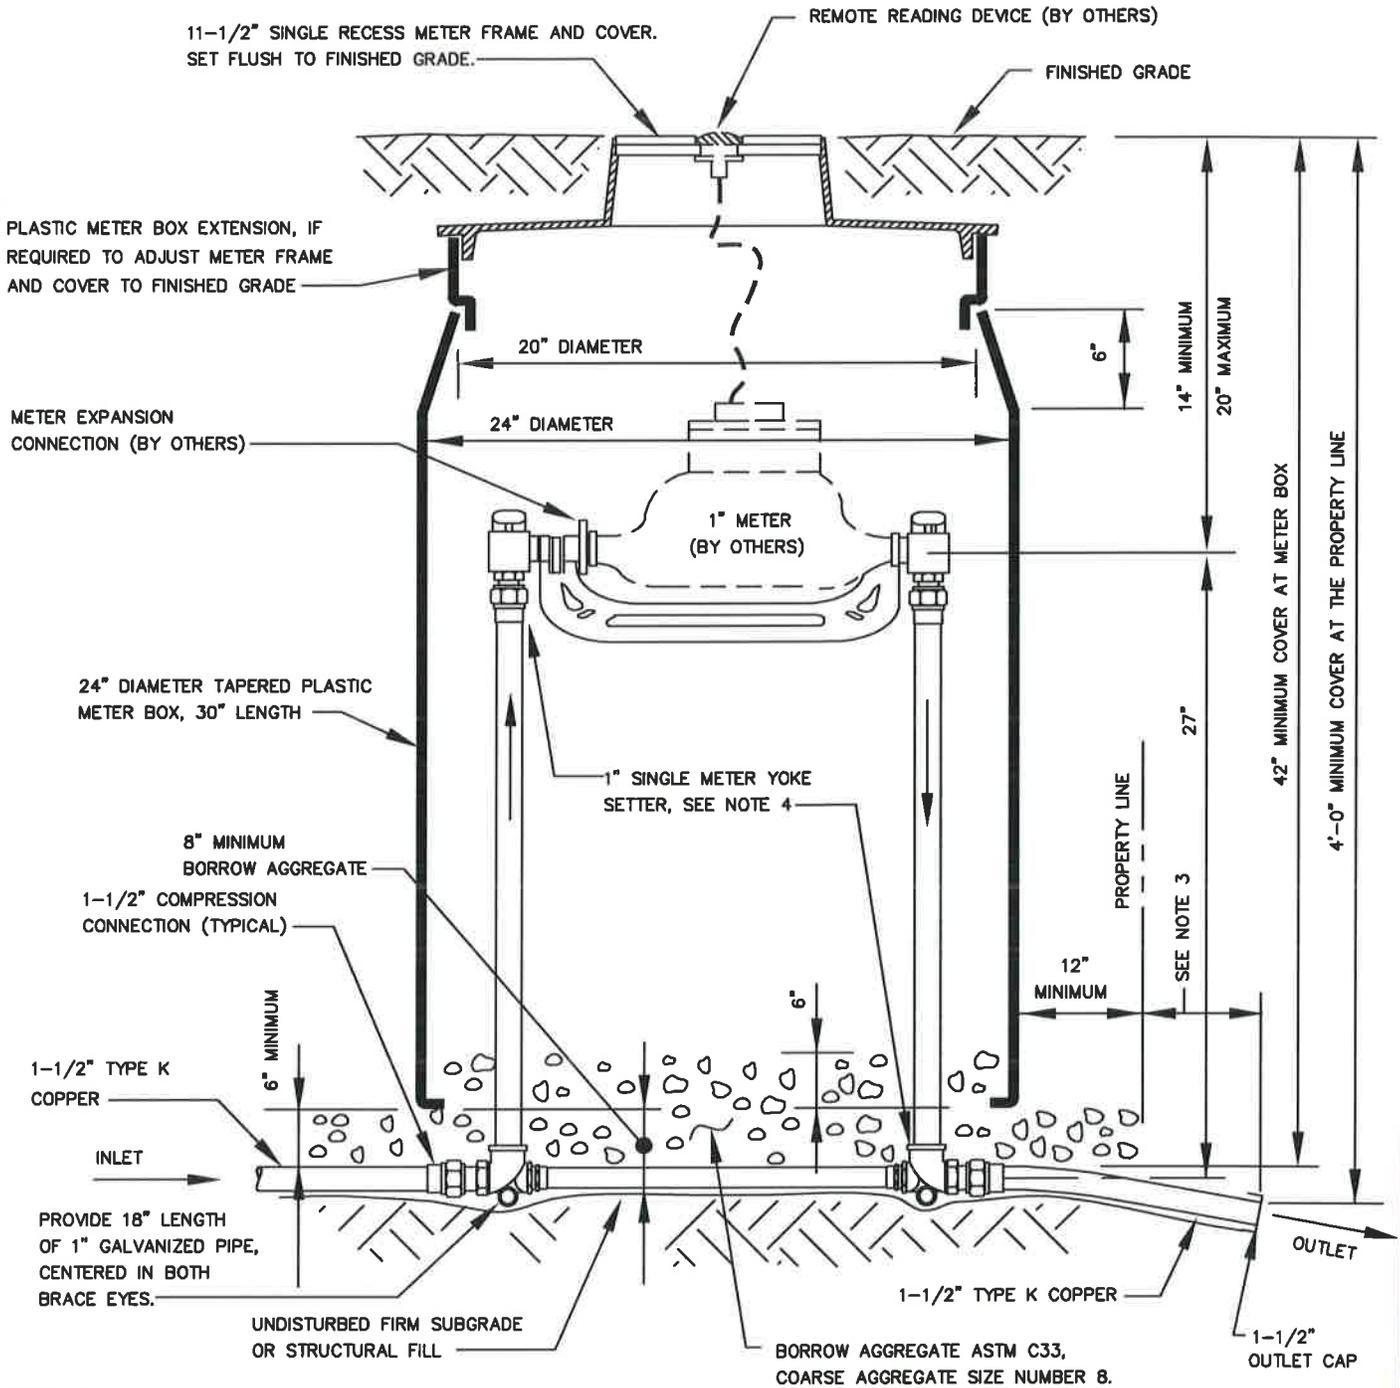

NOTES:

1. METER SETTING FOR NON-TRAFFIC AREAS ONLY, DO NOT LOCATE IN SIDEWALK OR DRIVEWAY, UNLESS OTHERWISE NOTED ON THE DRAWINGS.
2. COMPACT BACKFILL AND AGGREGATE BASE AS STRUCTURAL FILL.
3. EXTEND COPPER SERVICE OUTLET 3'-0" MINIMUM BEYOND METER BOX OR PROPERTY LINE, WHICHEVER IS GREATER.
4. 1" SINGLE METER YOKE SETTER IS COMPLETE ONE-PIECE FACTORY ASSEMBLED, INCLUDING TWO ANGLE BALL VALVES, YOKE, BENDS AND COMPRESSION CONNECTIONS.


WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/25/16</u> Chief Engineer	STANDARD DETAIL 1-INCH METER SETTING FOR 1-1/2-INCH SERVICE	<table style="margin: 0 auto;"> <tr><td style="text-align: center;">W</td></tr> <tr><td style="text-align: center;">5.7</td></tr> </table>	W	5.7
W					
5.7					

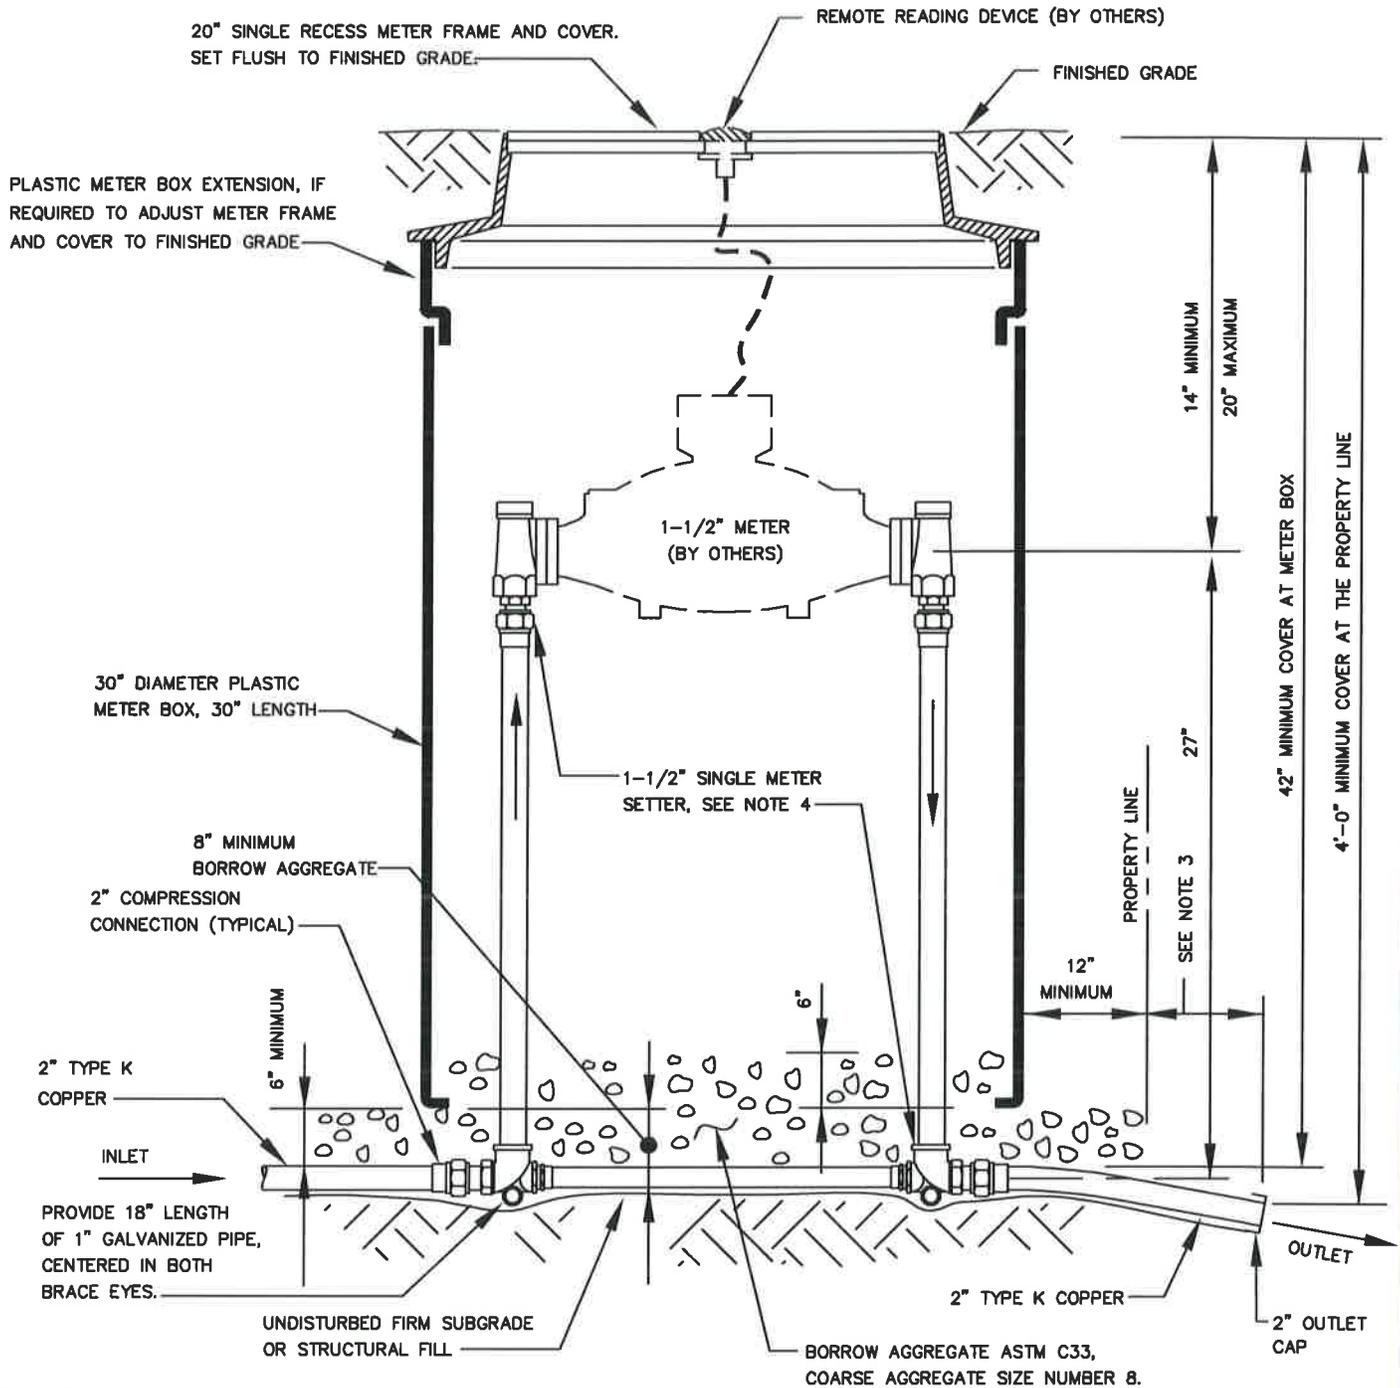

NOTES:


1. METER SETTING FOR NON-TRAFFIC AREAS ONLY, DO NOT LOCATE IN SIDEWALK OR DRIVEWAY, UNLESS OTHERWISE NOTED ON THE DRAWINGS.
2. COMPACT BACKFILL AND AGGREGATE BASE AS STRUCTURAL FILL.
3. EXTEND COPPER SERVICE OUTLET 3'-0" MINIMUM BEYOND METER BOX OR PROPERTY LINE, WHICHEVER IS GREATER.
4. 1-1/2" SINGLE METER SETTER IS COMPLETE ONE-PIECE FACTORY ASSEMBLED, INCLUDING TWO ANGLE BALL VALVES, BENDS AND COMPRESSION CONNECTIONS.


WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u>  Chief Engineer	STANDARD DETAIL 1-1/2-INCH METER SETTING FOR 2-INCH SERVICE	$\frac{W}{5.8}$
--	---	---	-----------------

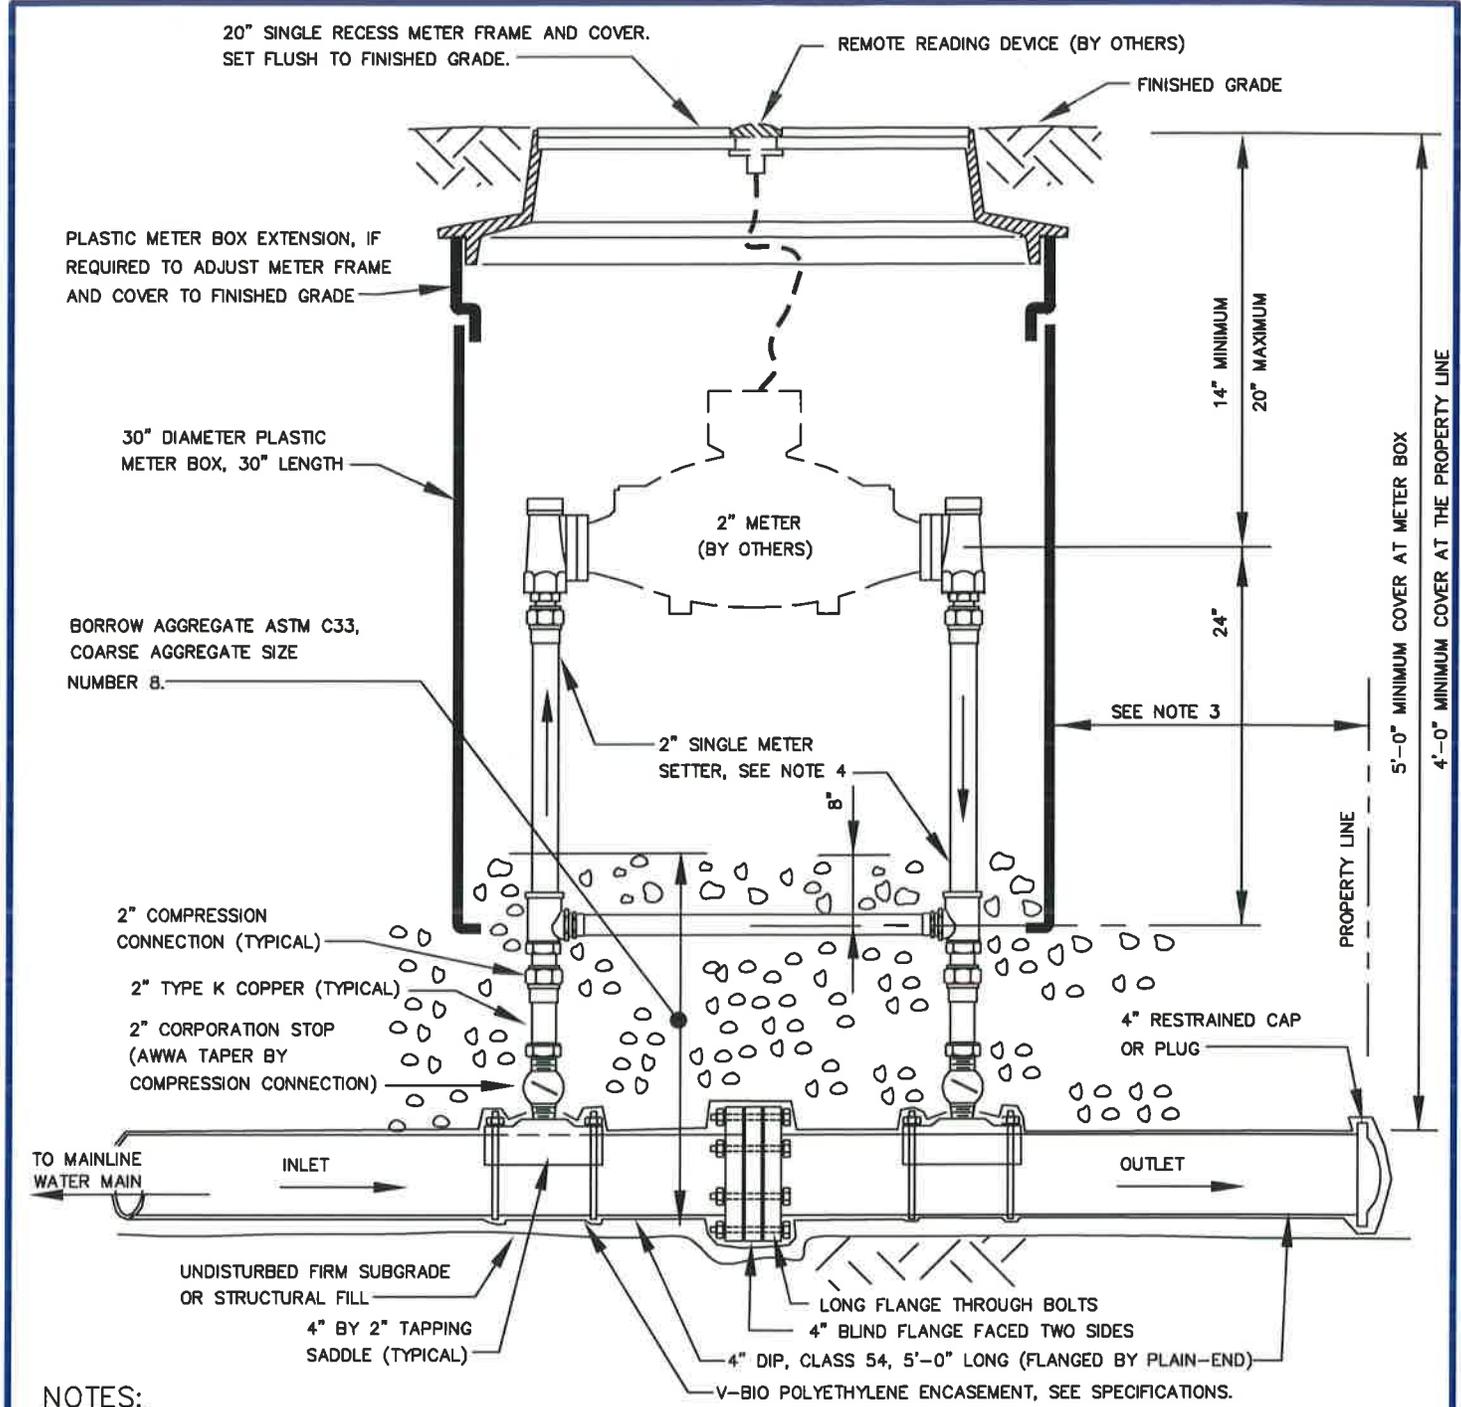

NOTES:


1. METER SETTING FOR NON-TRAFFIC AREAS ONLY, DO NOT LOCATE IN SIDEWALK OR DRIVEWAY, UNLESS OTHERWISE NOTED ON THE DRAWINGS.
2. COMPACT BACKFILL AND AGGREGATE BASE AS STRUCTURAL FILL.
3. EXTEND DUCTILE IRON SERVICE OUTLET 3'-0" MINIMUM BEYOND METER BOX OR PROPERTY LINE, WHICHEVER IS GREATER.
4. 2" SINGLE METER SETTER IS COMPLETE ONE-PIECE FACTORY ASSEMBLED, INCLUDING TWO ANGLE BALL VALVES, FITTINGS AND COMPRESSION CONNECTIONS.
5. RESTRAIN ALL PIPE JOINTS ON 4" DUCTILE IRON SERVICE, FROM THE MAINLINE WATER MAIN TO THE PLUG OR CAP.
6. V-BIO REQUIRED ON NEW COPPER PIPE, SEE SPECIFICATIONS.

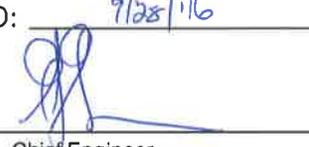
WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u>  Chief Engineer	STANDARD DETAIL 2-INCH METER SETTING FOR 4-INCH SERVICE	<table style="margin: auto;"> <tr><td style="text-align: center;">W</td></tr> <tr><td style="text-align: center;">5.9</td></tr> </table>	W	5.9
W					
5.9					

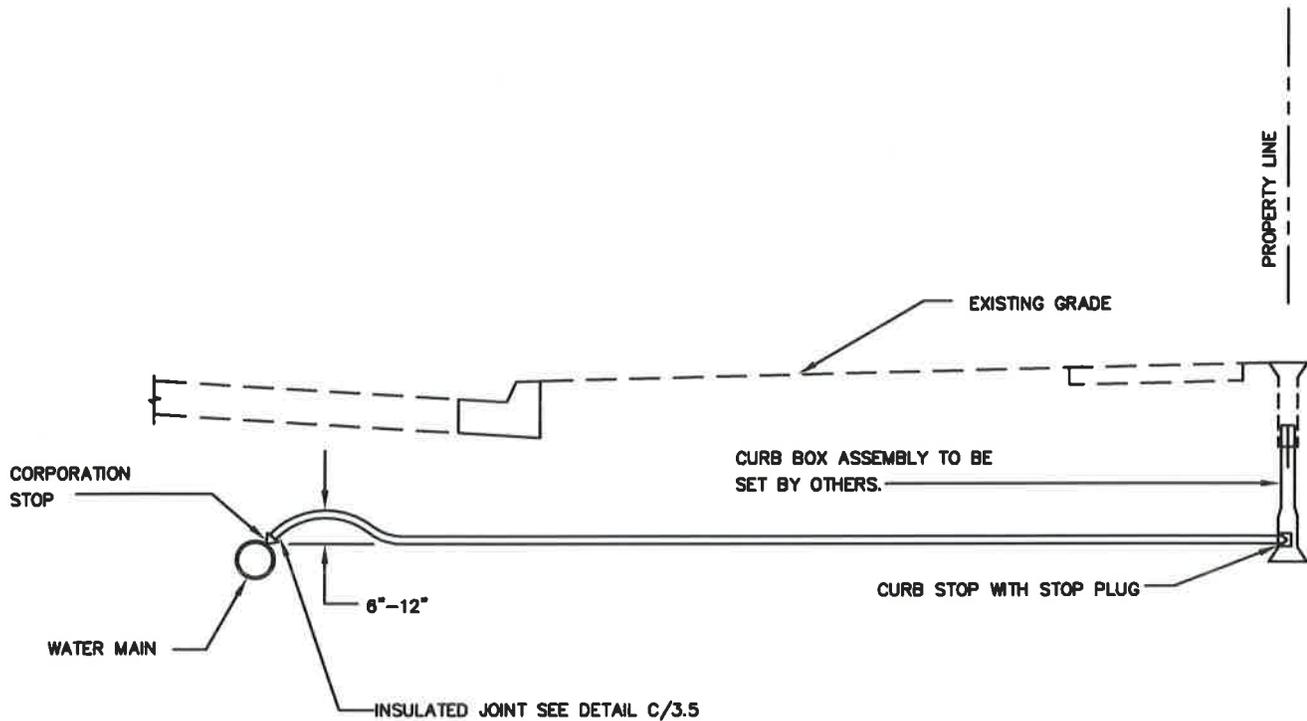


NOTES:

1. INSTALL W.H.C. 3'-6" MINIMUM BELOW FINISHED GRADE, UNLESS OTHERWISE SHOWN OR DIRECTED BY THE ENGINEER.
2. WHEN W.H.C. AND S.H.C. ARE INSTALLED IN SAME TRENCH, SEE DETAIL M/18.0.
3. END OF W.H.C. AT THE PROPERTY LINE. PROVIDE 4'-0" COVER OVER END OF W.H.C., UNLESS OTHER DIRECTED BY THE ENGINEER/CONTRACT MANAGER.
4. CORPORATION STOP TO BE LEFT OPEN AND CURB STOP TO STAY CLOSED.
5. AN APPROVED BENDING TOOL REQUIRED FOR MAKING BENDS IN ALL SIZES OF TYPE "K" COPPER PIPE.
6. FOR CONNECTIONS TO NEW WATER PIPE, V-BIO POLYETHYLENE ENCASEMENT REQUIRED ON NEW COPPER PIPE, SEE SPECIFICATIONS.


WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u>  Chief Engineer	STANDARD DETAIL 1-INCH, 1-1/2-INCH AND 2-INCH WATER HOUSE CONNECTIONS FOR INSIDE METERS	$\frac{W}{5.10}$
--	---	--	------------------

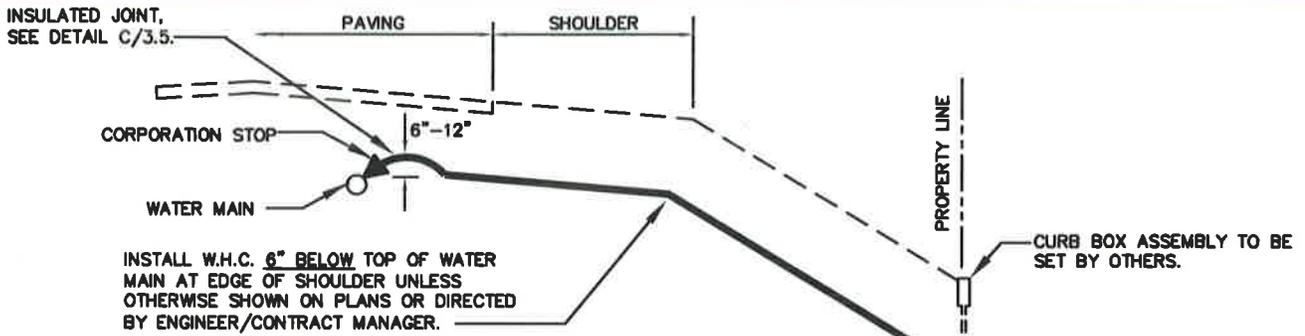

PARTIAL WIDTH GRADING
(FILL SECTION)

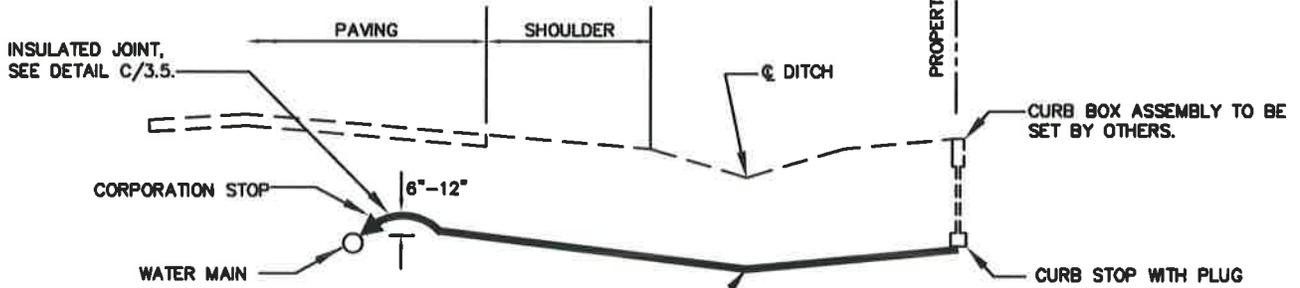

FULL WIDTH GRADING

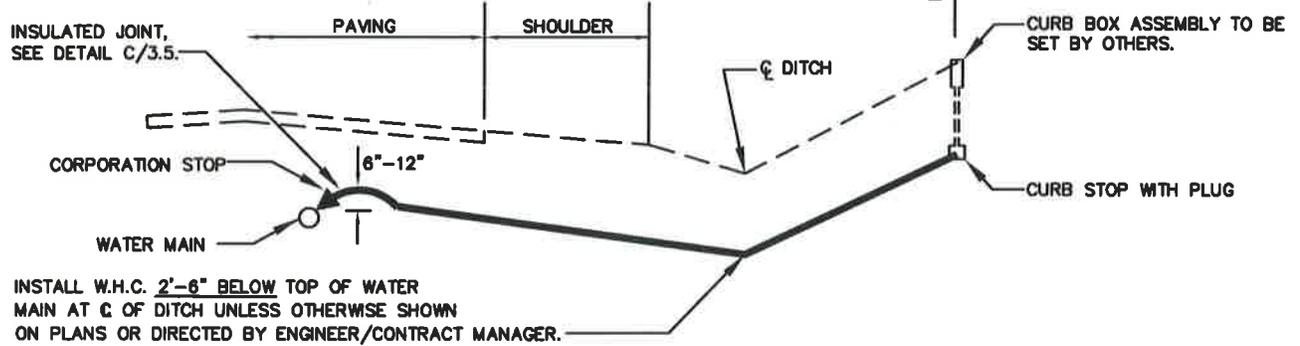

PARTIAL WIDTH GRADING

NOTES:

1. INSTALL W.H.C. 3'-6" MINIMUM BELOW FINISHED GRADE, UNLESS OTHERWISE SHOWN OR DIRECTED BY THE ENGINEER.
2. WHEN W.H.C. AND S.H.C. ARE INSTALLED IN SAME TRENCH, SEE DETAIL M/18.0.
3. END OF W.H.C. AT THE PROPERTY LINE. PROVIDE 4'-0" COVER OVER END ON W.H.C., UNLESS OTHER DIRECTED BY THE ENGINEER/CONTRACT MANAGER.
4. CORPORATION STOP TO BE LEFT OPEN AND CURB STOP TO STAY CLOSED.
5. AN APPROVED BENDING TOOL REQUIRED FOR MAKING BENDS IN ALL SIZES OF TYPE "K" COPPER PIPE.
6. FOR CONNECTIONS TO NEW WATER PIPE, V-BIO POLYETHYLENE ENCASEMENT IS REQUIRED ON NEW COPPER PIPE, SEE SPECIFICATIONS.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
1-INCH, 1-1/2-INCH AND 2-INCH
WATER HOUSE CONNECTIONS
FOR INSIDE METERS RURAL
TYPE PAVING SECTION


W
5.11

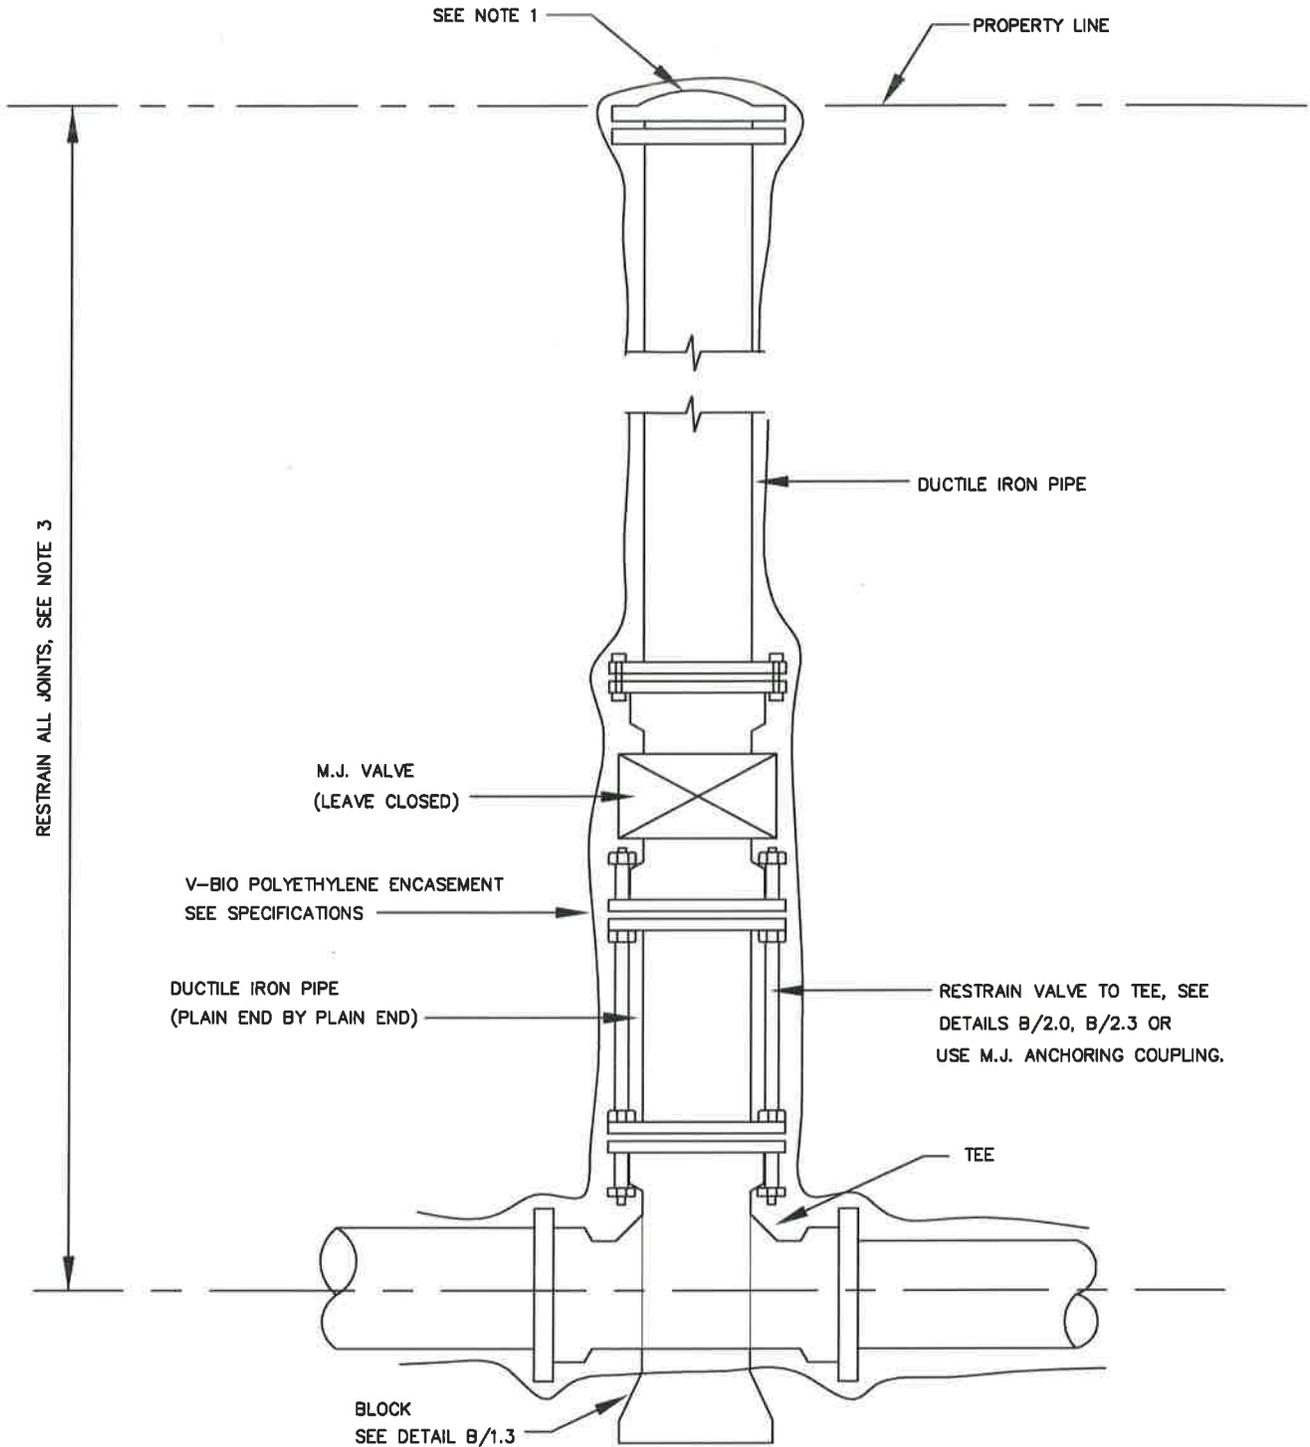

NOTES:


1. FOR INSIDE METER SETTINGS, TERMINATE WATER HOUSE CONNECTION WITH A MJ CAP. FOR OUTSIDE METER SETTINGS, SEE DETAILS W/5.0a, W/5.0d, W/5.1c, W/5.9, W/5.9a AND W/12.0a.
2. LAY SERVICE LEVEL UNLESS OTHERWISE NOTED ON THE DRAWINGS.
3. RESTRAIN ALL JOINTS ON WATER HOUSE CONNECTION.
4. IF BENDS ARE INSTALLED ON WATER HOUSE CONNECTION PROVIDE BLOCKING. SEE DETAILS B/1.0 AND B/1.8

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
4-INCH THRU 12-INCH
DUCTILE IRON
WATER HOUSE CONNECTION

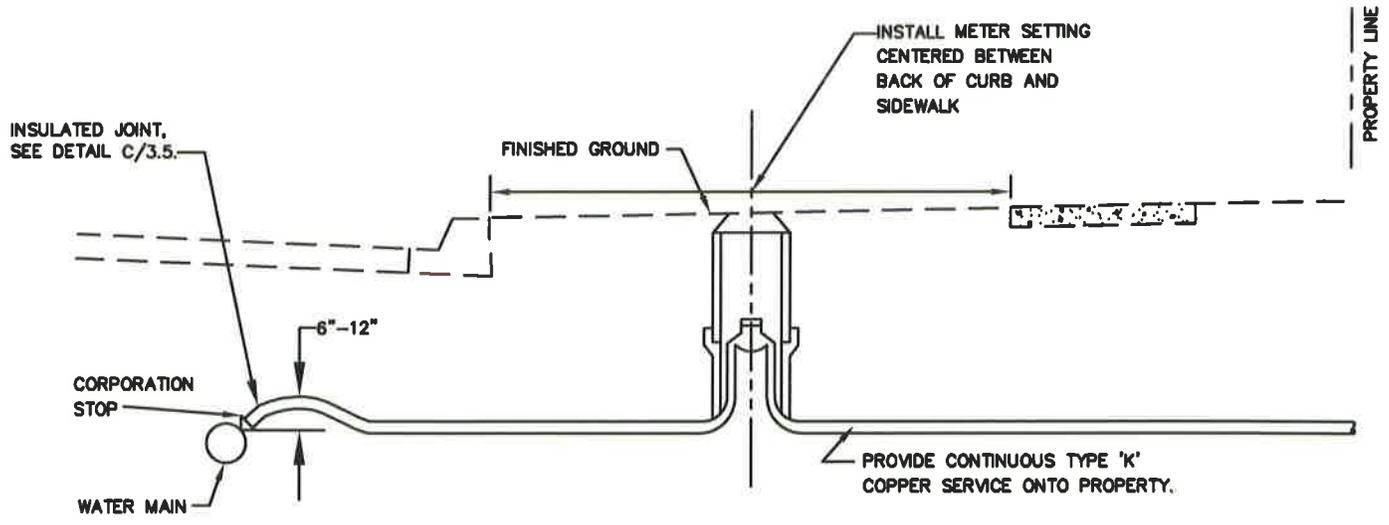W
5.12

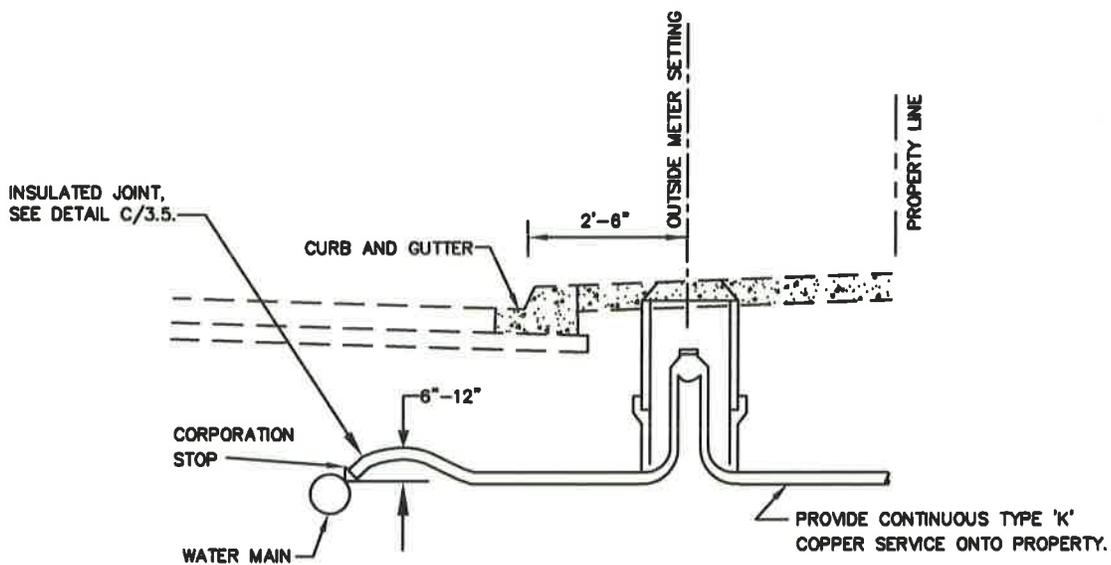

PROFILE - GRASS AREA BEHIND CURB



PROFILE - SIDEWALK BEHIND CURB

NOTES:

1. INSTALL W.H.C. 3'-6" MINIMUM BELOW FINISHED GRADE, UNLESS OTHERWISE SHOWN OR DIRECTED BY THE ENGINEER.
2. WHEN W.H.C. AND S.H.C. ARE INSTALLED IN SAME TRENCH, SEE DETAIL M/18.0.
3. END OF W.H.C. AT THE PROPERTY LINE. PROVIDE 4'-0" COVER OVER END ON W.H.C., UNLESS OTHER DIRECTED BY THE ENGINEER/CONTRACT MANAGER.
4. CORPORATION STOP TO BE LEFT OPEN AND CURB STOP TO STAY CLOSED.
5. AN APPROVED BENDING TOOL REQUIRED FOR MAKING BENDS IN ALL SIZES OF TYPE "K" COPPER PIPE.
6. FOR CONNECTIONS TO NEW WATER PIPE, V-BIO POLYETHYLENE ENCASEMENT IS REQUIRED ON NEW COPPER PIPE, SEE SPECIFICATIONS.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: _____

9/28/16


[Signature]
Chief Engineer

STANDARD DETAIL
LOCATION OF OUTSIDE METERS
FOR 1-INCH, 1 1/2-INCH AND 2-INCH
WATER HOUSE CONNECTIONS
CLOSED PAVING SECTION


W
5.13

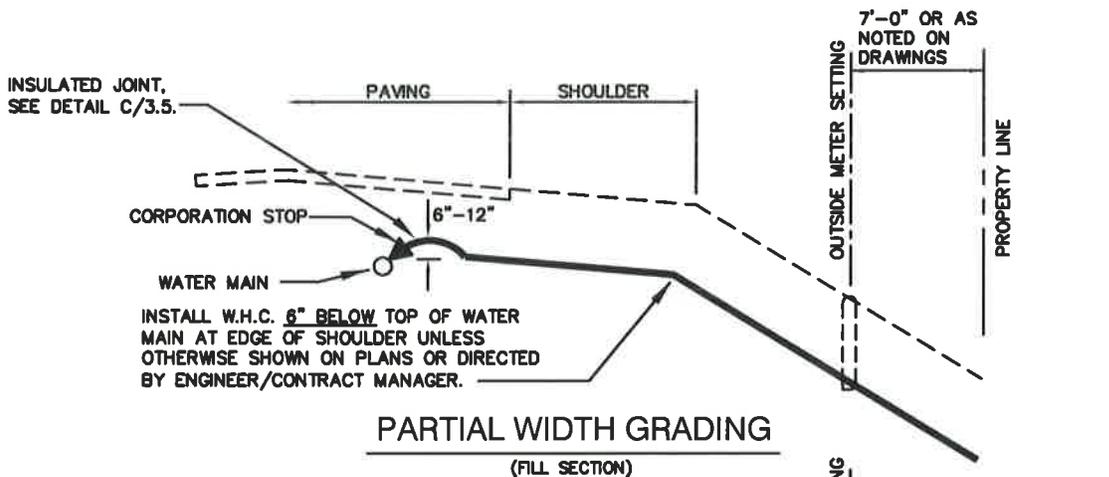

PARTIAL WIDTH GRADING
(FILL SECTION)

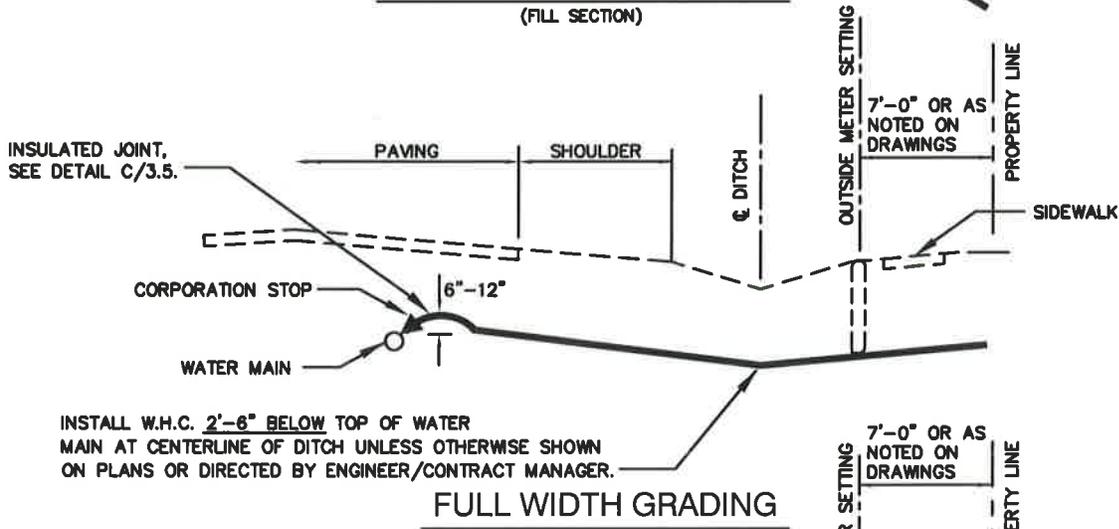

FULL WIDTH GRADING

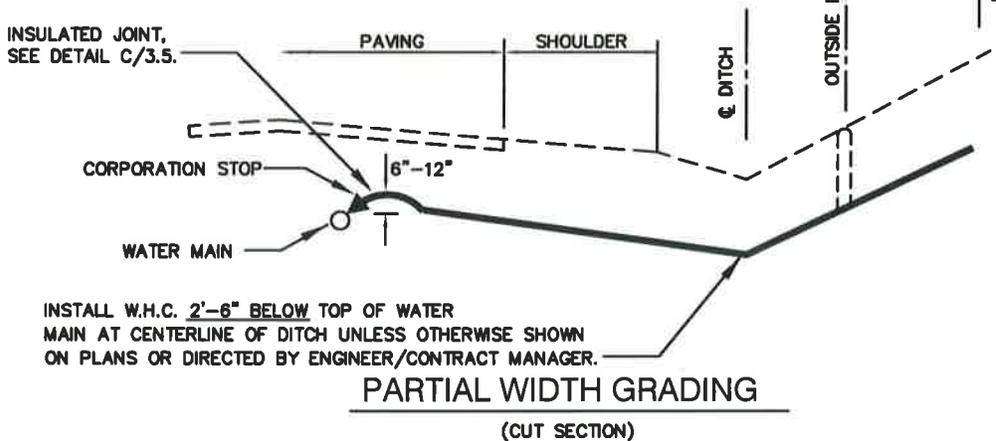

PARTIAL WIDTH GRADING
(CUT SECTION)

NOTES:

1. INSTALL W.H.C. 3'-6" MINIMUM BELOW FINISHED GRADE, UNLESS OTHERWISE SHOWN OR DIRECTED BY THE ENGINEER.
2. WHEN W.H.C. AND S.H.C. ARE INSTALLED IN SAME TRENCH, SEE DETAIL M/18.0.
3. END OF W.H.C. AT THE PROPERTY LINE. PROVIDE 4'-0" COVER OVER END ON W.H.C., UNLESS OTHER DIRECTED BY THE ENGINEER/CONTRACT MANAGER.
4. CORPORATION STOP TO BE LEFT OPEN AND CURB STOP TO STAY CLOSED.
5. AN APPROVED BENDING TOOL REQUIRED FOR MAKING BENDS IN ALL SIZES OF TYPE "K" COPPER PIPE.
6. FOR CONNECTIONS TO NEW WATER PIPE, V-BIO POLYETHYLENE ENCASEMENT IS REQUIRED ON NEW COPPER PIPE, SEE SPECIFICATIONS.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16


Chief Engineer

STANDARD DETAIL
1-INCH, 1-1/2-INCH AND 2-INCH
WATER HOUSE CONNECTIONS AND
OUTSIDE METER LOCATIONS
RURAL PAVING SECTIONS

W
5.14

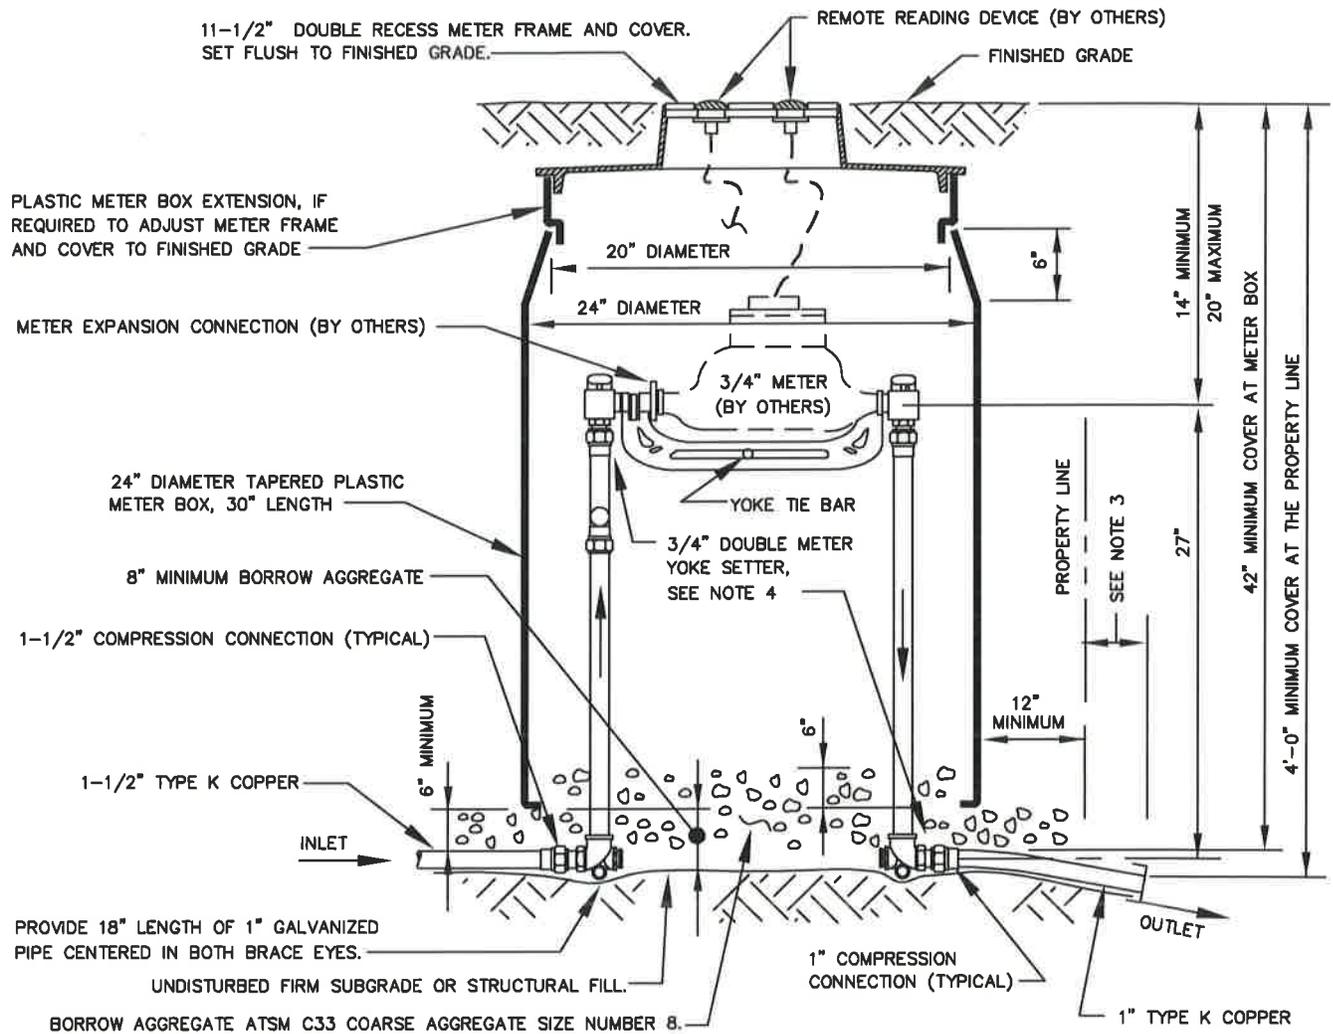

SECTION A-A

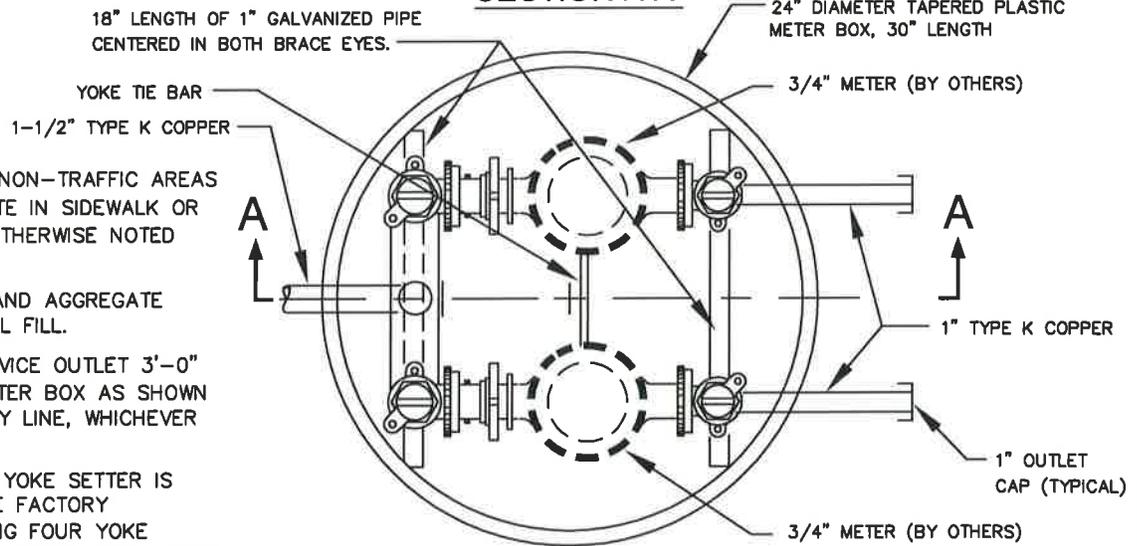

PLAN

NOTES:

1. METER SETTING FOR NON-TRAFFIC AREAS ONLY, DO NOT LOCATE IN SIDEWALK OR DRIVEWAY, UNLESS OTHERWISE NOTED ON THE DRAWINGS.
2. COMPACT BACKFILL AND AGGREGATE BASE AS STRUCTURAL FILL.
3. EXTEND COPPER SERVICE OUTLET 3'-0" MINIMUM BEYOND METER BOX AS SHOWN OR TO THE PROPERTY LINE, WHICHEVER IS GREATER.
4. 3/4" DOUBLE METER YOKE SETTER IS COMPLETE ONE-PIECE FACTORY ASSEMBLED, INCLUDING FOUR YOKE ANGLE BALL VALVES, BENDS, TWO YOKES AND COMPRESSION COUPLINGS.



WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
**DOUBLE 3/4-INCH
METER SETTING**

W
5.15

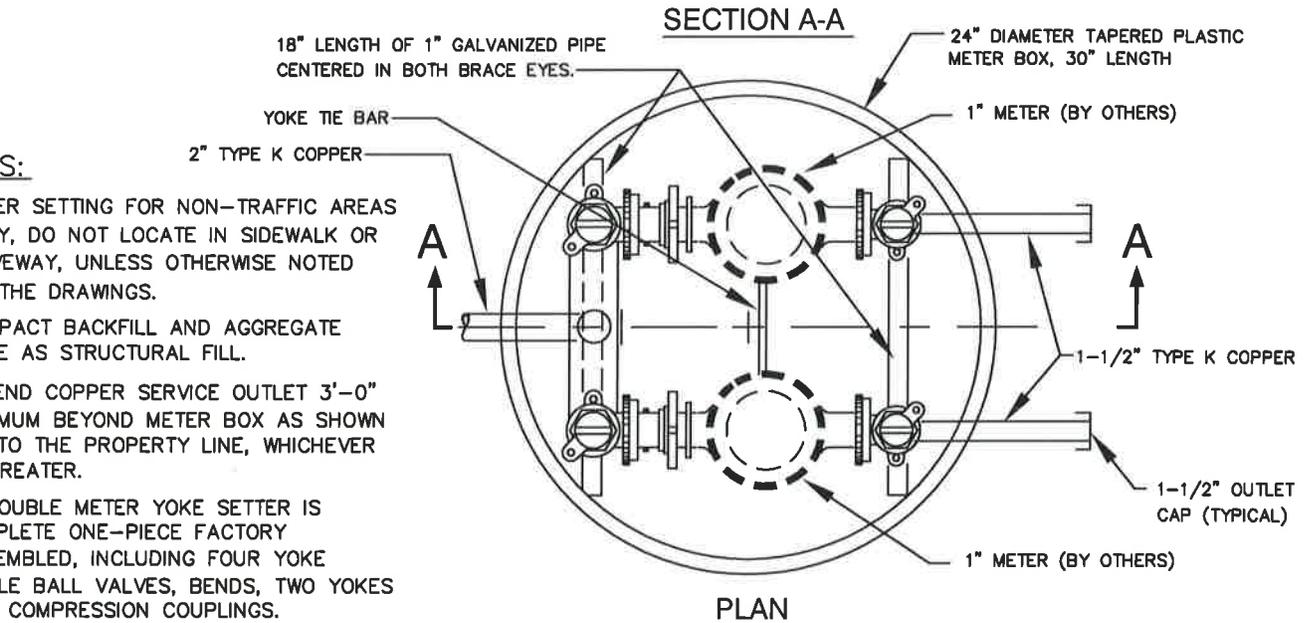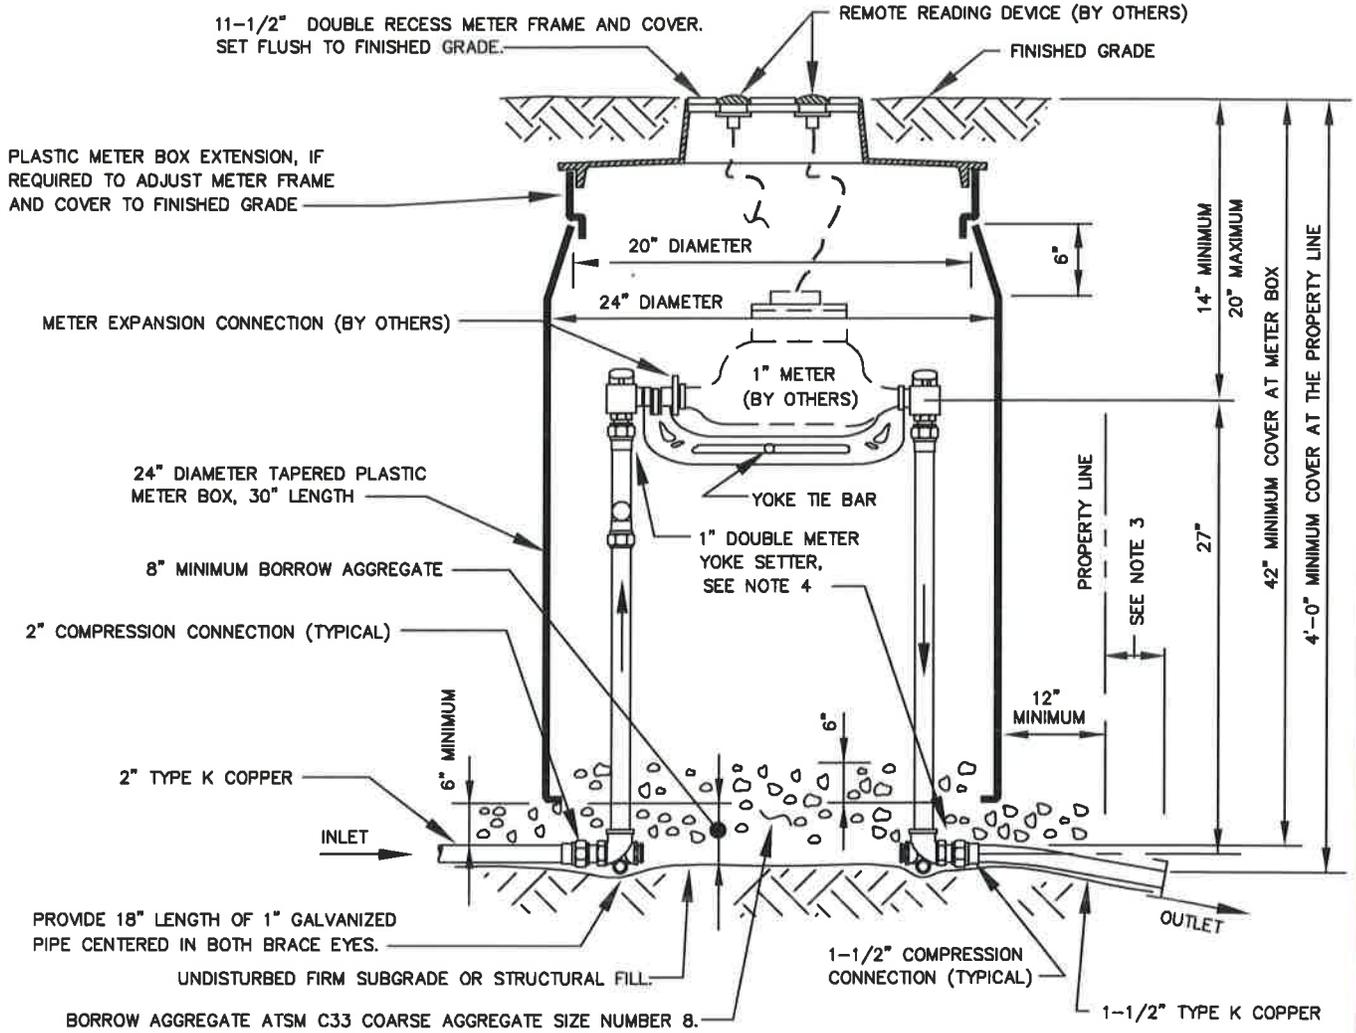

NOTES:

1. METER SETTING FOR NON-TRAFFIC AREAS ONLY, DO NOT LOCATE IN SIDEWALK OR DRIVEWAY, UNLESS OTHERWISE NOTED ON THE DRAWINGS.
2. COMPACT BACKFILL AND AGGREGATE BASE AS STRUCTURAL FILL.
3. EXTEND COPPER SERVICE OUTLET 3'-0" MINIMUM BEYOND METER BOX AS SHOWN OR TO THE PROPERTY LINE, WHICHEVER IS GREATER.
4. 1" DOUBLE METER YOKE SETTER IS COMPLETE ONE-PIECE FACTORY ASSEMBLED, INCLUDING FOUR YOKE ANGLE BALL VALVES, BENDS, TWO YOKEs AND COMPRESSION COUPLINGS.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
**DOUBLE 1-INCH
METER SETTING**

W
5.15a

CONTRACTOR TO PROVIDE TEMPORARY METER COVER WITH HOLE FOR TEMPORARY WATER HOSE, IF EQUIP, OTHERWISE PROVIDE HOLE IN COVER

EXISTING REMOTE READING DEVICE IF EQUIPPED.

TEMPORARY WATER SERVICE, CONTRACTOR TO PROVIDE

EXISTING METER FRAME

PIPE COUPLING, CONTRACTOR TO PROVIDE

TEMPORARY COPPER PIPE, CONTRACTOR TO PROVIDE

INVERT AND CONNECT TEMPORARY ANGLE BALL VALVE, CONTRACTOR TO PROVIDE

EXISTING METER

CLOSE AND DISCONNECT EXISTING ANGLE VALVE

EXISTING ANGLE VALVE YOKE SETTER

EXISTING METER BOX

EXISTING WATER SERVICE

INLET

OUTLET

TEMPORARY WATER SERVICE FOR OUTSIDE METER SETTING

CONTRACTOR TO PROVIDE TEMPORARY METER COVER WITH HOLE FOR TEMPORARY WATER HOSE, IF EQUIP, OTHERWISE PROVIDE HOLE IN COVER

EXISTING REMOTE READING DEVICE IF EQUIPPED.

TEMPORARY WATER SERVICE, CONTRACTOR TO PROVIDE

EXISTING METER FRAME

PIPE COUPLING, CONTRACTOR TO PROVIDE

TEMPORARY COPPER PIPE, CONTRACTOR TO PROVIDE

INVERT AND RE-CONNECT EXISTING ANGLE BALL VALVE

EXISTING METER

CRIMPED EXISTING COPPER SERVICE FOR SHUT DOWN

EXISTING ANGLE VALVE YOKE SETTER

EXISTING METER BOX

EXISTING WATER SERVICE

EXISTING COPPER WATER SERVICE

INLET

OUTLET

OPTION FOR TEMPORARY WATER SERVICE FOR OUTSIDE METER SETTING

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: 9/28/16




Chief Engineer

STANDARD DETAIL
EXISTING OUTSIDE METER
TEMPORARY WATER SERVICE
FOR
WATER MAIN REPLACEMENT

W
5.16

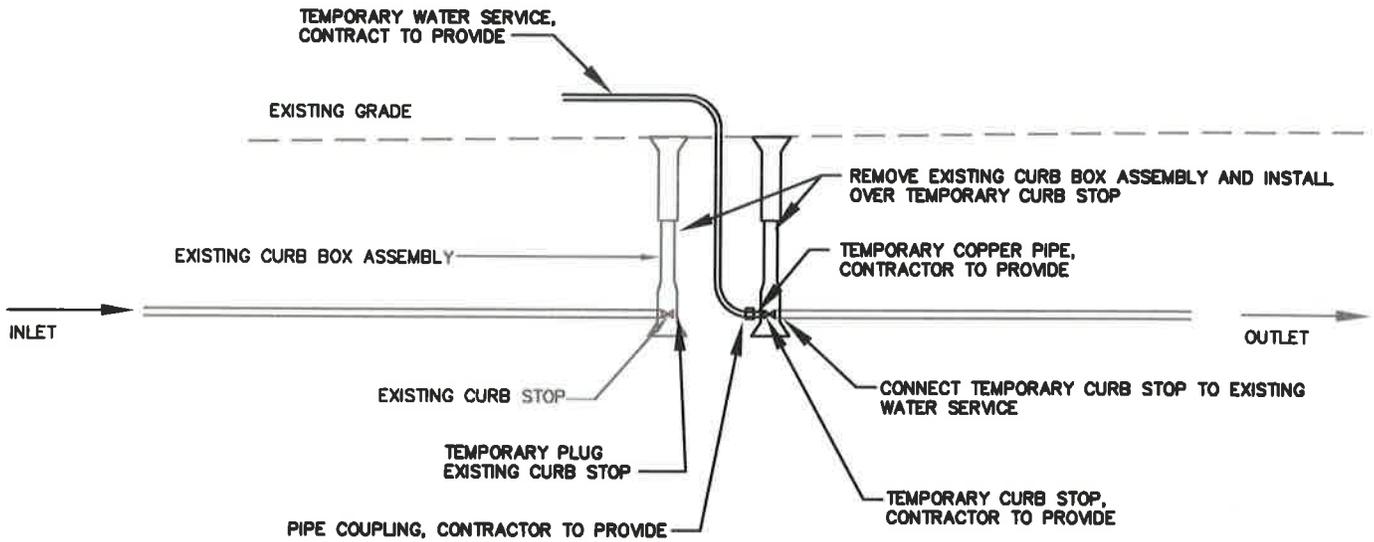


**TEMPORARY WATER SERVICE
FOR INSIDE METER SETTING**

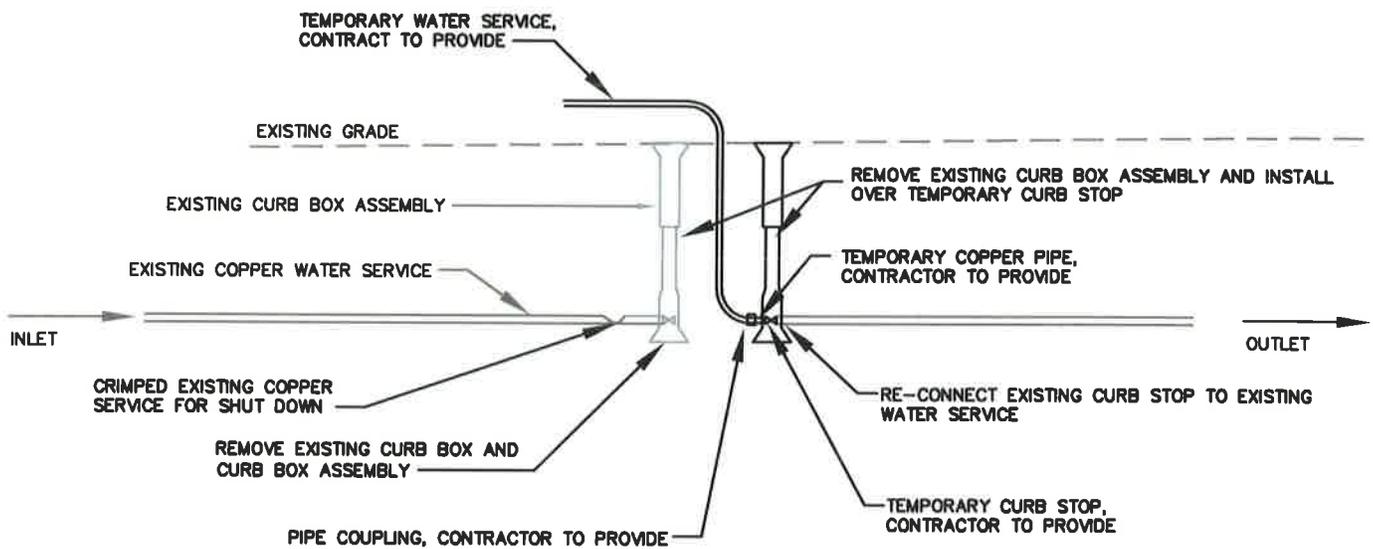

**OPTION FOR TEMPORARY WATER
SERVICE FOR INSIDE METER SETTING**

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: _____

9/28/16


Chief Engineer

STANDARD DETAIL
EXISTING INSIDE METER SETTING
TEMPORARY WATER SERVICE
FOR
WATER MAIN REPLACEMENT

W
5.16a

PIPE SIZE IN INCHES	CLASS OF PIPE	MAX. DEPTH TO INVERT
3	54	100'
4	54	100'
6	52	100'
8	54	80'
	55	98'
	56	100'
10	54	57'
	55	67'
	56	81'
12	54	46'
	55	55'
	56	65'
14	54	37'
	55	44'
	56	53'
16	54	31'
	55	36'
	56	42'
18	54	26'
	55	31'
	56	36'

PIPE SIZE IN INCHES	CLASS OF PIPE	MAX. DEPTH TO INVERT
20	54	23'
	55	27'
	56	31'
24	54	20'
	55	22'
	56	26'
30	54	26'
	55	29'
	56	33'
36	54	28'
	55	31'
	56	34'
42	54	27'
	55	31'
	56	34'
48	54	28'
	55	32'
	56	35'
54	54	29'
	55	32'
	56	36'

CRITERIA:

DESIGN PROCEDURE SAME AS ANSI A21.50 (AWWA C150).

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u>  Chief Engineer	STANDARD DETAIL DUCTILE IRON PIPE LOAD CHART	$\frac{W}{6.0}$
--	---	--	-----------------

12-INCH AND SMALLER	
	PVC AWWA C900 DIMENSION RATIO (DR)
	DR 14
MAXIMUM COVER OVER PIPE USING GENERAL TRENCH BACKFILL	25'
MAXIMUM COVER OVER PIPE USING BORROW AGGREGATE MATERIAL (AS NOTED ON THE DRAWINGS)	40'

16-INCH PIPE		
	PVC AWWA C905 DIMENSION RATIO (DR)	
	DR 14	DR 18
MAXIMUM COVER OVER PIPE USING GENERAL TRENCH BACKFILL	25'	10'
MAXIMUM COVER OVER PIPE USING BORROW AGGREGATE MATERIAL (AS NOTED ON THE DRAWINGS)	40'	22'

LARGER THAN 16-INCH PIPE	
	PVC AWWA C905 DIMENSION RATIO (DR)
	DR 18
MAXIMUM COVER OVER PIPE USING GENERAL TRENCH BACKFILL	10'
MAXIMUM COVER OVER PIPE USING BORROW AGGREGATE MATERIAL (AS NOTED ON THE DRAWINGS)	22'



NOTE

- FOR ADDITIONAL INFORMATION, SEE DETAIL M/8.1a AND SPECIFICATIONS.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u>  Chief Engineer	STANDARD DETAIL POLYVINYL CHLORIDE (PVC) PIPE (AWWA C900/905) LOAD CHART	$\frac{W}{6.1}$
--	---	---	-----------------

NOTES:

1. METER TO BE SET HORIZONTALLY.
2. BENDS IN REMOTE READER CONDUIT NO GREATER THAN 45° EXCEPT 90° PERMITTED AT EXIT.
3. SECURE METER RACK ABOVE AND BELOW TO PREVENT STRAIN ON PIPING.
4. LOCATE EXIT POINT FOR REMOTE READING DEVICE 2-1/2' TO 4' ABOVE FINISHED GRADE ON SAME WALL AS ELECTRIC METER. IF ELECTRIC METER IS LOCATED AT REAR OF BUILDING, LOCATE EXIT POINT IN FRONT OF BUILDING. REMOTE READER AND CABLE TO BE SUPPLIED BY WSSC.

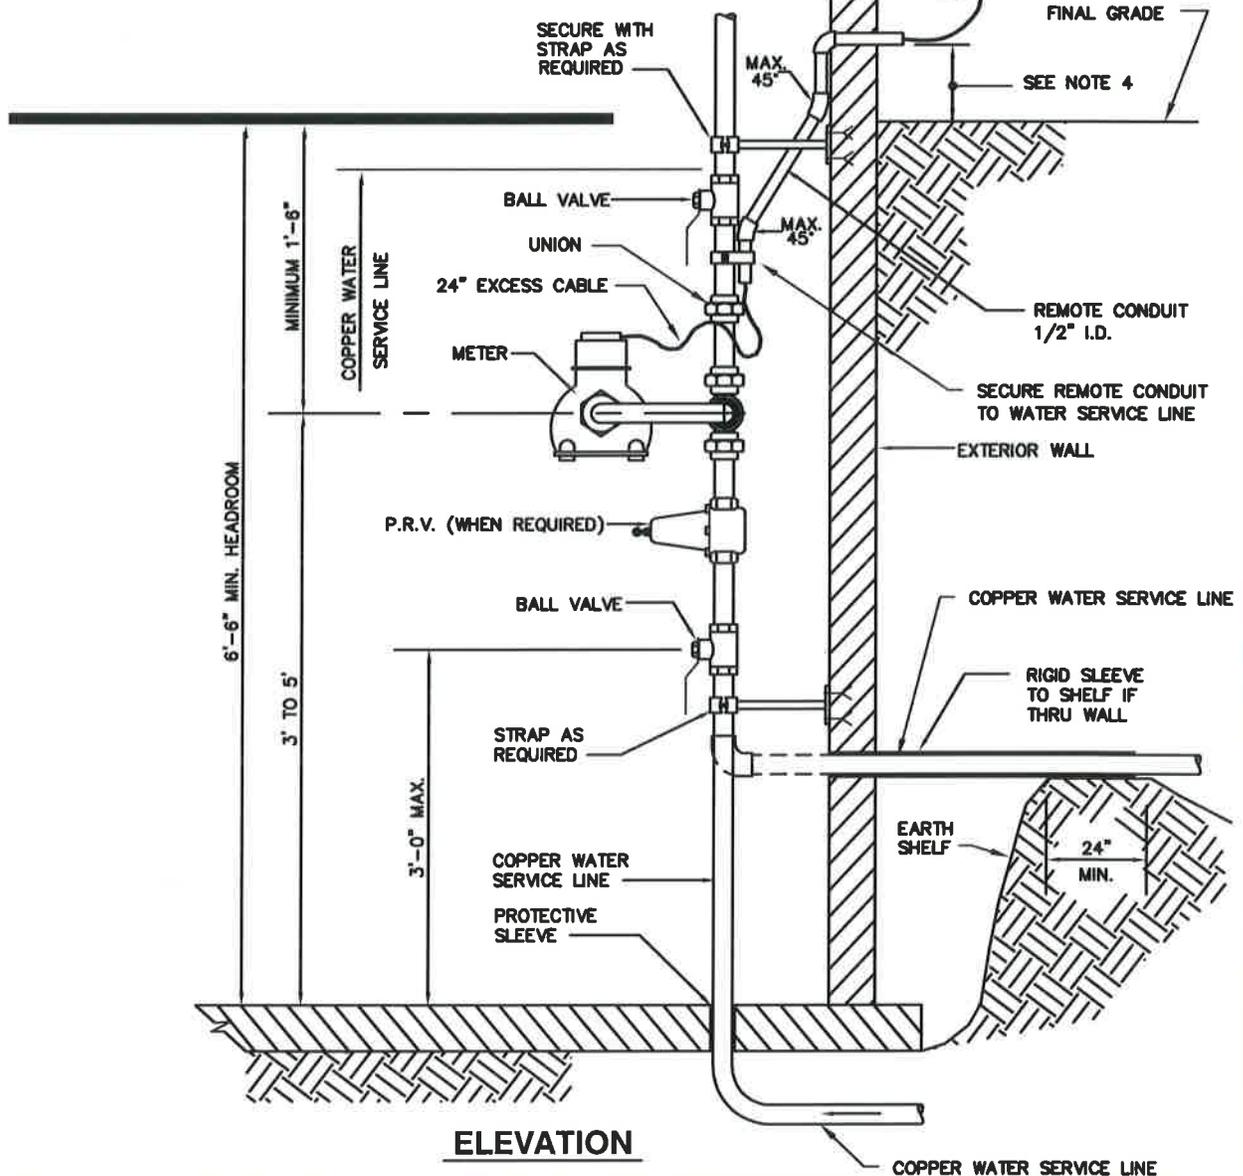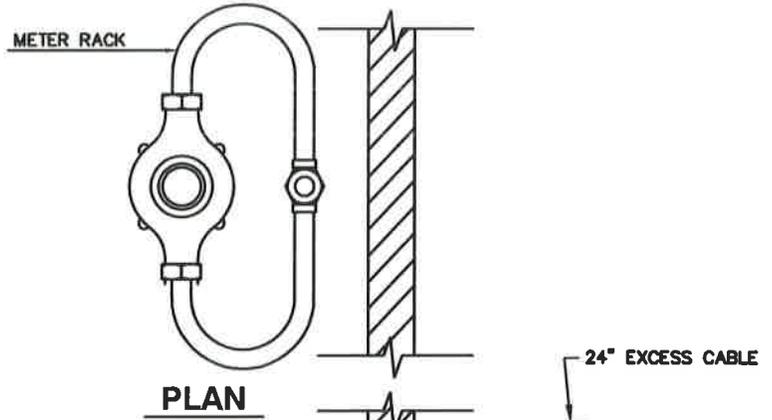

ELEVATION

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16


Chief Engineer

STANDARD DETAIL
1-INCH AND SMALLER
INSIDE WATER METER SETTING

W
7.1

NOTE:

1. FLANGE BOLTS SHALL BE READILY ACCESSIBLE.
2. ALL VALVES SHALL BE BALL TYPE.
3. METER TO BE SET HORIZONTALLY.
4. SLEEVE SHALL REST ON 24" OF UNDISTURBED EARTH AND EXTEND THRU THE FOUNDATION WALL.
5. FOR METER SETTING WHEN METER ROOM IS ADJACENT TO EXTERIOR BUILDING WALLS, SEE DETAIL W/7.2b.
6. REMOTE READER CONDUIT - NO BENDS GREATER THAN 45°, EXCEPT AS SHOWN.
7. SECURE REMOTE READER CONDUIT TO WATER SERVICE LINE.
8. LOCATE EXIT POINT FOR REMOTE READING DEVICE 2'-1/2' TO 4' ABOVE FINISHED GRADE AND ON SAME WALL AS ELECTRIC METER. IF ELECTRIC METER IS LOCATED AT REAR OF BUILDING, LOCATE EXIT POINT IN FRONT OF BUILDING. REMOTE READER CABLE TO BE SUPPLIED BY WSSC.

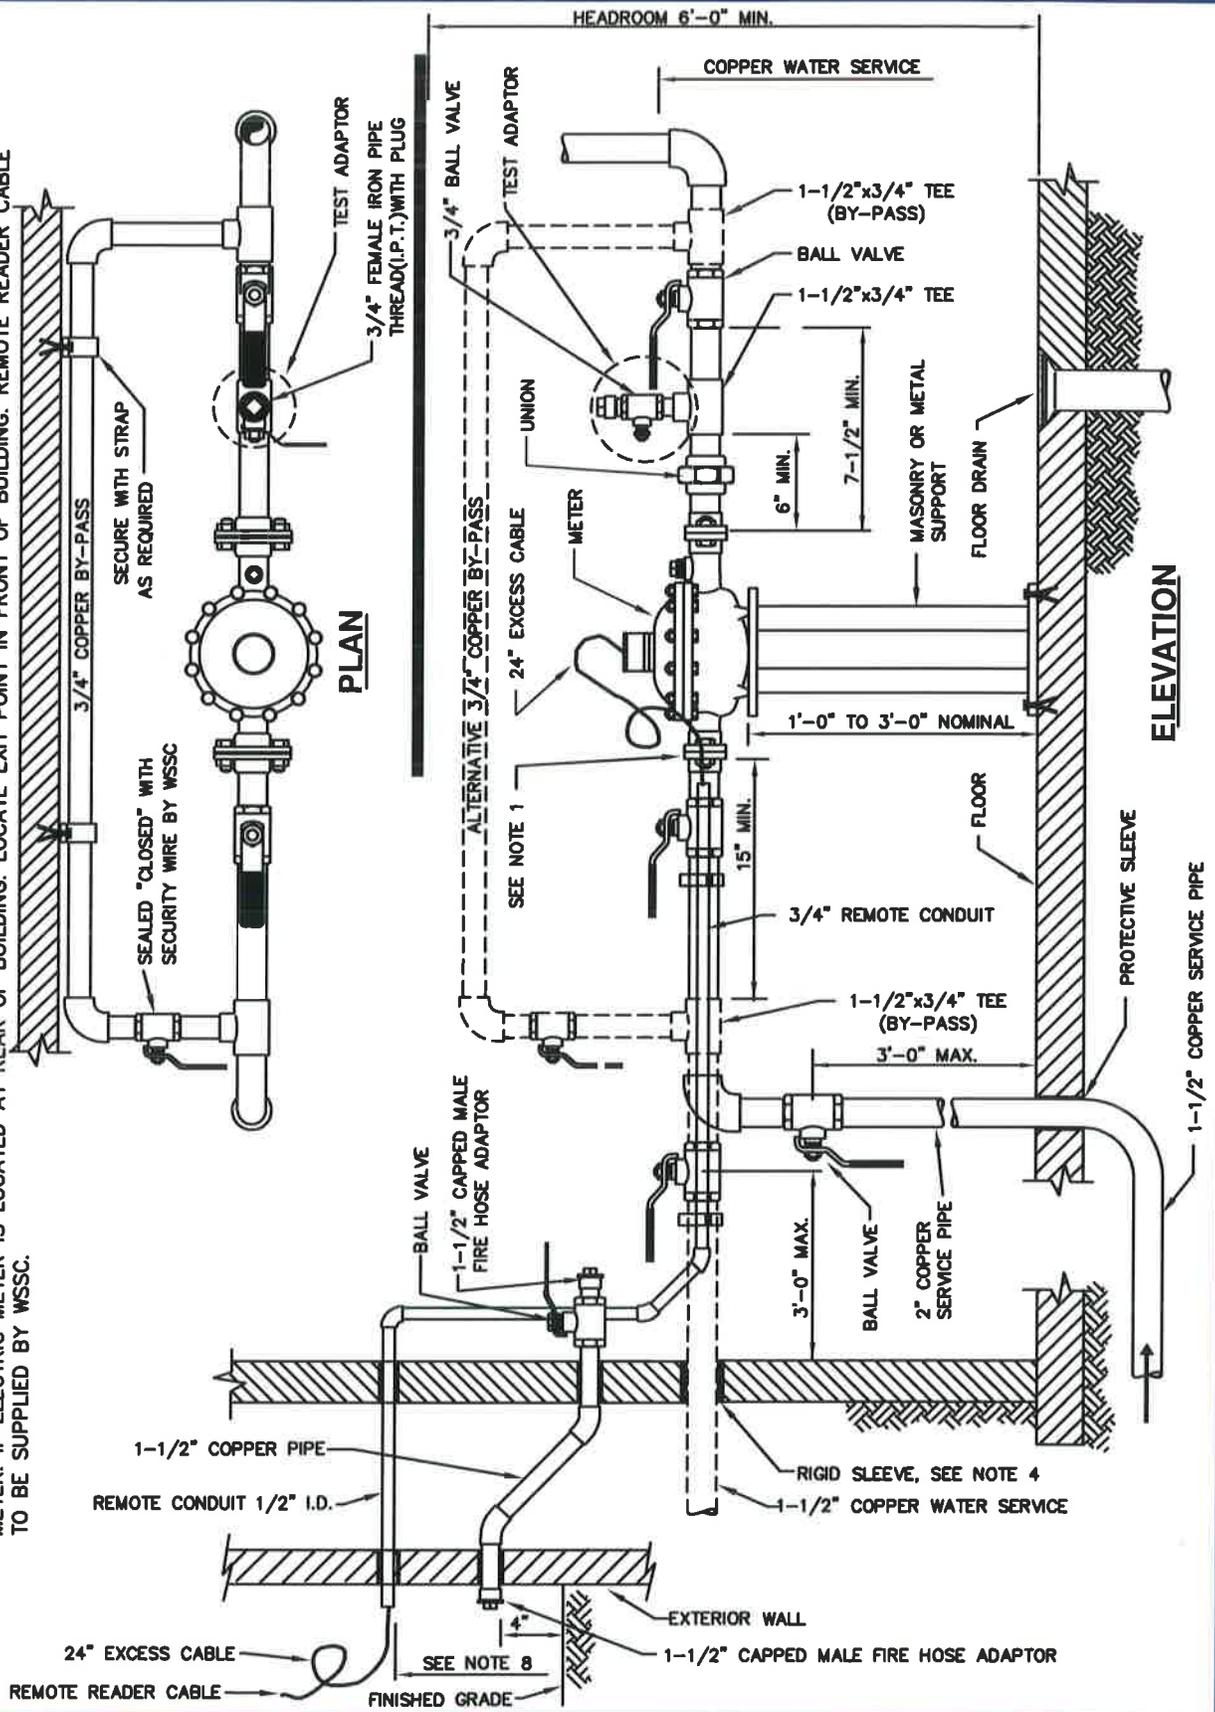

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
1-1/2-INCH INSIDE WATER METER
SETTING WHEN METER
ROOM IS NOT ADJACENT TO
EXTERIOR BUILDING WALLS

W
7.2a

- NOTE:**
1. FLANGE BOLTS SHALL BE READILY ACCESSIBLE.
 2. ALL VALVES SHALL BE BALL TYPE.
 3. METER TO BE SET HORIZONTALLY.
 4. SLEEVE SHALL REST ON 24" OF UNDISTURBED EARTH AND EXTEND THRU THE FOUNDATION WALL.
 5. FOR METER SETTING WHEN METER ROOM IS NOT ADJACENT TO EXTERIOR BUILDING WALLS, SEE DETAIL W/7.2a.
 6. REMOTE READER CONDUIT - NO BENDS GREATER THAN 45°, EXCEPT AS SHOWN.
 7. SECURE REMOTE READER CONDUIT TO WATER SERVICE LINE.
 8. LOCATE EXIT POINT FOR REMOTE READING DEVICE 2'-1/2' TO 4' ABOVE FINISHED GRADE AND ON SAME WALL AS ELECTRIC METER. IF ELECTRIC METER IS LOCATED AT REAR OF BUILDING, LOCATE EXIT POINT IN FRONT OF BUILDING. REMOTE READER CABLE TO BE SUPPLIED BY WSSC.

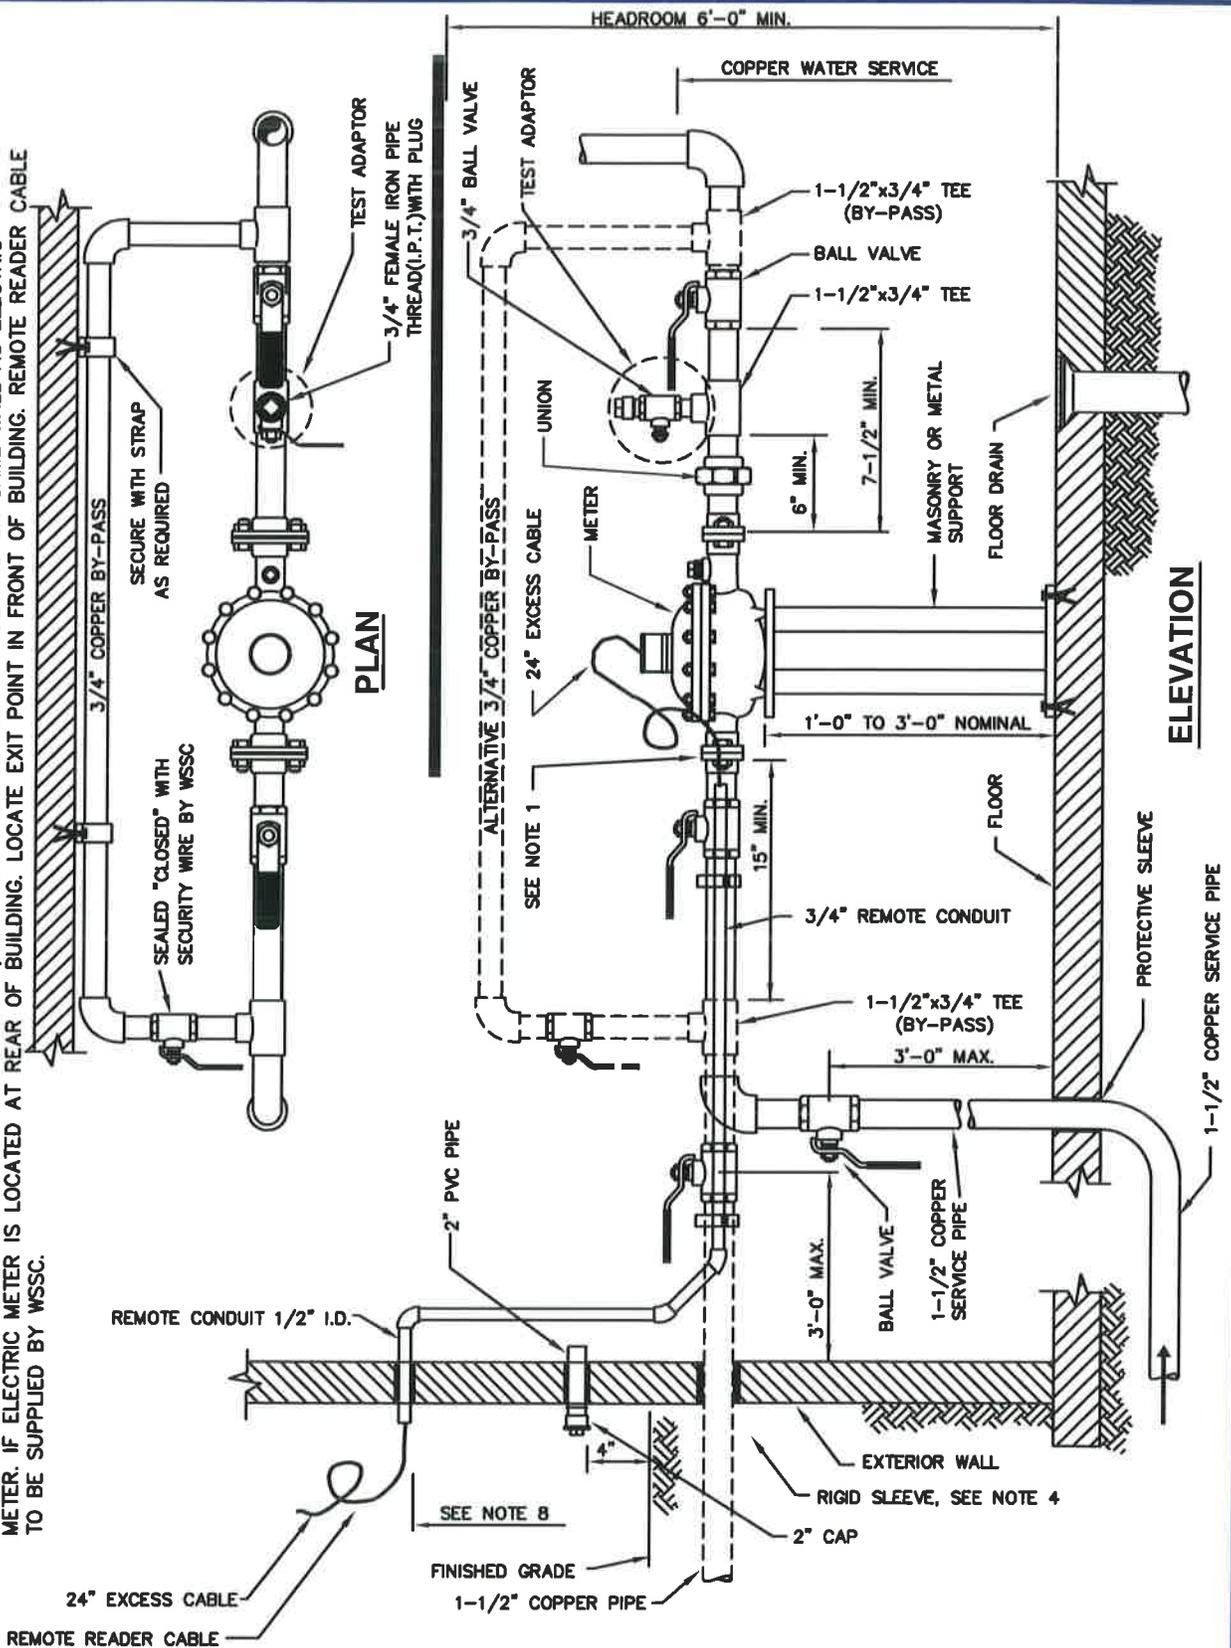

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
1-1/2-INCH INSIDE WATER METER
SETTING WHEN METER
ROOM IS ADJACENT TO
EXTERIOR BUILDING WALLS

W
7.2b

- NOTE:**
1. FLANGE BOLTS SHALL BE READILY ACCESSIBLE.
 2. ALL VALVES SHALL BE BALL TYPE.
 3. METER TO BE SET HORIZONTALLY.
 4. SLEEVE SHALL REST ON 24" OF UNDISTURBED EARTH AND EXTEND THRU THE FOUNDATION WALL.
 5. FOR METER SETTING WHEN METER ROOM IS NOT ADJACENT TO EXTERIOR BUILDING WALLS, SEE DETAIL W/7.3a.
 6. REMOTE READER CONDUIT - NO BENDS GREATER THAN 45°, EXCEPT AS SHOWN.
 7. SECURE REMOTE READER CONDUIT TO WATER SERVICE LINE.
 8. LOCATE EXIT POINT FOR REMOTE READING DEVICE 2'-1/2' TO 4' ABOVE FINISHED GRADE AND ON SAME WALL AS ELECTRIC METER. IF ELECTRIC METER IS LOCATED AT REAR OF BUILDING, LOCATE EXIT POINT IN FRONT OF BUILDING. REMOTE READER CABLE TO BE SUPPLIED BY WSSC.

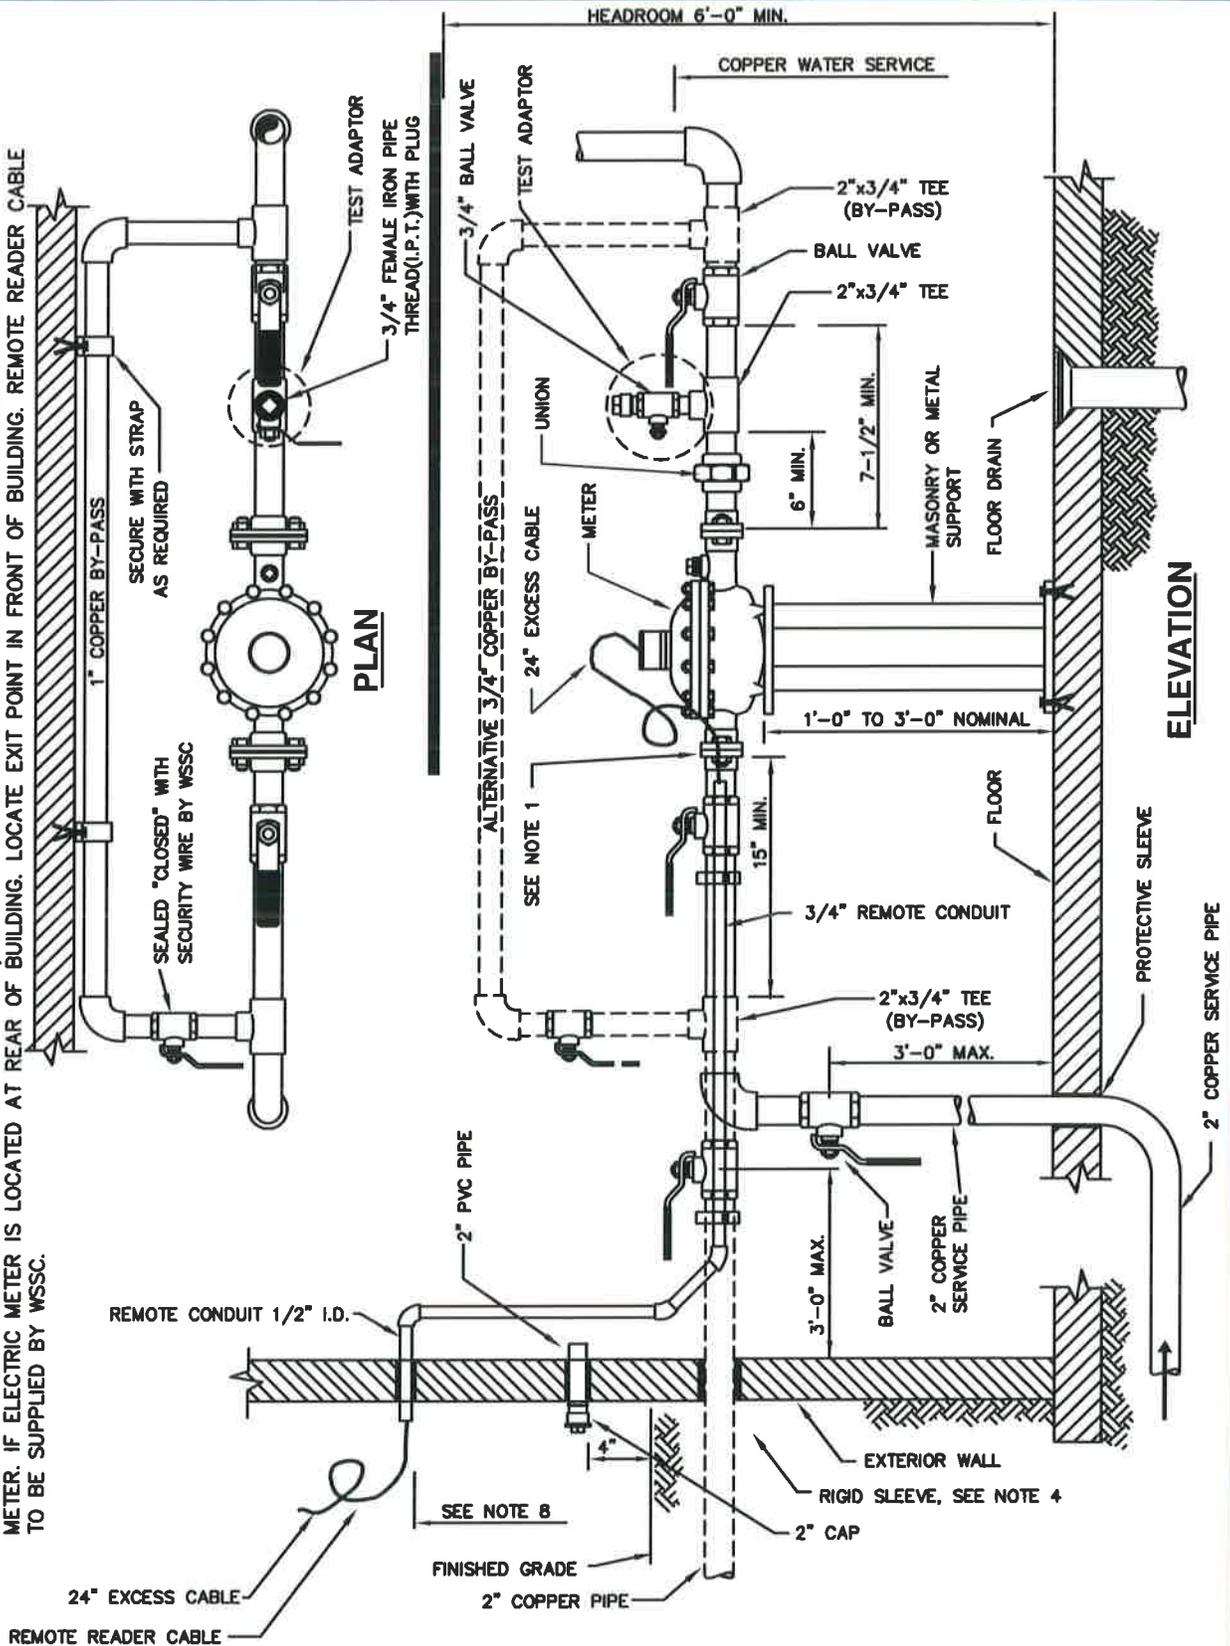


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16


Chief Engineer

STANDARD DETAIL
2-INCH INSIDE WATER METER
SETTING WHEN METER
ROOM IS ADJACENT TO
EXTERIOR BUILDING WALLS

W
7.3b

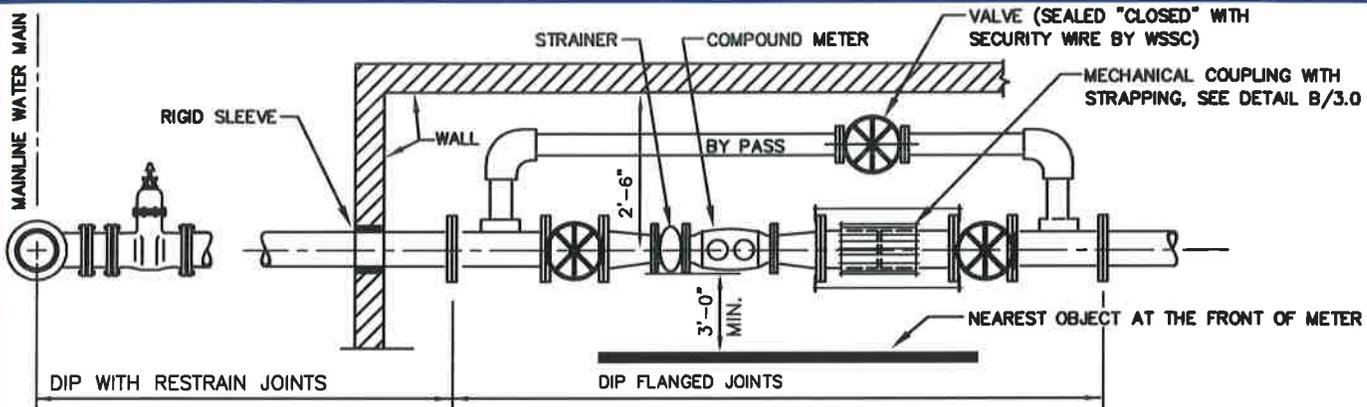

PLAN

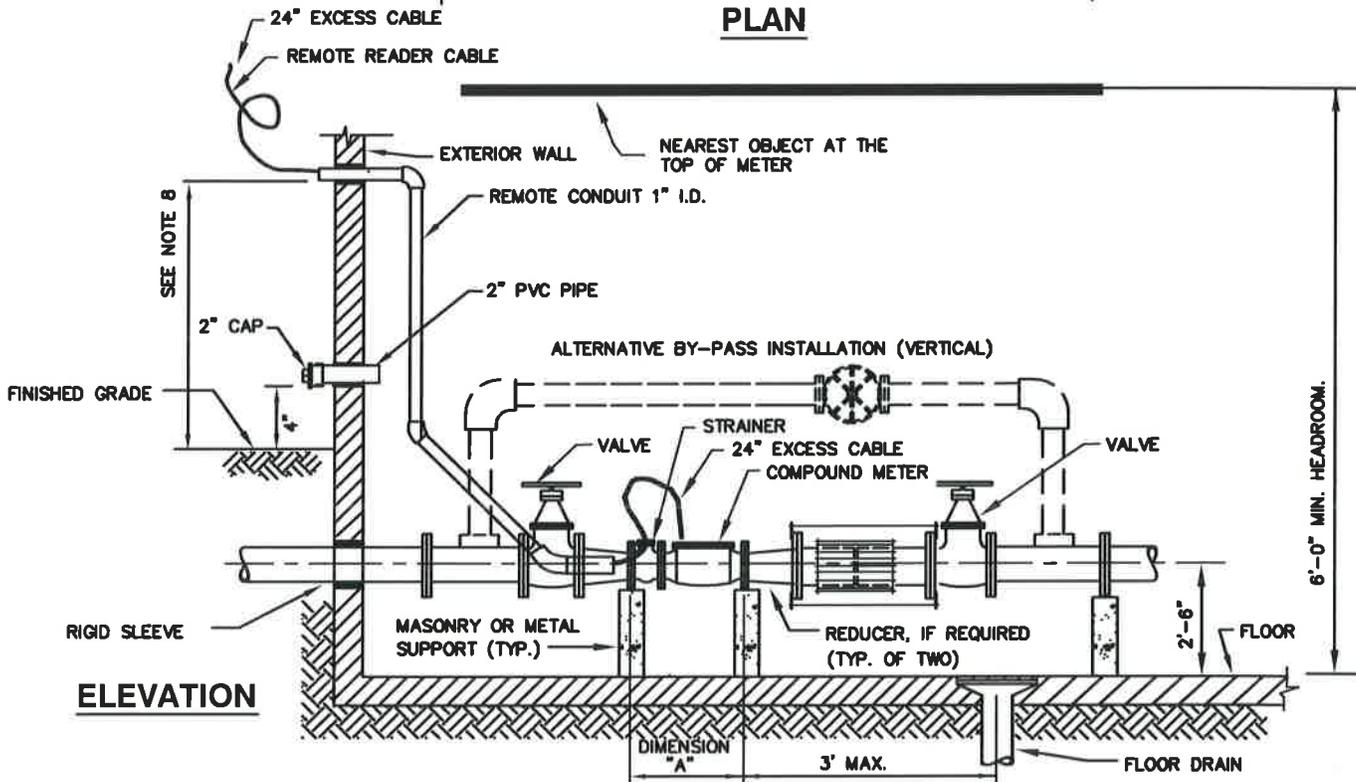

ELEVATION

BY-PIPE SIZE	
COMPOUND METER SIZE	BY-PASS PIPE SIZE
3"	2"
4"	2"
6"	4"

"A" DIMENSION	
COMPOUND METER SIZE	"A" (LENGTH OF METER AND STRAINER)
3"	24"
4"	29"
6"	36.5"

NOTE:

1. FLANGE BOLTS SHALL BE READILY ACCESSIBLE.
2. METER TO BE SET HORIZONTALLY.
3. FOR METER SETTING WHEN METER ROOM IS NOT ADJACENT TO EXTERIOR BUILDING WALLS, SEE DETAIL W/7.5
4. TURBULENCE COMPENSATOR MINIMUM 5 PIPE DIAMETERS INLET AND OUTLET.
5. METER NOT TO BE SET WITHIN 10' OF ELECTRICAL DISTRIBUTION EQUIPMENT.
6. REMOTE READER CONDUIT - NO BENDS GREATER THAN 45°, EXCEPT AS SHOWN.
7. SECURE REMOTE READER CONDUIT TO WATER SERVICE LINE.
8. LOCATE EXIT POINT FOR REMOTE READING DEVICE 2-1/2' TO 4' ABOVE FINISHED GRADE AND ON SAME WALL AS ELECTRIC METER. IF ELECTRIC METER IS LOCATED AT REAR OF BUILDING. LOCATE EXIT POINT IN FRONT OF BUILDING. REMOTE READER CABLE TO BE SUPPLIED BY WSSC.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16


Chief Engineer

STANDARD DETAIL
3-INCH, 4-INCH AND 6-INCH
INDOOR COMPOUND METER
WHEN METER ROOM IS ADJACENT
TO EXTERIOR BUILDING WALLS

W
7.4

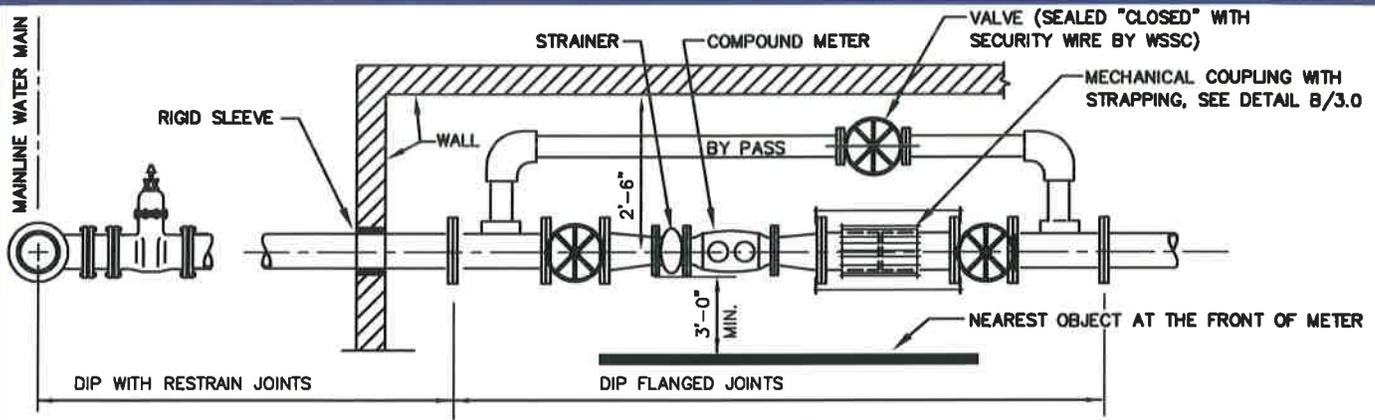

PLAN

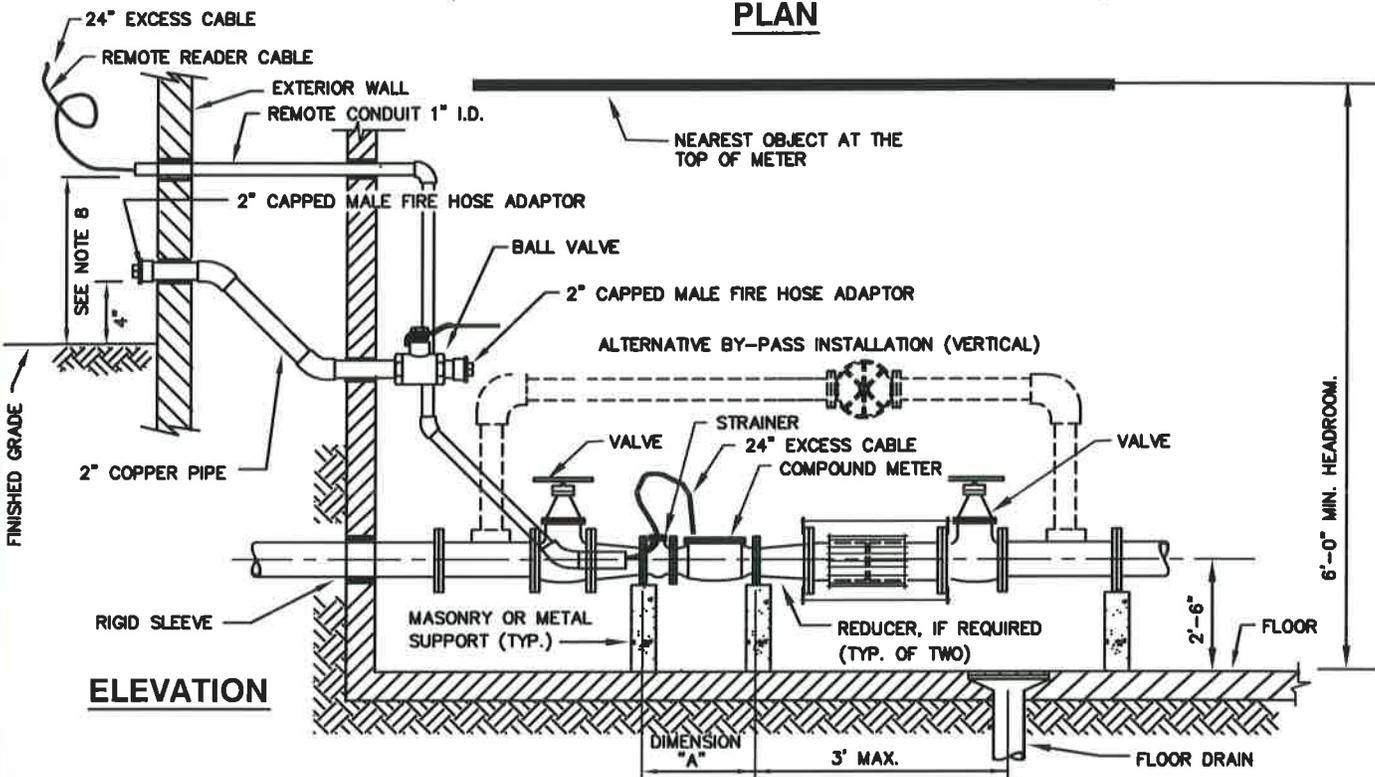

ELEVATION

BY-PIPE SIZE	
COMPOUND METER SIZE	BY-PASS PIPE SIZE
3"	2"
4"	2"
6"	4"

"A" DIMENSION	
COMPOUND METER SIZE	"A" (LENGTH OF METER AND STRAINER)
3"	24"
4"	29"
6"	36.5"

NOTE:

1. FLANGE BOLTS SHALL BE READILY ACCESSIBLE.
2. METER TO BE SET HORIZONTALLY.
3. FOR METER SETTING WHEN METER ROOM IS ADJACENT TO EXTERIOR BUILDING WALLS, SEE DETAIL W/7.4
4. TURBULENCE COMPENSATOR MINIMUM 5 PIPE DIAMETERS INLET AND OUTLET.
5. METER NOT TO BE SET WITHIN 10' OF ELECTRICAL DISTRIBUTION EQUIPMENT.
6. REMOTE READER CONDUIT - NO BENDS GREATER THAN 45°, EXCEPT AS SHOWN.
7. SECURE REMOTE READER CONDUIT TO WATER SERVICE LINE.
8. LOCATE EXIT POINT FOR REMOTE READING DEVICE 2-1/2' TO 4' ABOVE FINISHED GRADE AND ON SAME WALL AS ELECTRIC METER. IF ELECTRIC METER IS LOCATED AT REAR OF BUILDING. LOCATE EXIT POINT IN FRONT OF BUILDING. REMOTE READER CABLE TO BE SUPPLIED BY WSSC.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16


Chief Engineer

STANDARD DETAIL
3-INCH, 4-INCH AND 6-INCH
INDOOR COMPOUND METER WHEN
METER ROOM IS NOT ADJACENT
TO EXTERIOR BUILDING WALLS

W
7.5

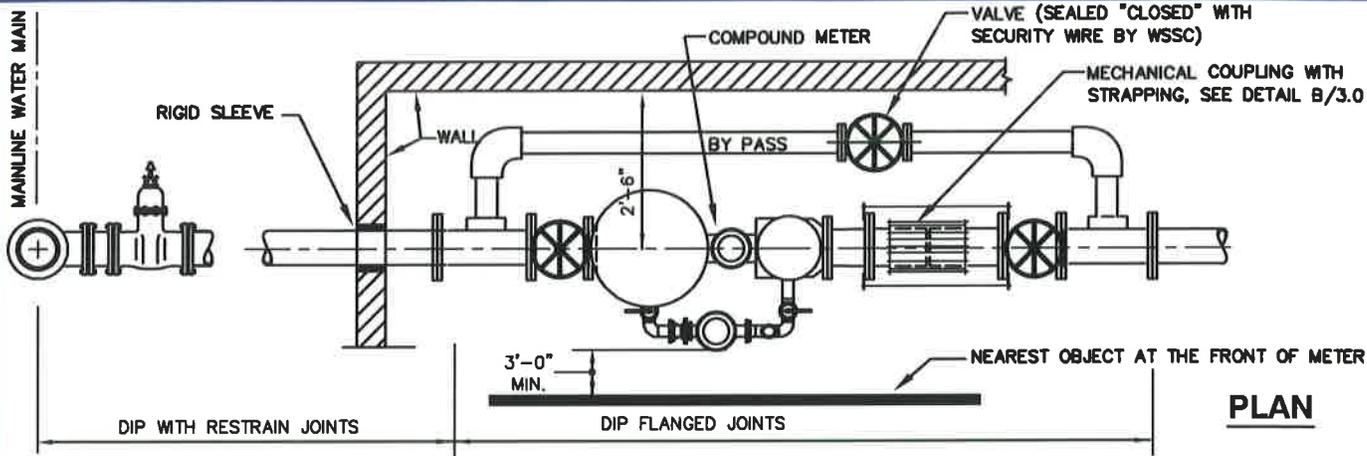

PLAN

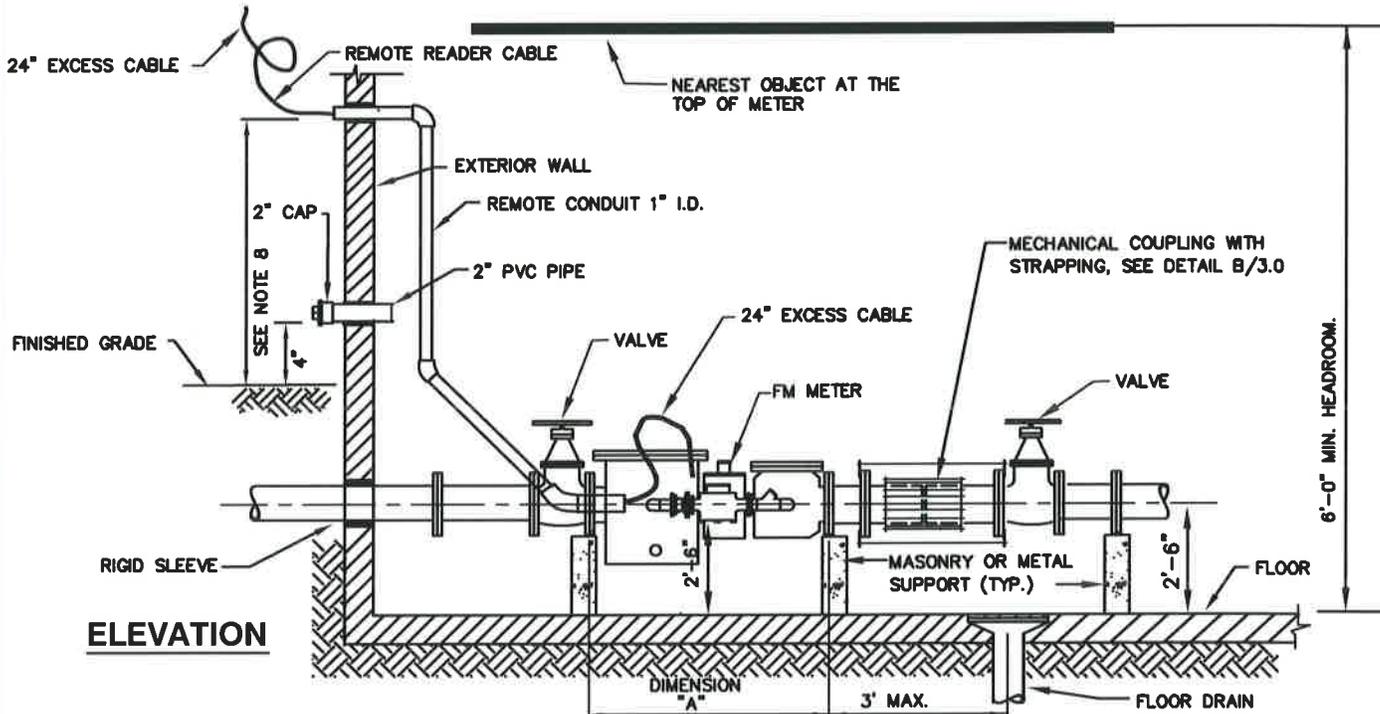

ELEVATION

BY-PIPE SIZE	
FM METER SIZE	BY-PASS PIPE SIZE
4"	4"
6"	6"
8"	8"

"A" DIMENSION	
FM METER SIZE	"A" (LENGTH OF METER)
4"	33"
6"	45"
8"	53"

NOTE:

1. FLANGE BOLTS SHALL BE READILY ACCESSIBLE.
2. METER TO BE SET HORIZONTALLY.
3. FOR METER SETTING WHEN METER ROOM IS NOT ADJACENT TO EXTERIOR BUILDING WALLS, SEE DETAIL W/7.7
4. TURBULENCE COMPENSATOR MINIMUM 5 PIPE DIAMETERS INLET AND OUTLET.
5. METER NOT TO BE SET WITHIN 10' OF ELECTRICAL DISTRIBUTION EQUIPMENT.
6. REMOTE READER CONDUIT - NO BENDS GREATER THAN 45°, EXCEPT AS SHOWN.
7. SECURE REMOTE READER CONDUIT TO WATER SERVICE LINE.
8. LOCATE EXIT POINT FOR REMOTE READING DEVICE 2-1/2' TO 4' ABOVE FINISHED GRADE AND ON SAME WALL AS ELECTRIC METER. IF ELECTRIC METER IS LOCATED AT REAR OF BUILDING. LOCATE EXIT POINT IN FRONT OF BUILDING. REMOTE READER CABLE TO BE SUPPLIED BY WSSC.



WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
4-INCH, 6-INCH AND 8-INCH
INDOOR FM METER WHEN
METER ROOM IS ADJACENT TO
EXTERIOR BUILDING WALLS

W
7.6

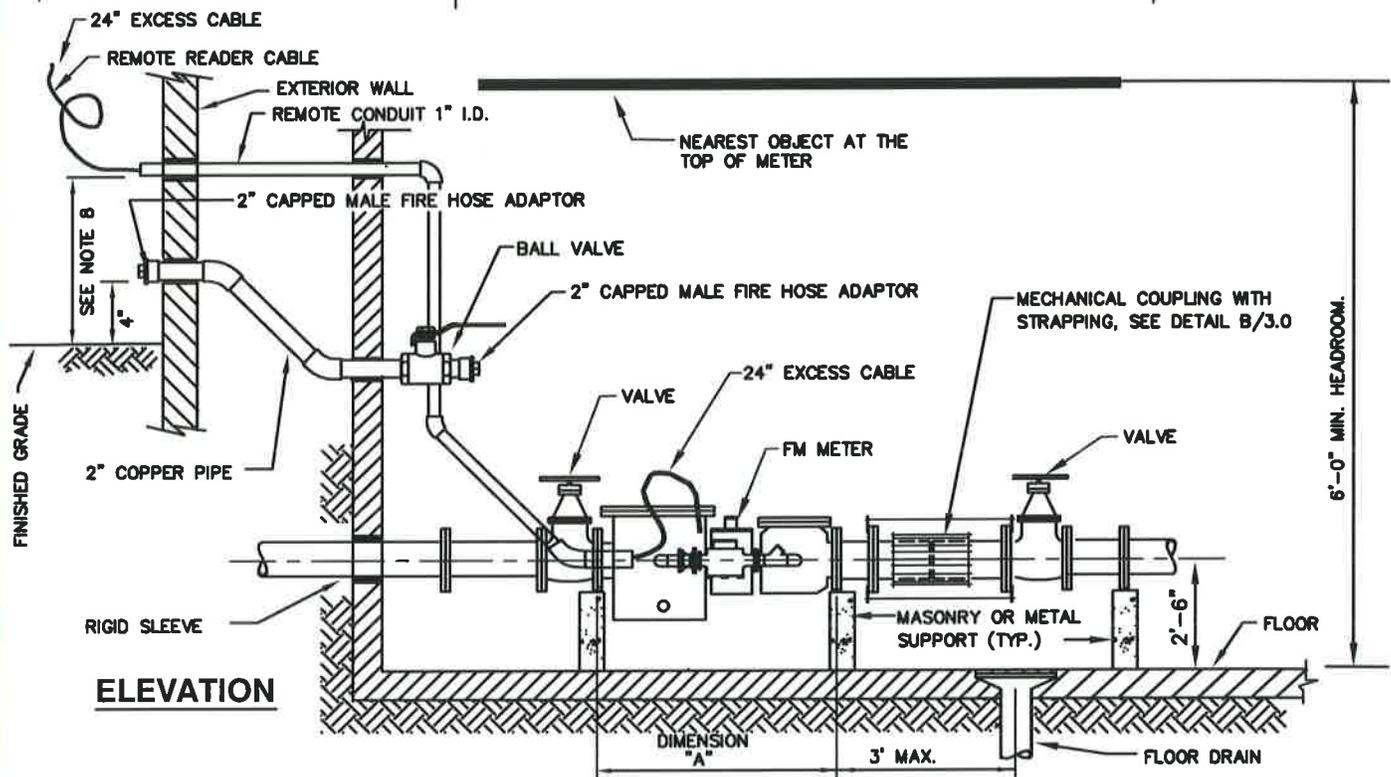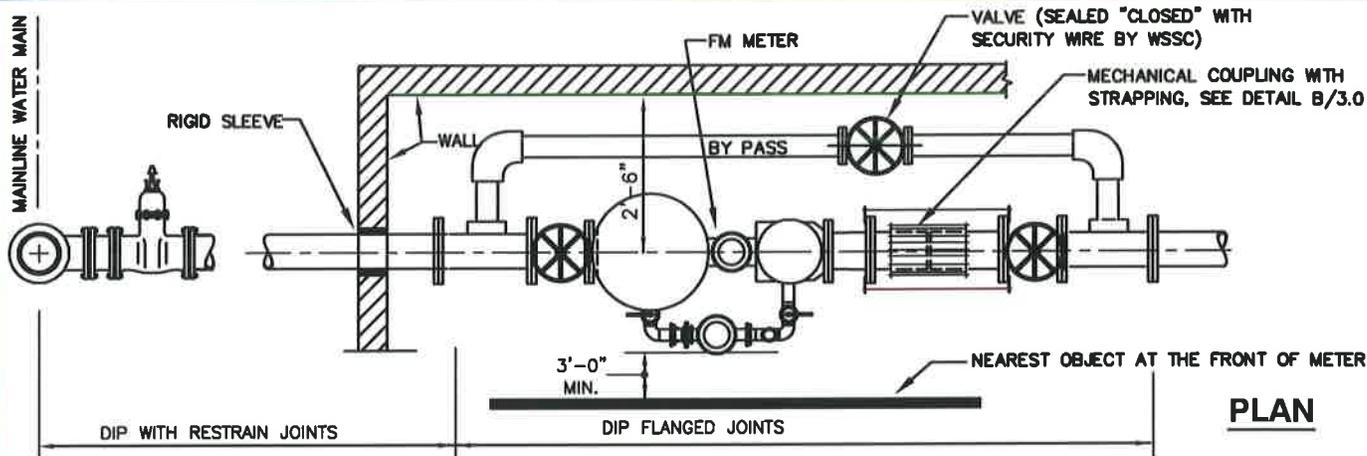

BY-PIPE SIZE	
FM METER SIZE	BY-PASS PIPE SIZE
4"	4"
6"	6"
8"	8"

"A" DIMENSION	
FM METER SIZE	"A" (LENGTH OF METER)
4"	33"
6"	45"
8"	53"

- NOTE:**
1. FLANGE BOLTS SHALL BE READILY ACCESSIBLE.
 2. METER TO BE SET HORIZONTALLY.
 3. FOR METER SETTING WHEN METER ROOM IS ADJACENT TO EXTERIOR BUILDING WALLS, SEE DETAIL W/7.6
 4. TURBULENCE COMPENSATOR MINIMUM 5 PIPE DIAMETERS INLET AND OUTLET.
 5. METER NOT TO BE SET WITHIN 10' OF ELECTRICAL DISTRIBUTION EQUIPMENT.
 6. REMOTE READER CONDUIT - NO BENDS GREATER THAN 45°, EXCEPT AS SHOWN.
 7. SECURE REMOTE READER CONDUIT TO WATER SERVICE LINE.
 8. LOCATE EXIT POINT FOR REMOTE READING DEVICE 2-1/2' TO 4' ABOVE FINISHED GRADE AND ON SAME WALL AS ELECTRIC METER. IF ELECTRIC METER IS LOCATED AT REAR OF BUILDING. LOCATE EXIT POINT IN FRONT OF BUILDING. REMOTE READER CABLE TO BE SUPPLIED BY WSSC.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
4-INCH, 6-INCH AND 8-INCH
INDOOR FM METER WHEN
METER ROOM IS NOT ADJACENT
TO EXTERIOR BUILDING WALLS

W
7.7

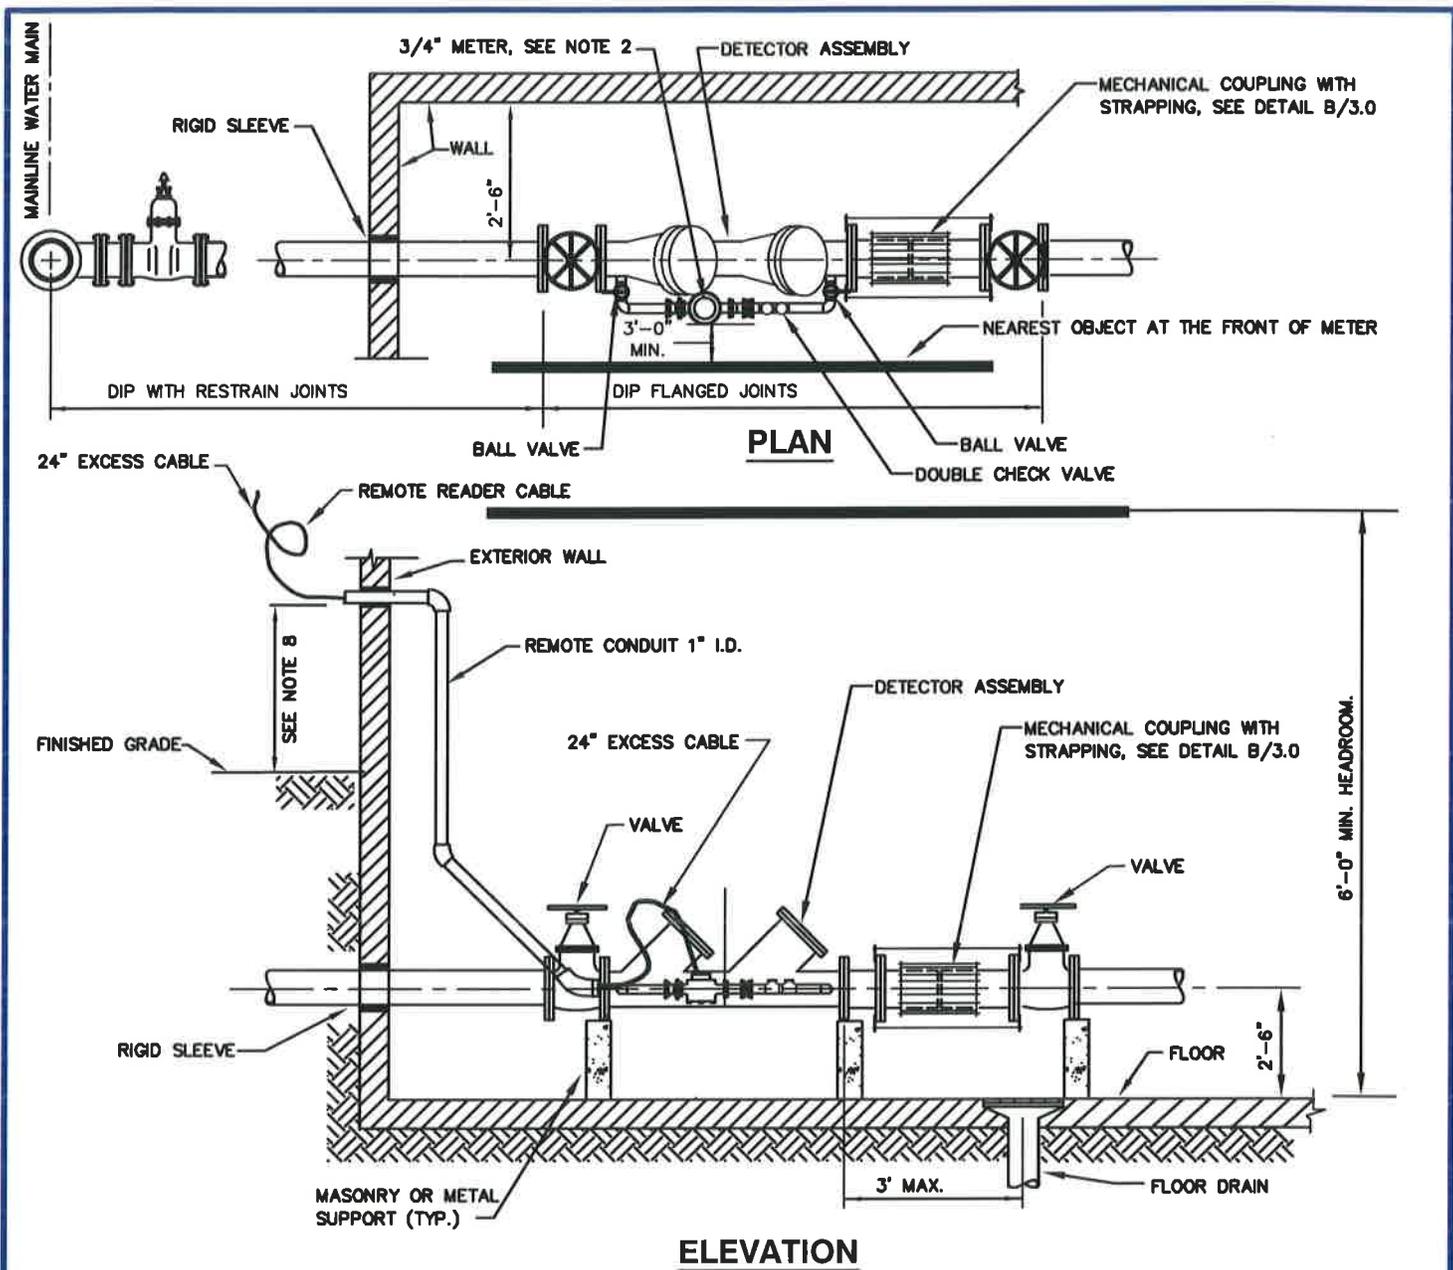

NOTE:

1. DETECTOR ASSEMBLY SHALL BE A REDUCED PRESSURE DETECTOR OR DOUBLE CHECK DETECTOR ASSEMBLY.
2. 3/4" METER TO BE SUPPLIED BY WSSC. 3/4" METER TO BE SET HORIZONTALLY.
3. FOR DETECTOR ASSEMBLY SETTING WHEN METER ROOM IS NOT ADJACENT TO EXTERIOR BUILDING WALLS, SEE DETAIL W/7.9
4. ALL 3/4" PIPE AND FITTINGS SHALL BE COPPER.
5. METER NOT TO BE SET WITHIN 10' OF ELECTRICAL DISTRIBUTION EQUIPMENT.
6. REMOTE READER CONDUIT - NO BENDS GREATER THAN 45, EXCEPT AS SHOWN.
7. SECURE REMOTE READER CONDUIT TO WATER SERVICE LINE.
8. LOCATE EXIT POINT FOR REMOTE READING DEVICE 2-1/2' TO 4' ABOVE FINISHED GRADE AND ON SAME WALL AS ELECTRIC METER. IF ELECTRIC METER IS LOCATED AT REAR OF BUILDING. LOCATE EXIT POINT IN FRONT OF BUILDING. REMOTE READER CABLE TO BE SUPPLIED BY WSSC.
9. FLANGE BOLTS SHALL BE READILY ACCESSIBLE.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
3-INCH AND LARGER
INDOOR DETECTOR ASSEMBLY
WHEN METER ROOM IS ADJACENT
TO EXTERIOR BUILDING WALLS

W
7.8

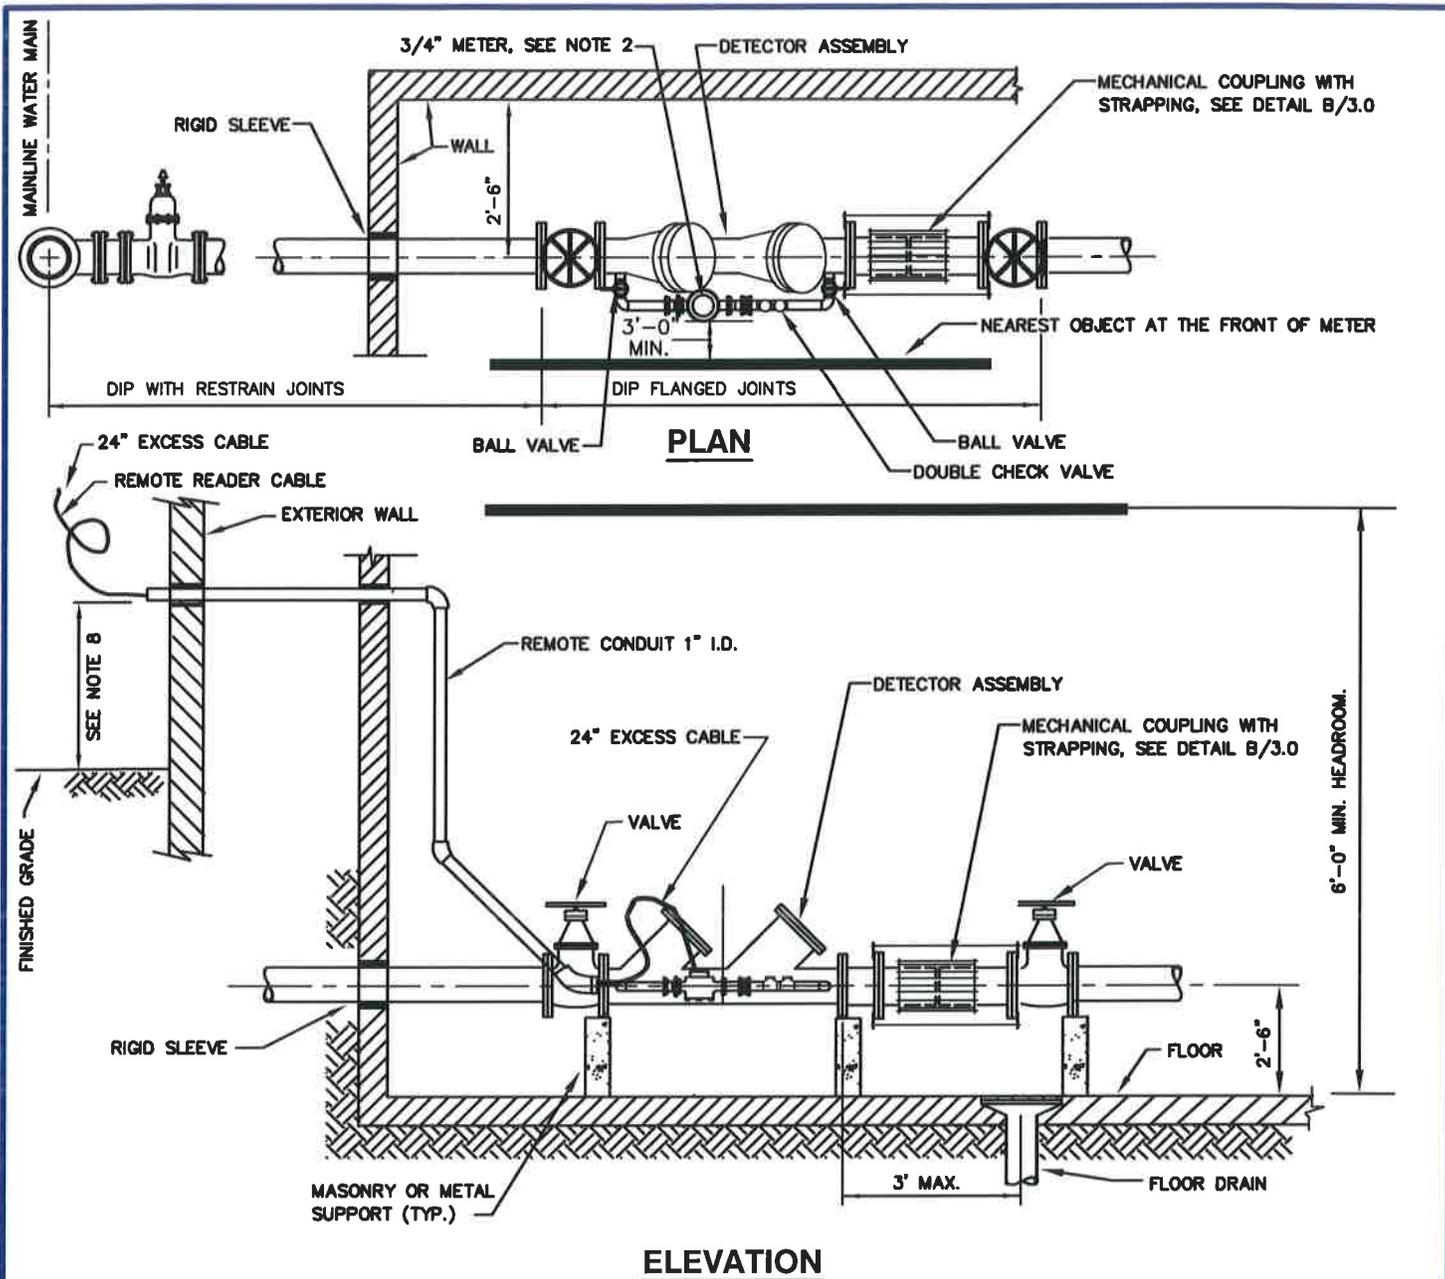

NOTE:

1. DETECTOR ASSEMBLY SHALL BE A REDUCED PRESSURE DETECTOR OR DOUBLE CHECK DETECTOR ASSEMBLY.
2. 3/4" METER TO BE SUPPLIED BY WSSC. 3/4" METER TO BE SET HORIZONTALLY.
3. FOR DETECTOR ASSEMBLY SETTING WHEN METER ROOM IS ADJACENT TO EXTERIOR BUILDING WALLS, SEE DETAIL W/7.8.
4. ALL 3/4" PIPE AND FITTINGS SHALL BE COPPER.
5. METER NOT TO BE SET WITHIN 10' OF ELECTRICAL DISTRIBUTION EQUIPMENT.
6. REMOTE READER CONDUIT - NO BENDS GREATER THAN 45, EXCEPT AS SHOWN.
7. SECURE REMOTE READER CONDUIT TO WATER SERVICE LINE.
8. LOCATE EXIT POINT FOR REMOTE READING DEVICE 2-1/2' TO 4' ABOVE FINISHED GRADE AND ON SAME WALL AS ELECTRIC METER. IF ELECTRIC METER IS LOCATED AT REAR OF BUILDING. LOCATE EXIT POINT IN FRONT OF BUILDING. REMOTE READER CABLE TO BE SUPPLIED BY WSSC.
9. FLANGE BOLTS SHALL BE READILY ACCESSIBLE.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
3-INCH AND LARGER INDOOR
DETECTOR ASSEMBLY WHEN
METER ROOM IS NOT ADJACENT
TO EXTERIOR BUILDING WALLS

W
7.9

TYPE OF HYDRANT	H (IN.)	
	MIN.	MAX.
U.S. PIPE AND FOUNDRY CO.	18	24
MUELLER COMPANY	18	24
KENNEDY VALVE	17 1/4	23 1/4
AMERICAN FLOW CONTROL	14	20

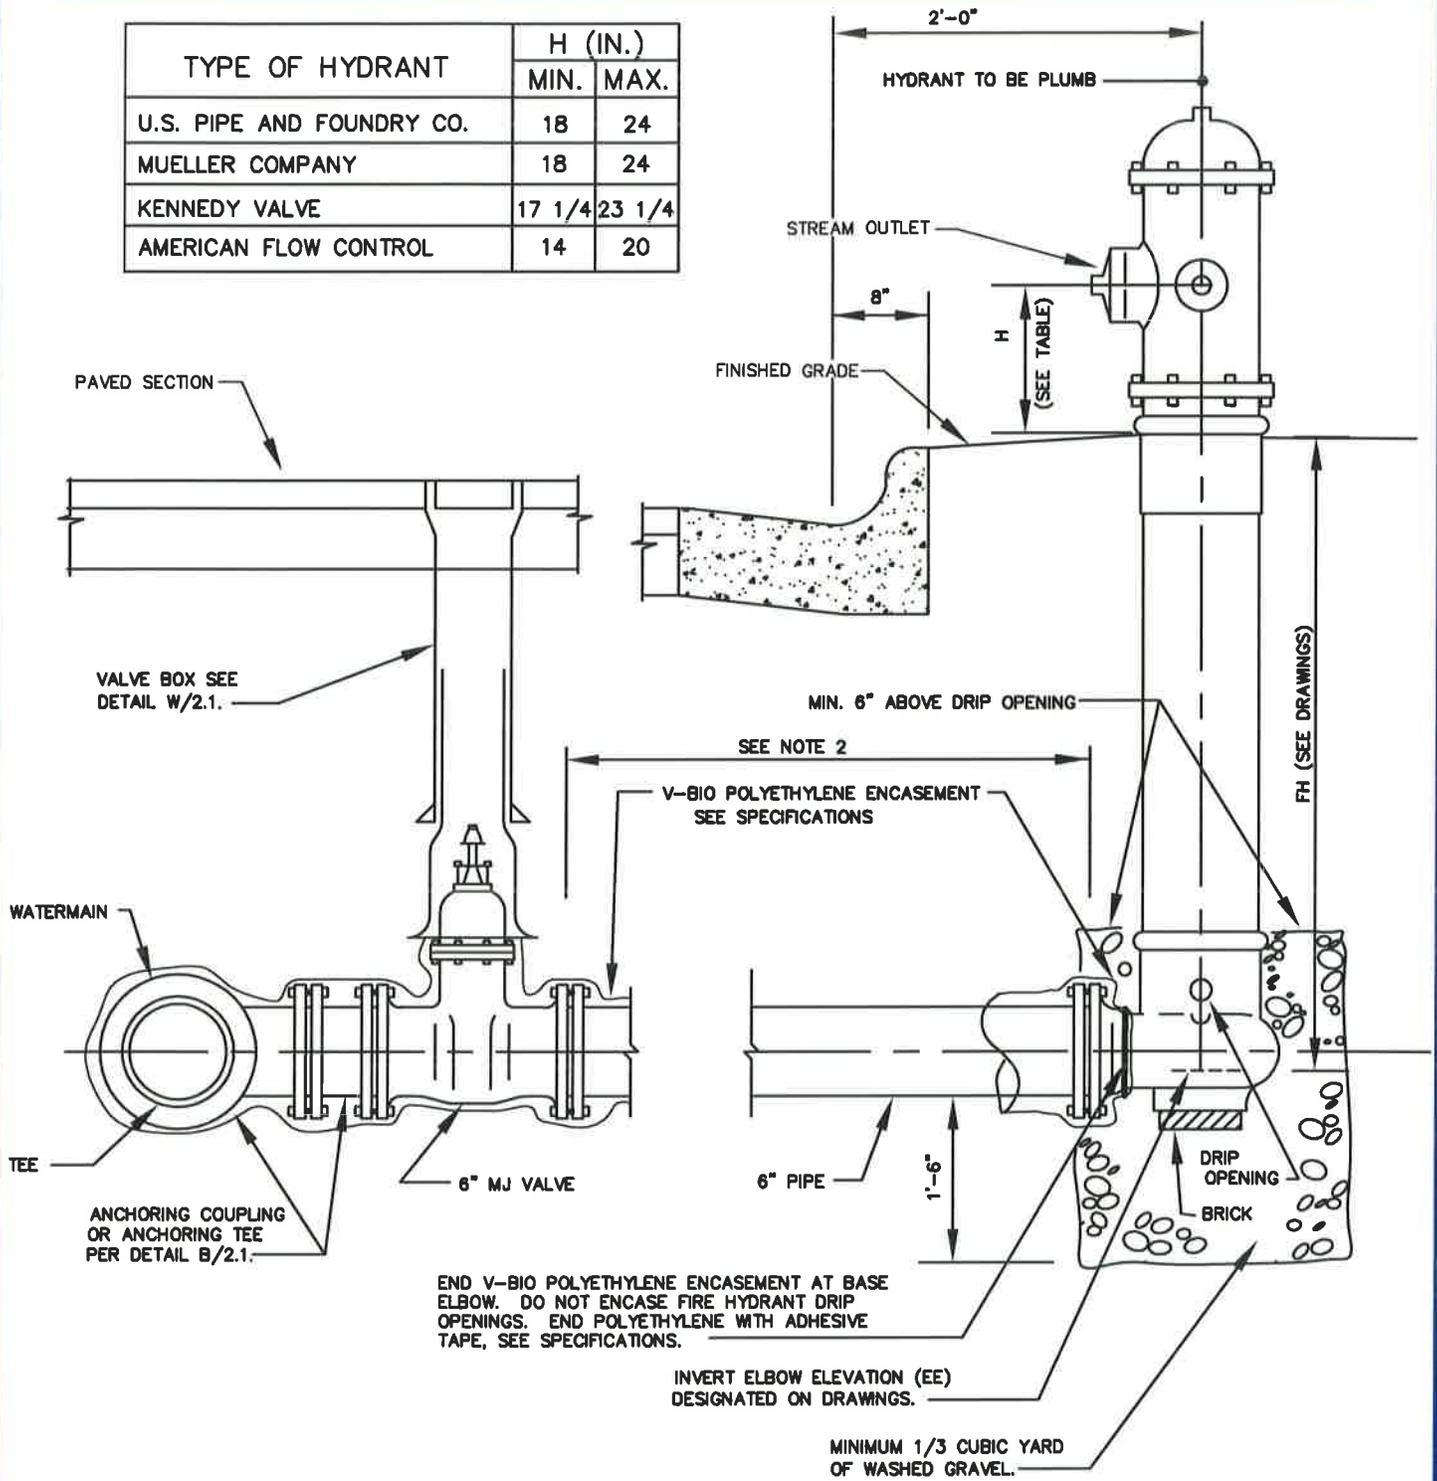

NOTES:

1. DO NOT BLOCK FIRE HYDRANT OR FIRE HYDRANT TEE.
2. FOR RESTRAINING VALVE TO FIRE HYDRANT, SEE DETAIL B/2.1.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
**FIRE HYDRANT SETTING
CLOSED PAVING SECTION**

W
8.0

TYPE OF HYDRANT	H (IN.)	
	MIN.	MAX.
U.S. PIPE AND FOUNDRY CO.	18	24
MUELLER COMPANY	18	24
KENNEDY VALVE	17 1/4	23 1/4
AMERICAN FLOW CONTROL	14	20

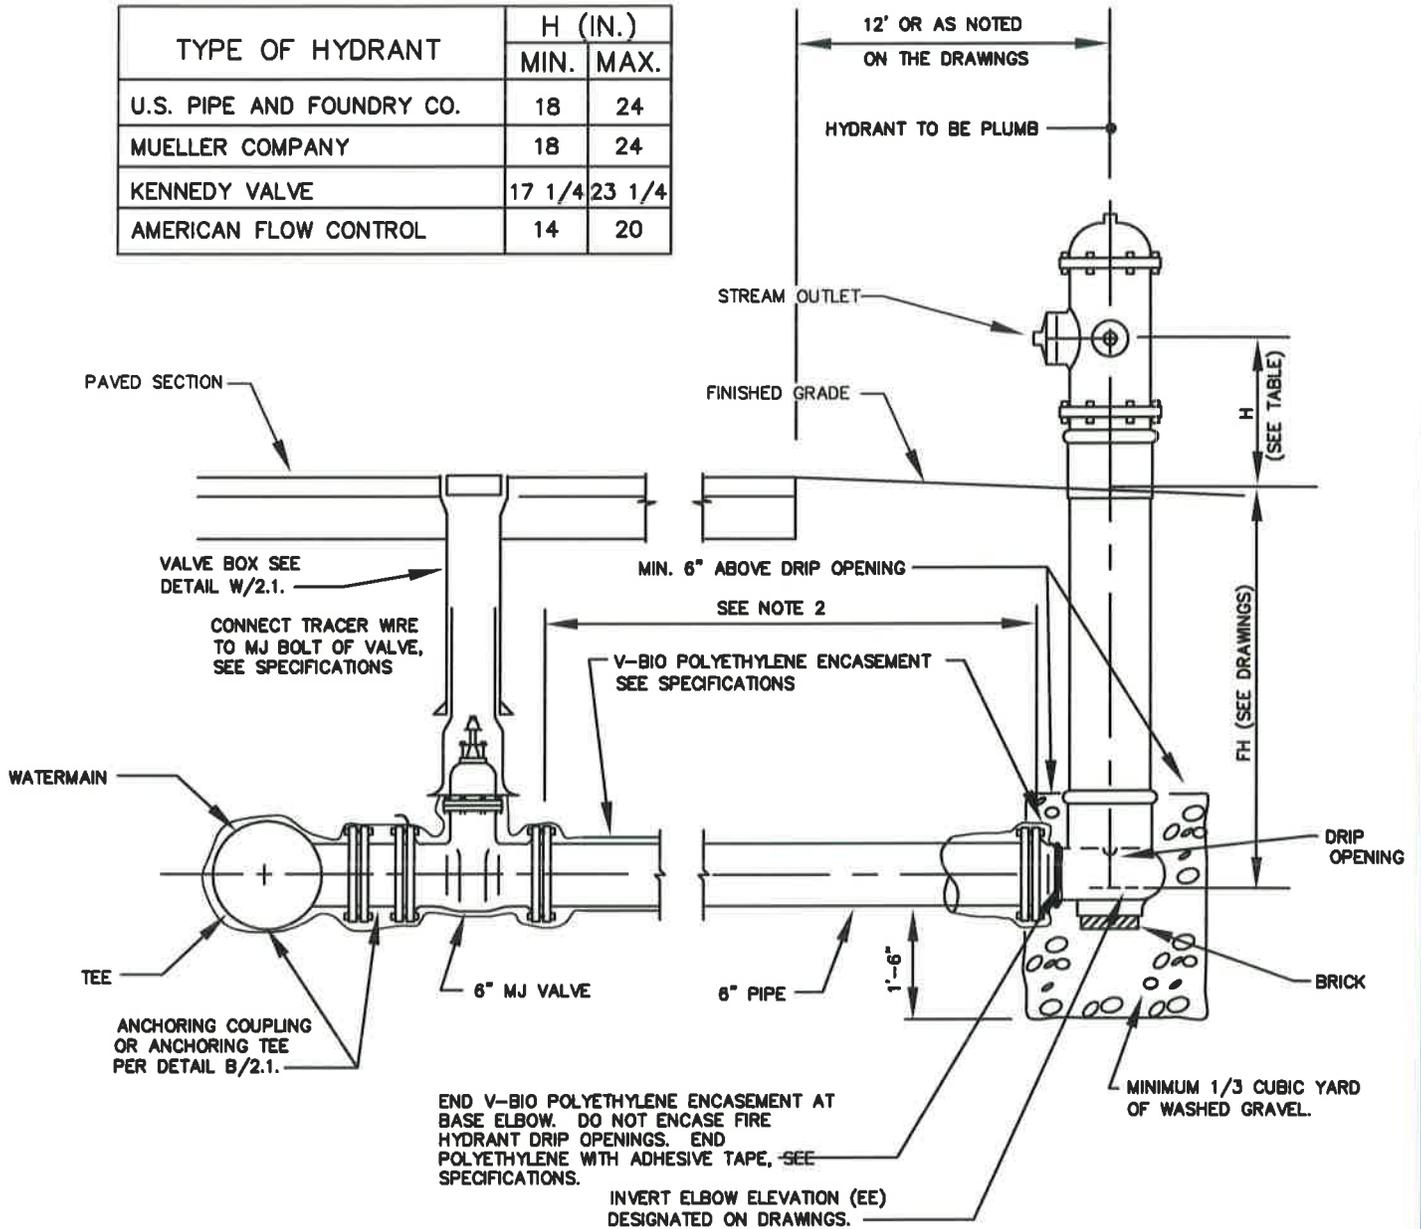

NOTES:

1. DO NOT BLOCK FIRE HYDRANT OR FIRE HYDRANT TEE.
2. FOR RESTRAINING VALVE TO FIRE HYDRANT, SEE DETAIL B/2.1.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

Chief Engineer

STANDARD DETAIL
FIRE HYDRANT SETTING
OPEN PAVING SECTION

W
8.1

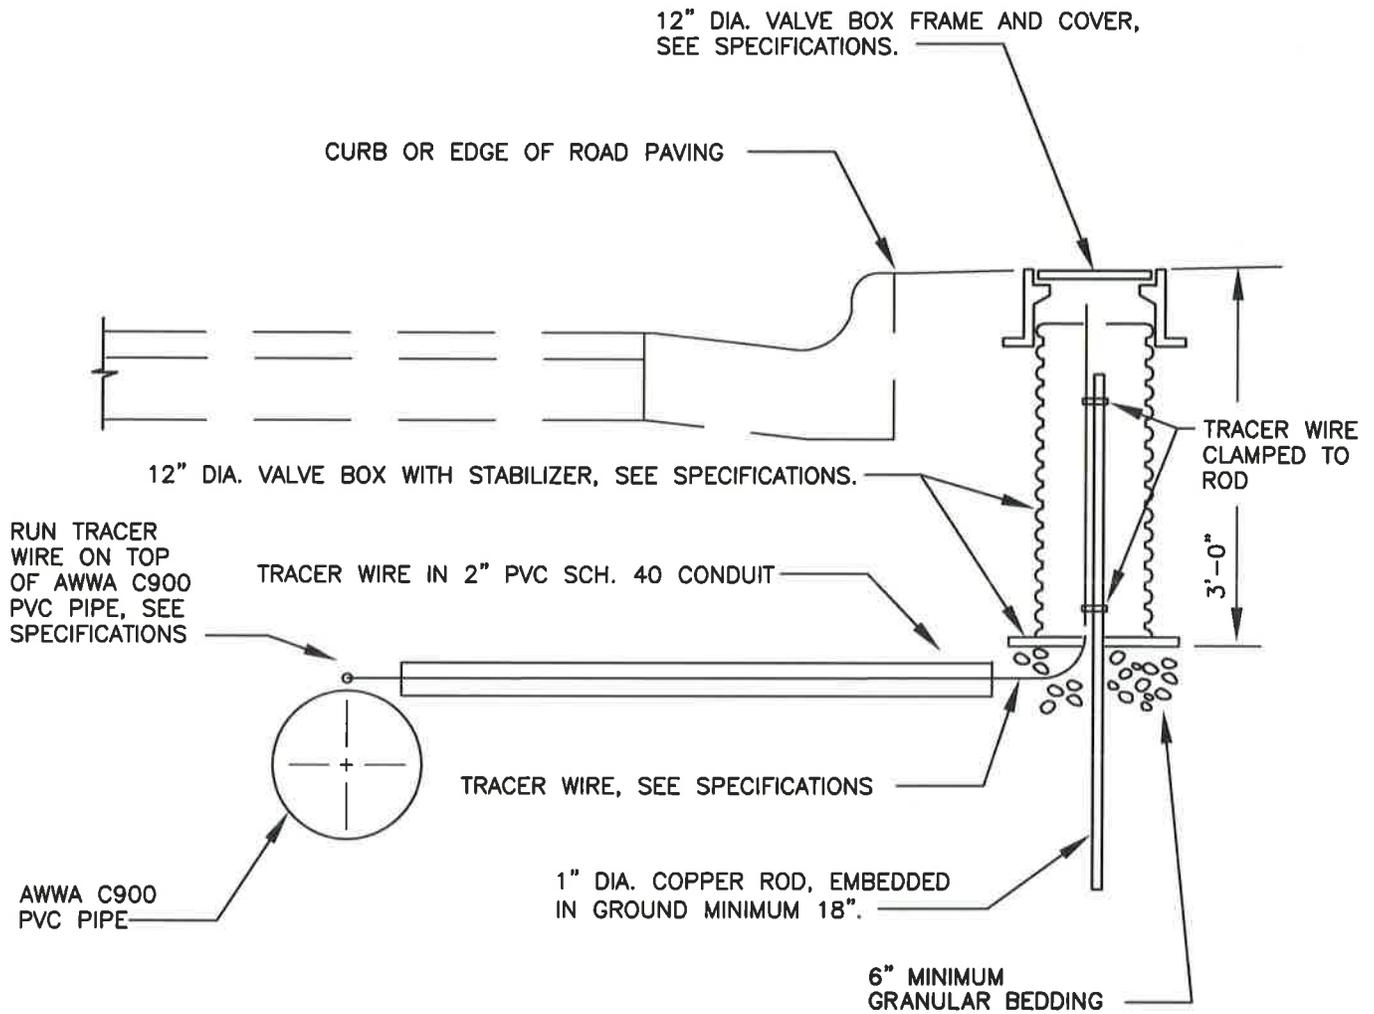

NOTE:

1. INSTALL TRACER WIRE IN 2" PVC SCH. 40 PVC WHEN NOT INSTALLED ON TOP OF PIPELINE.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: _____


9/28/16

Chief Engineer


STANDARD DETAIL

CONTINUITY TEST STATION
FOR AWWA C900 PVC PIPE

W
9.0

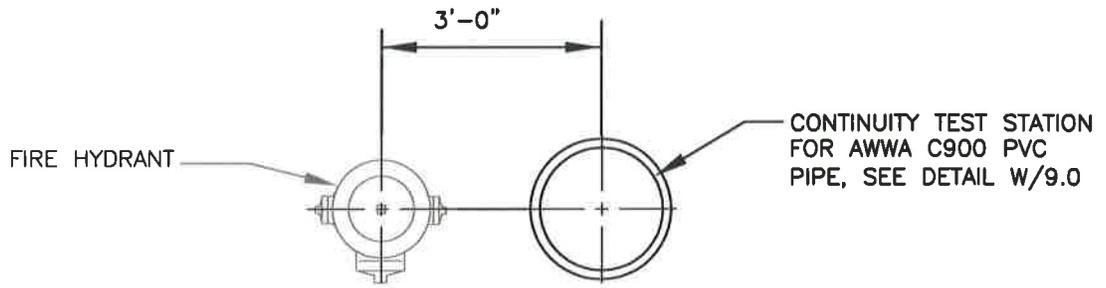


PLAN

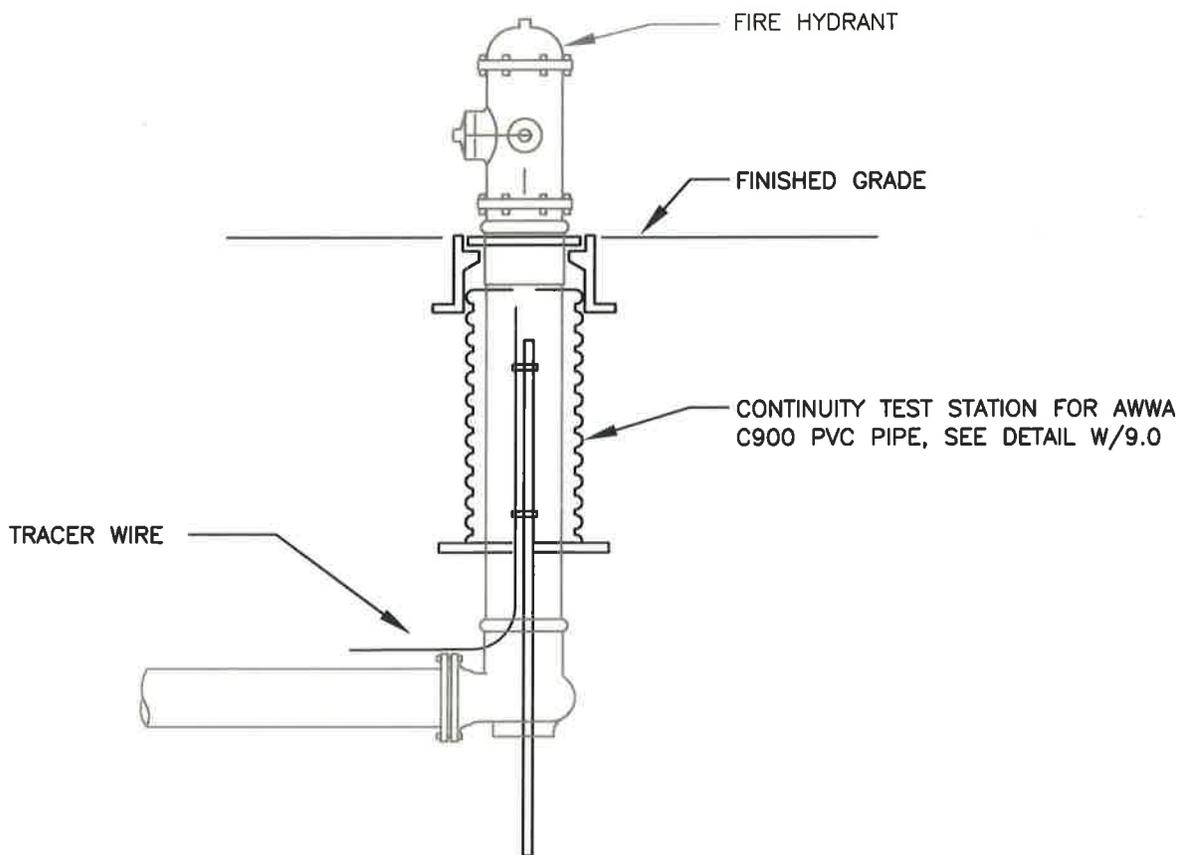


ELEVATION


WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/28/16</u>  Chief Engineer	STANDARD DETAIL CONTINITY TEST STATION FOR AWWA C900 PVC PIPE AT FIRE HYDRANT LOCATION	$\frac{W}{9.1}$
--	---	---	-----------------

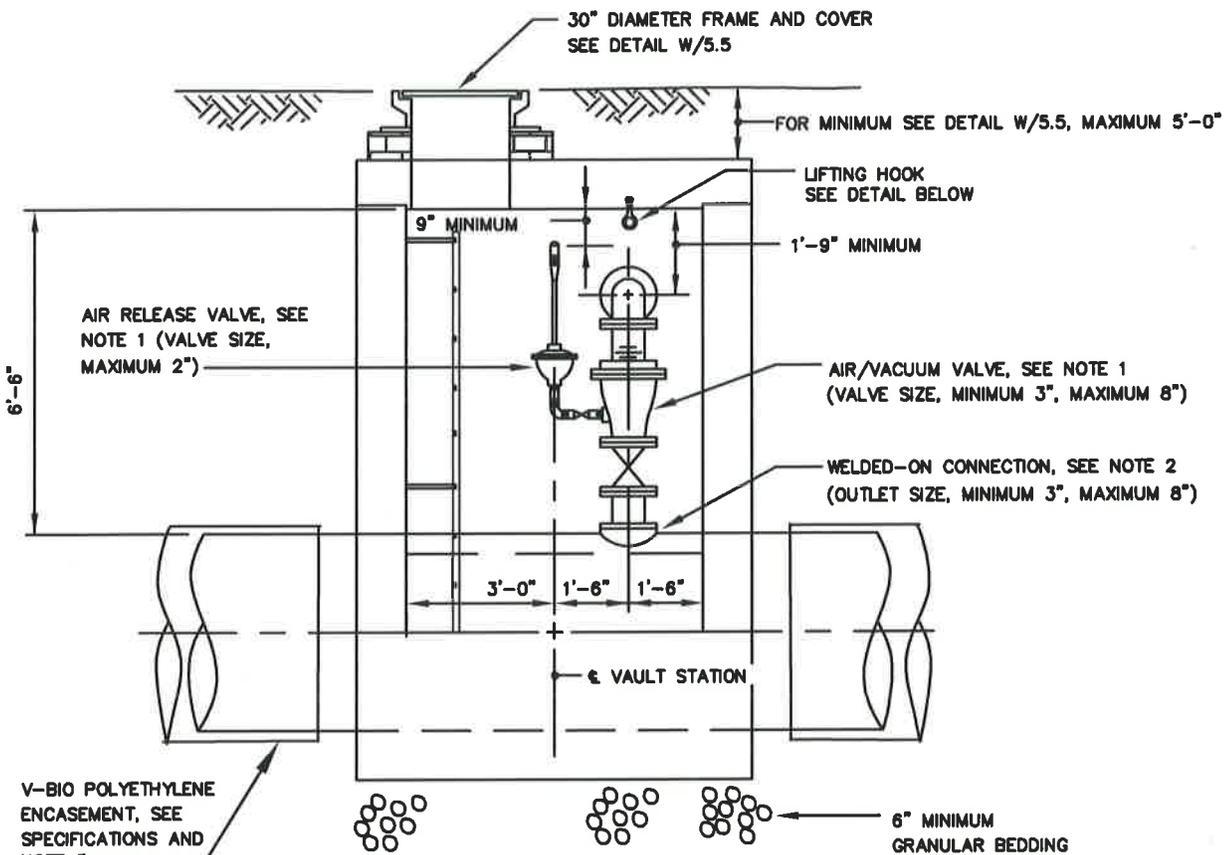

SECTION

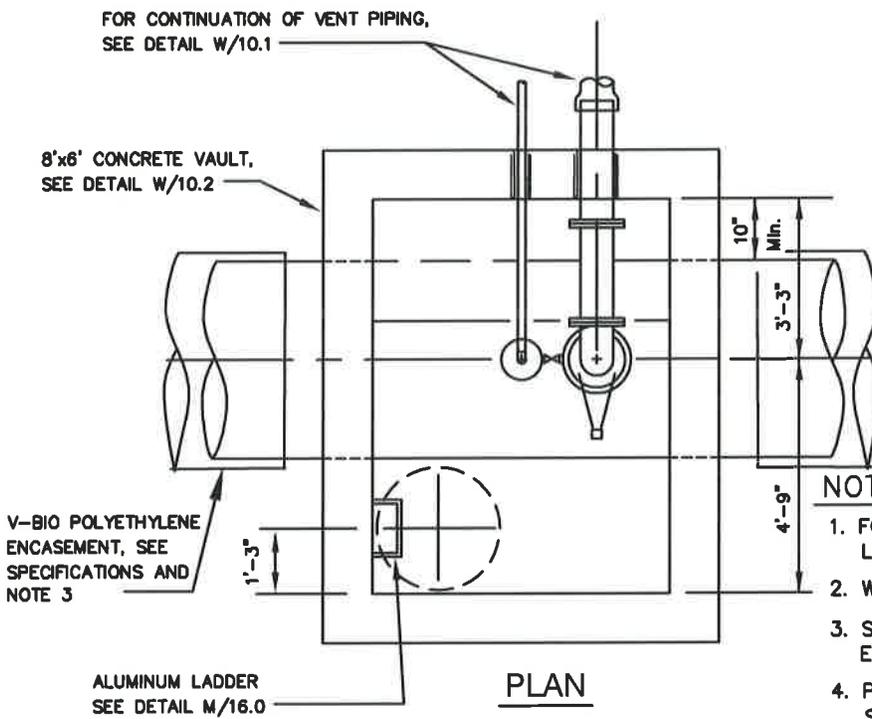

PLAN

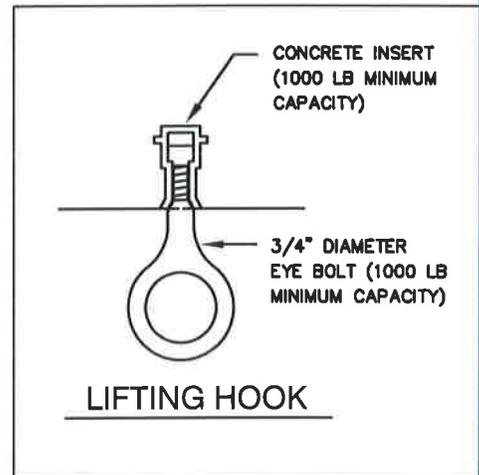

NOTES:

1. FOR VALVE AND PIPING SIZES AND LAYOUT, SEE DETAIL W/10.1
2. WELDED-ON CONNECTION, DETAIL W/10.1
3. SEE DETAIL W/2.8 FOR V-BIO POLYETHYLENE ENCASUREMENT AT CONCRETE INTERFACE.
4. PROVIDE RUBBER ANNUAL HYDROSTATIC SEALING DEVICES FOR PIPE THROUGH WALL CONNECTIONS, SEE SPECIFICATIONS.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: 9/29/16

Chief Engineer

STANDARD DETAIL

AIR/VACUUM VALVE VAULT
ON 30-INCH DIAMETER
AND LARGER PIPES

W
10.0

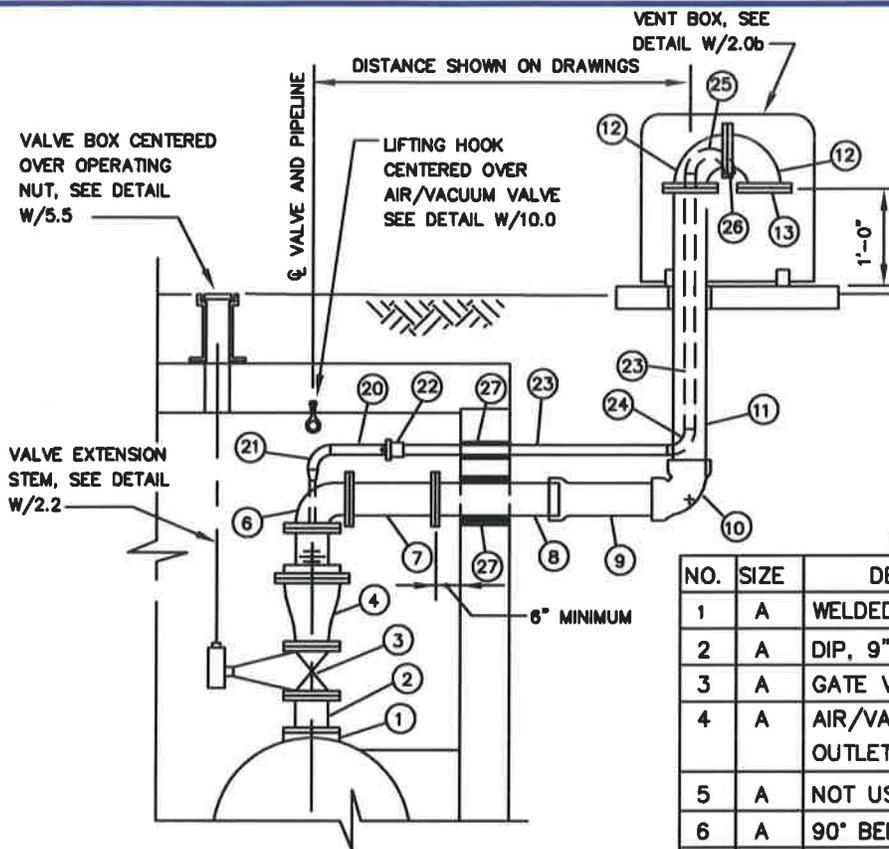


NOTES:

1. SEE DRAWING FOR:
 - a. VALVE "A" MODEL NUMBER AND TYPE OF FLANGE (ANSI B16.1, CLASS 125 OR CLASS 250) FOR AIR/VACUUM VALVES
 - b. VALVE "B" MODEL NUMBER, OUTLET AND ORIFICE SIZES FOR AIR RELEASE VALVES.
 - c. MATERIAL LIST SIZES "A" AND "B" (SIZE "A", MINIMUM 3", MAXIMUM 8") (SIZE "B", MAXIMUM 2")
2. SEE SPECIFICATIONS FOR WELDED-ON CONNECTIONS (BOSSES OR OUTLETS) (OUTLET SIZE, MINIMUM 3", MAXIMUM 8")
3. MATERIAL LIST NUMBER 2 (9" DIP, FLGxFLG) IS REQUIRED ONLY FOR WELDED-ON BOSSES.

MATERIAL LIST

NO.	SIZE	DESCRIPTION	JOINT
1	A	WELDED-ON CONNECTION, SEE NOTE 2	FLG
2	A	DIP, 9" LONG, SEE NOTE 3	FLGxFLG
3	A	GATE VALVE WITH BEVEL GEARING	FLG
4	A	AIR/VACUUM VALVE WITH FLANGE OUTLET, SEE NOTE 1.a	FLG
5	A	NOT USED	
6	A	90° BEND	FLG
7	A	DIP, LENGTH VARIES	FLGxFLG
8	A	DIP, LENGTH VARIES	FLGxPE
9	A	DIP	BELLxPE
10	A	90° BEND	BELL
11	A	DIP, LENGTH VARIES	FLGxPE
12	A	90° BEND	FLG
13	-	1/2" SQ.-12GA. STAINLESS STEEL BIRD SCREEN WITH FLANGE	-
14	B	BRASS NIPPLE	NPT
15	B	BRASS GATE VALVE WITH HAND WHEEL	NPT
16	B	90° BRASS ELBOW	NPT
17	B	PRESSURE AIR RELEASE VALVE, SEE NOTE 1.b	NPT
18	1/2"	BRASS PIPE	NPT
19	2"x1/2"	BRASS REDUCER	NPT
20	2"	BRASS NIPPLE	NPT
21	2"	90° BRASS ELBOW	NPT
22	2"	UNION, BRASSxPVC	NPT
23	2"	PVC PIPE, SCH 40, SOLVENT WELDED	-
24	2"	PVC 90° BEND, SOLVENT WELDED	-
25	2"	PVC 180° BEND, SOLVENT WELDED	-
26	-	BIRD SCREEN, SEE DETAIL W/2.0b	-
27	-	RUBBER ANNUAL HYDROSTATIC SEALING DEVICE, SEE SPECIFICATIONS	-

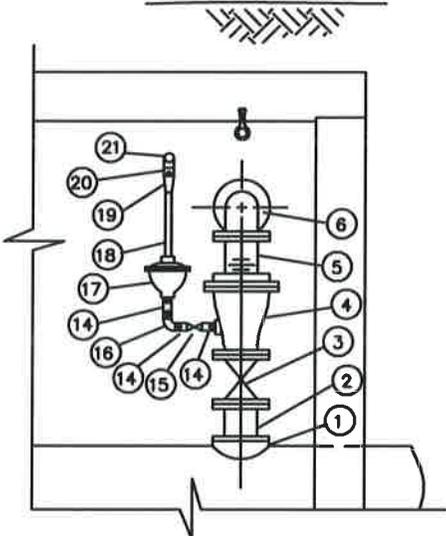


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/29/16

Chief Engineer


STANDARD DETAIL
DETAILS FOR
AIR/VACUUM VALVE VAULT
ON 30-INCH DIAMETER
AND LARGER PIPES


W
10.1

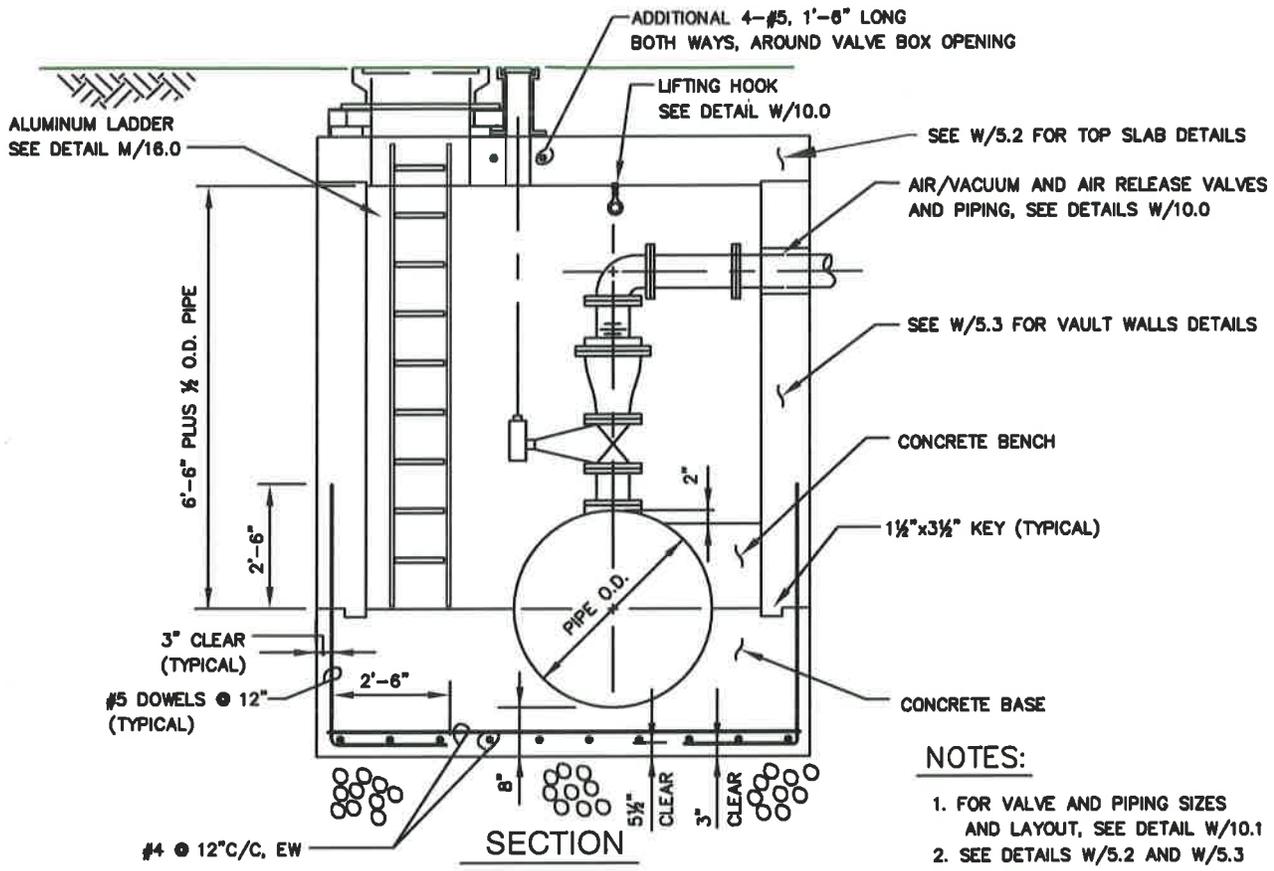


NOTES:

1. FOR VALVE AND PIPING SIZES AND LAYOUT, SEE DETAIL W/10.1
2. SEE DETAILS W/5.2 AND W/5.3 ADDITIONAL INFORMATION.
3. CONTRACTOR MAY USE PRECAST VAULT. SEE SPECIFICATIONS FOR SUBMITTAL REQUIREMENTS
4. PROVIDE RUBBER ANNUAL HYDROSTATIC SEALING DEVICES FOR PIPE THROUGH WALL CONNECTIONS, SEE SPECIFICATIONS.
5. SEE DETAIL W/2.8 FOR V-BIO POLYETHYLENE ENCASMENT AT CONCRETE INTERFACE.

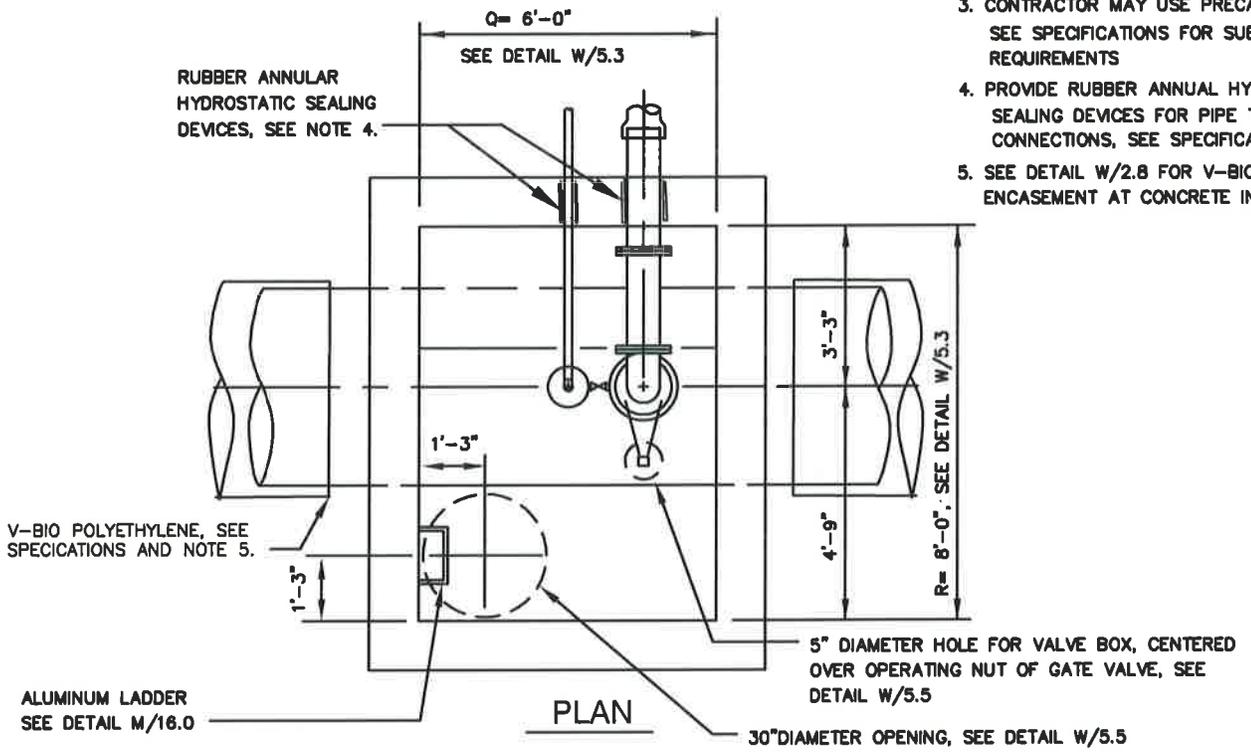


WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/29/16</u>  Chief Engineer	STANDARD DETAIL AIR/VACUUM VALVE VAULT ON 30" DIAMETER AND LARGER PIPES	$\frac{W}{10.2}$
--	---	--	------------------

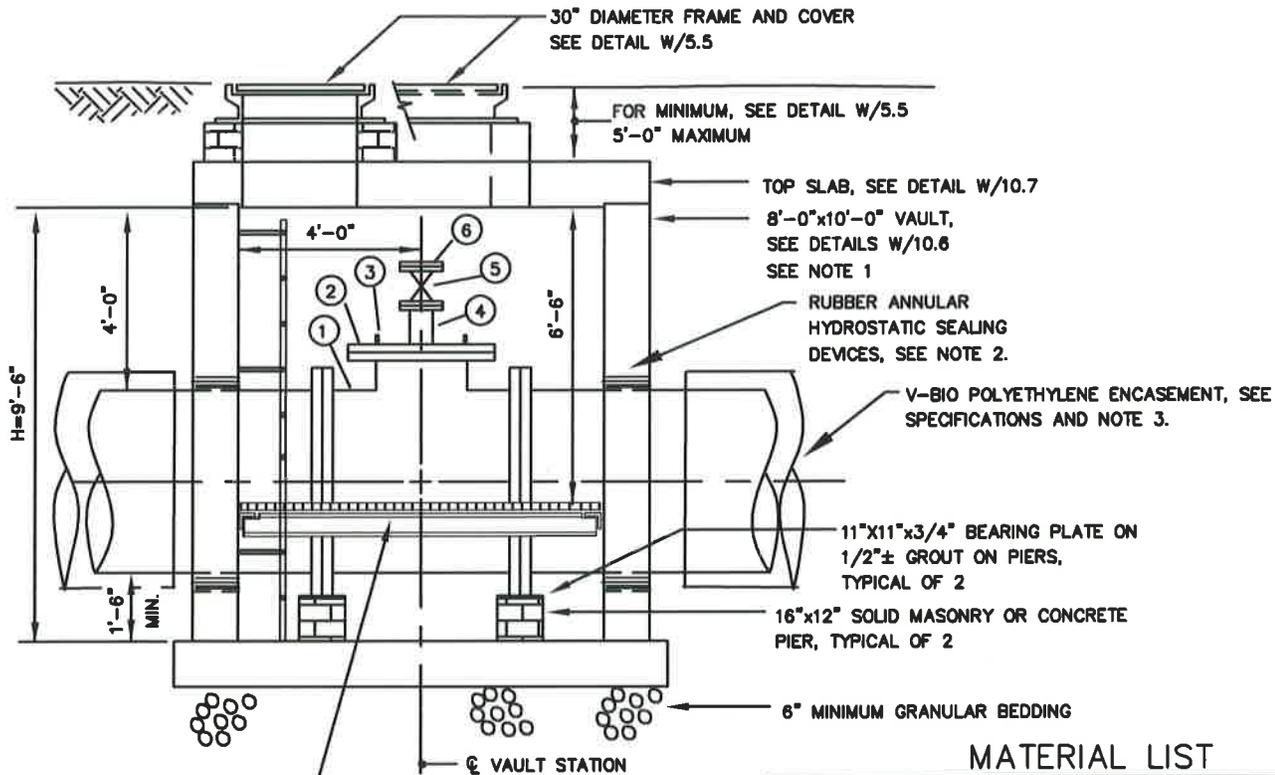

PLATFORM GRATING,
SEE DETAIL M/22.0

MATERIAL LIST

NO.	SIZE	DESCRIPTION	JOINT
1	-	TEE (30" OUTLET)	FLG
2	30"	STEEL BLIND FLANGE, AWWA C207, CLASS E WITH 4" OUTLET PIPE SEE DETAIL W/10.4	FLG
3	-	LIFTING HOOKS, SEE DETAIL W/10.4	-
4	4"	STEEL PIPE SCHEDULE 40, SEE DETAIL W/10.4	FLG
5	4"	GATE VALVE WITH HANDWHEEL CLASS 125	FLG
6	4"	STEEL BLIND FLANGE, AWWA C207, CLASS E	FLG

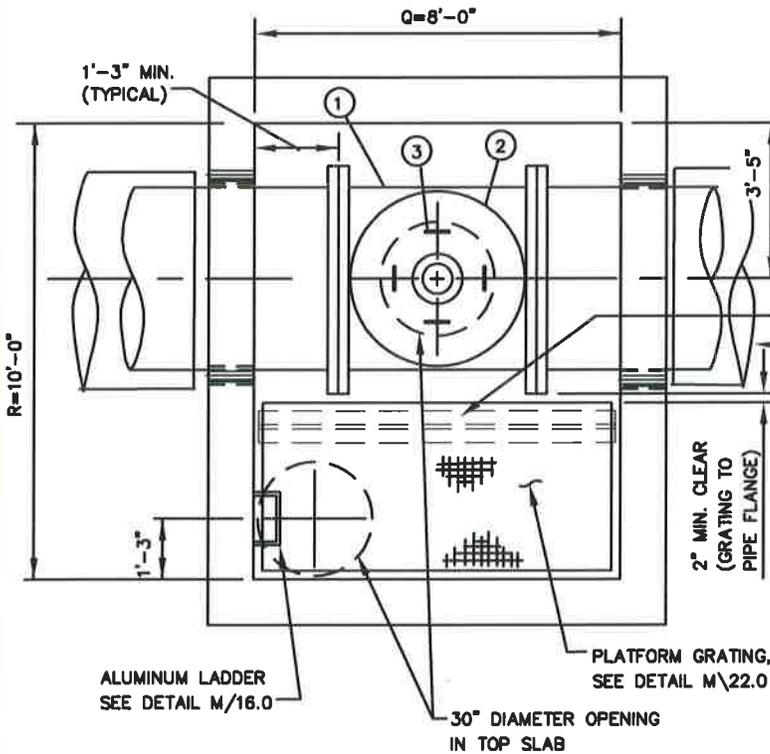

ALUMINUM BEAM, SEE DETAIL M22.0

V-BIO POLYETHYLENE ENCASUREMENT, SEE
SPECIFICATIONS AND NOTE 3.

NOTE:

1. CONTRACTOR MAY USE PRECAST VAULT.
SEE SPECIFICATIONS FOR SUBMITTAL
REQUIREMENTS
2. PROVIDE RUBBER ANNUAL HYDROSTATIC
SEALING DEVICES FOR PIPE THROUGH WALL
CONNECTIONS, SEE SPECIFICATIONS.
3. SEE DETAIL W/2.8 FOR V-BIO POLYETHYLENE
ENCASUREMENT AT CONCRETE INTERFACE.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:

9/29/16

Chief Engineer


STANDARD DETAIL

ENTRY PORT VAULT
FOR 36" TO 48"
DIAMETER PIPES


W
10.3

NOTE:


1. SEE AWWA C207, FOR METHOD OF ATTACHMENT FOR RING FLANGE TO OUTLET PIPE.

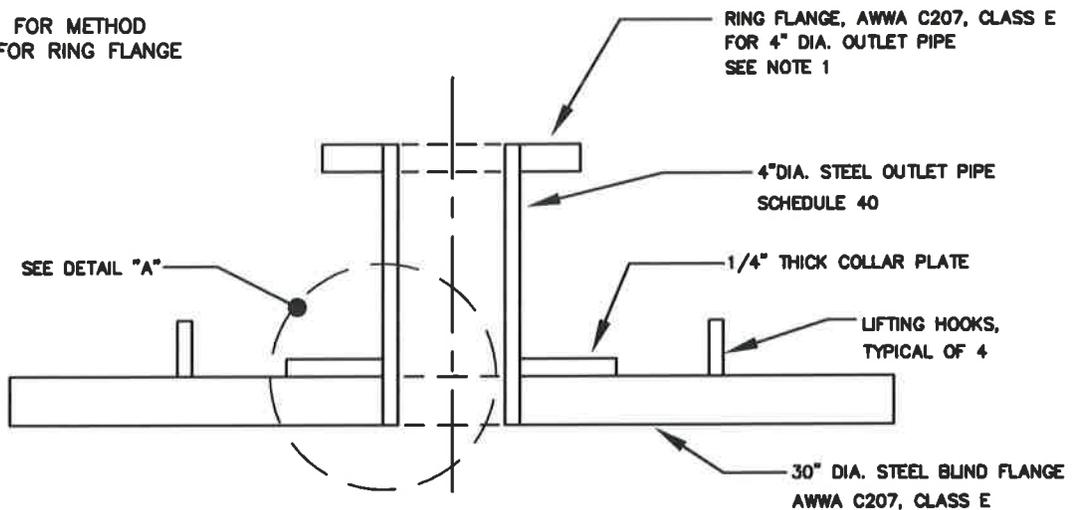


DETAIL OF ENTRY PORT BLIND FLANGE WITH 4" OUTLET

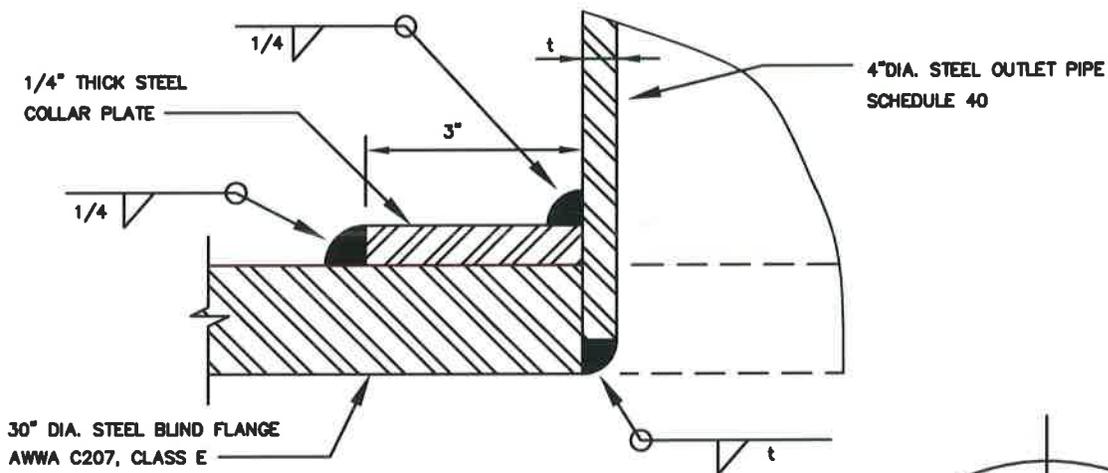

DETAIL "A"

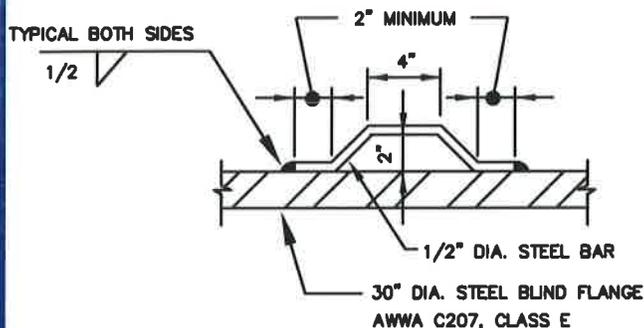

LIFTING HOOK DETAIL

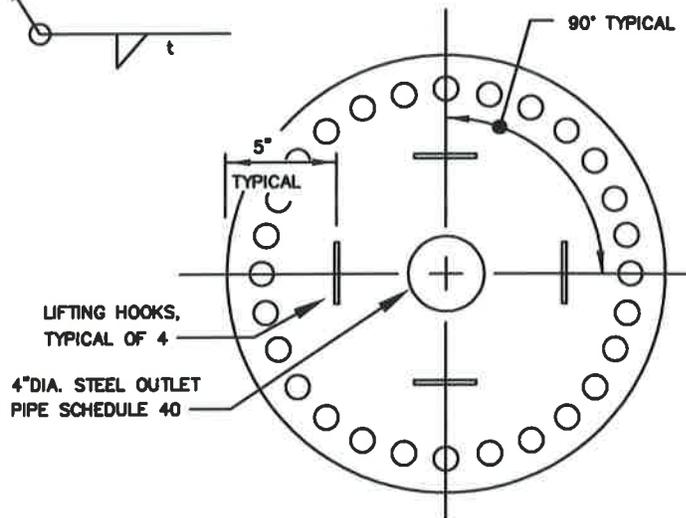

LIFTING HOOK LOCATION DETAIL



WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/29/16

Chief Engineer

STANDARD DETAIL
BLIND FLANGE DETAILS
FOR
ENTRY PORT VAULTS

W
10.4

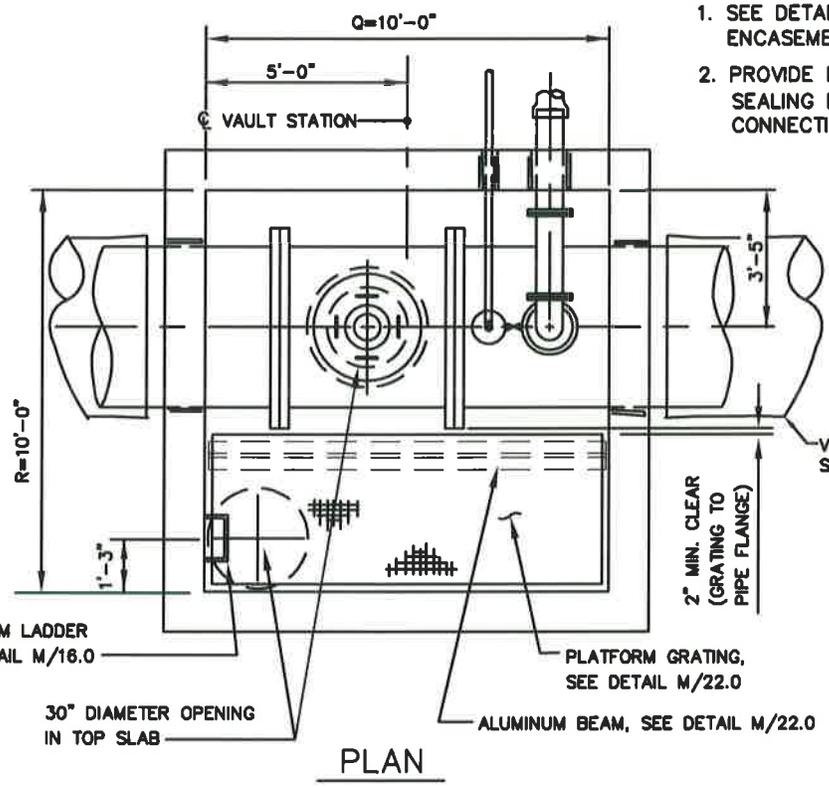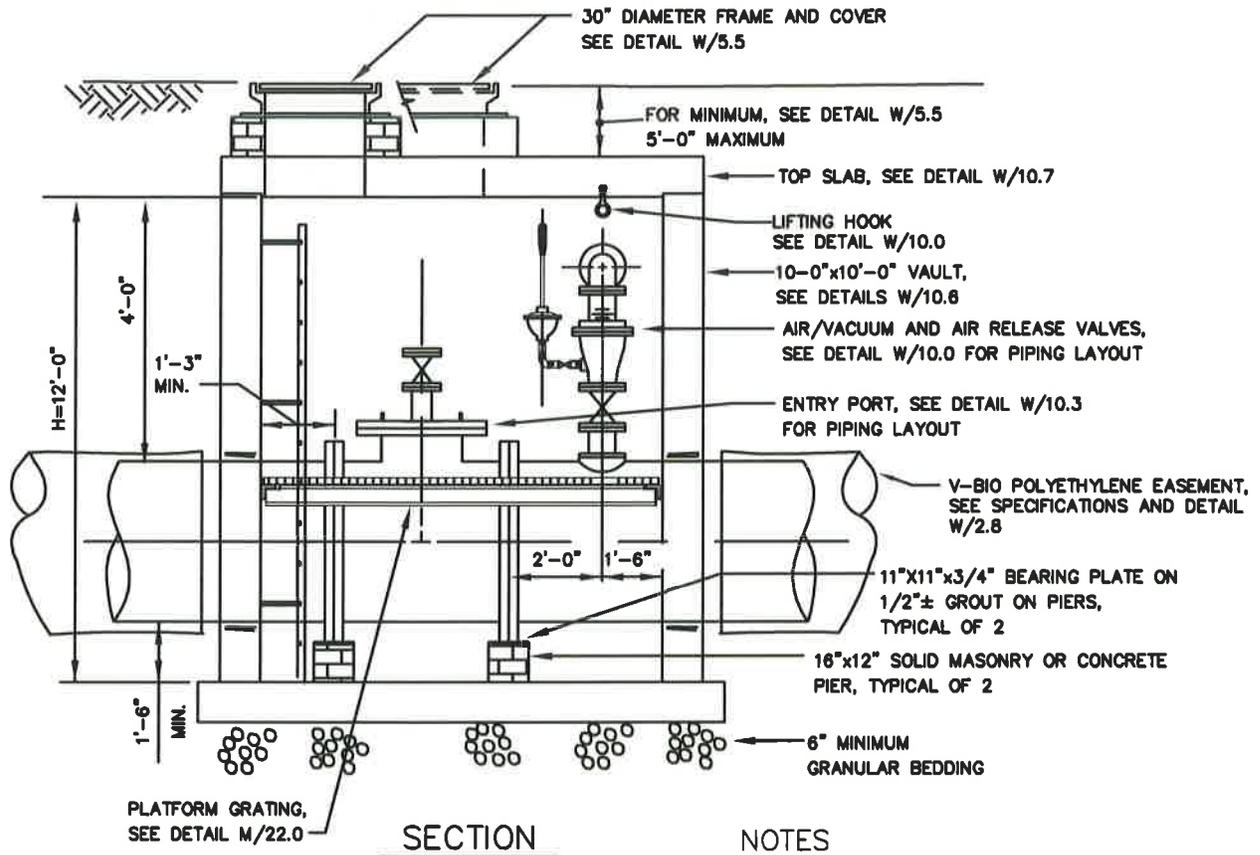

NOTES

1. SEE DETAIL W/2.8 FOR V-BIO POLYETHYLENE ENCASMENT AT CONCRETE INTERFACE.
2. PROVIDE RUBBER ANNUAL HYDROSTATIC SEALING DEVICES FOR PIPE THROUGH WALL CONNECTIONS, SEE SPECIFICATIONS.


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 7/29/16

Chief Engineer

STANDARD DETAIL
AIR/VACUUM VALVE VAULT
AND ENTRY PORT VAULT
FOR 36" TO 48"
DIAMETER PIPES

W
10.5

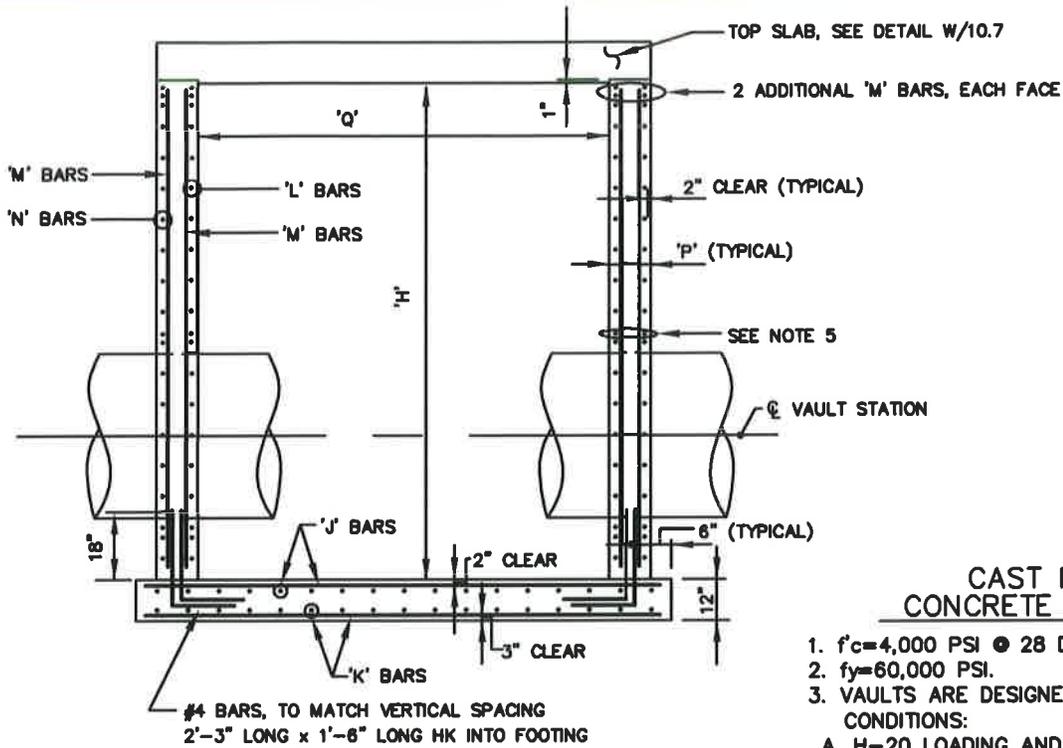


SECTION

H	Q	R	P	J	K	L	M	N
9'-6"	8'-0"	10'-0"	10"	#4@9"	#5@12"	#6@8"	#4@10"	#5@10"
12'-0"	10'-0"	10'-0"	12"	#4@10"	#5@10"	#6@7"	#4@9"	#5@7"

CAST IN PLACE CONCRETE VAULT NOTES:

1. $f'_c=4,000$ PSI @ 28 DAYS.
2. $f_y=60,000$ PSI.
3. VAULTS ARE DESIGNED FOR THE FOLLOWING CONDITIONS:
 - A. H-20 LOADING AND 1'-0" COVER PLUS IMPACT. (WATER TABLE 4'-0" BELOW FINISHED GRADE)
 - B. 5'-0" COVER AND 2'-0" SURCHARGE. (WATER TABLE 4'-0" BELOW FINISHED GRADE)
4. CONTRACTOR MAY USE PRECAST VAULT. SEE SPECIFICATIONS FOR SUBMITTAL REQUIREMENTS.
5. PROVIDE REQUIRED ADDITIONAL 'L', 'M' AND 'N' BARS AROUND ALL PIPE PENETRATIONS.
6. FOR PIPE CONFIGURATION AND ADDITIONAL DETAILS, SEE DETAILS W/10.3 AND W/10.5.
7. PROVIDE RUBBER ANNUAL HYDROSTATIC SEALING DEVICES FOR PIPE THROUGH WALL CONNECTIONS, SEE SPECIFICATIONS.

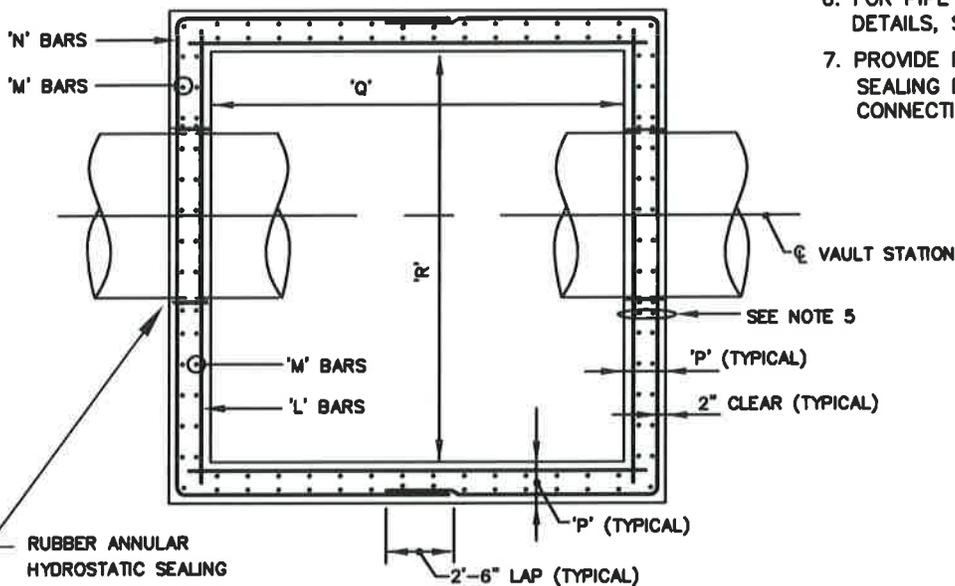

PLAN


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/29/16

Chief Engineer

STANDARD DETAIL
CONCRETE VAULT
FOR ENTRY PORTS


W
10.6

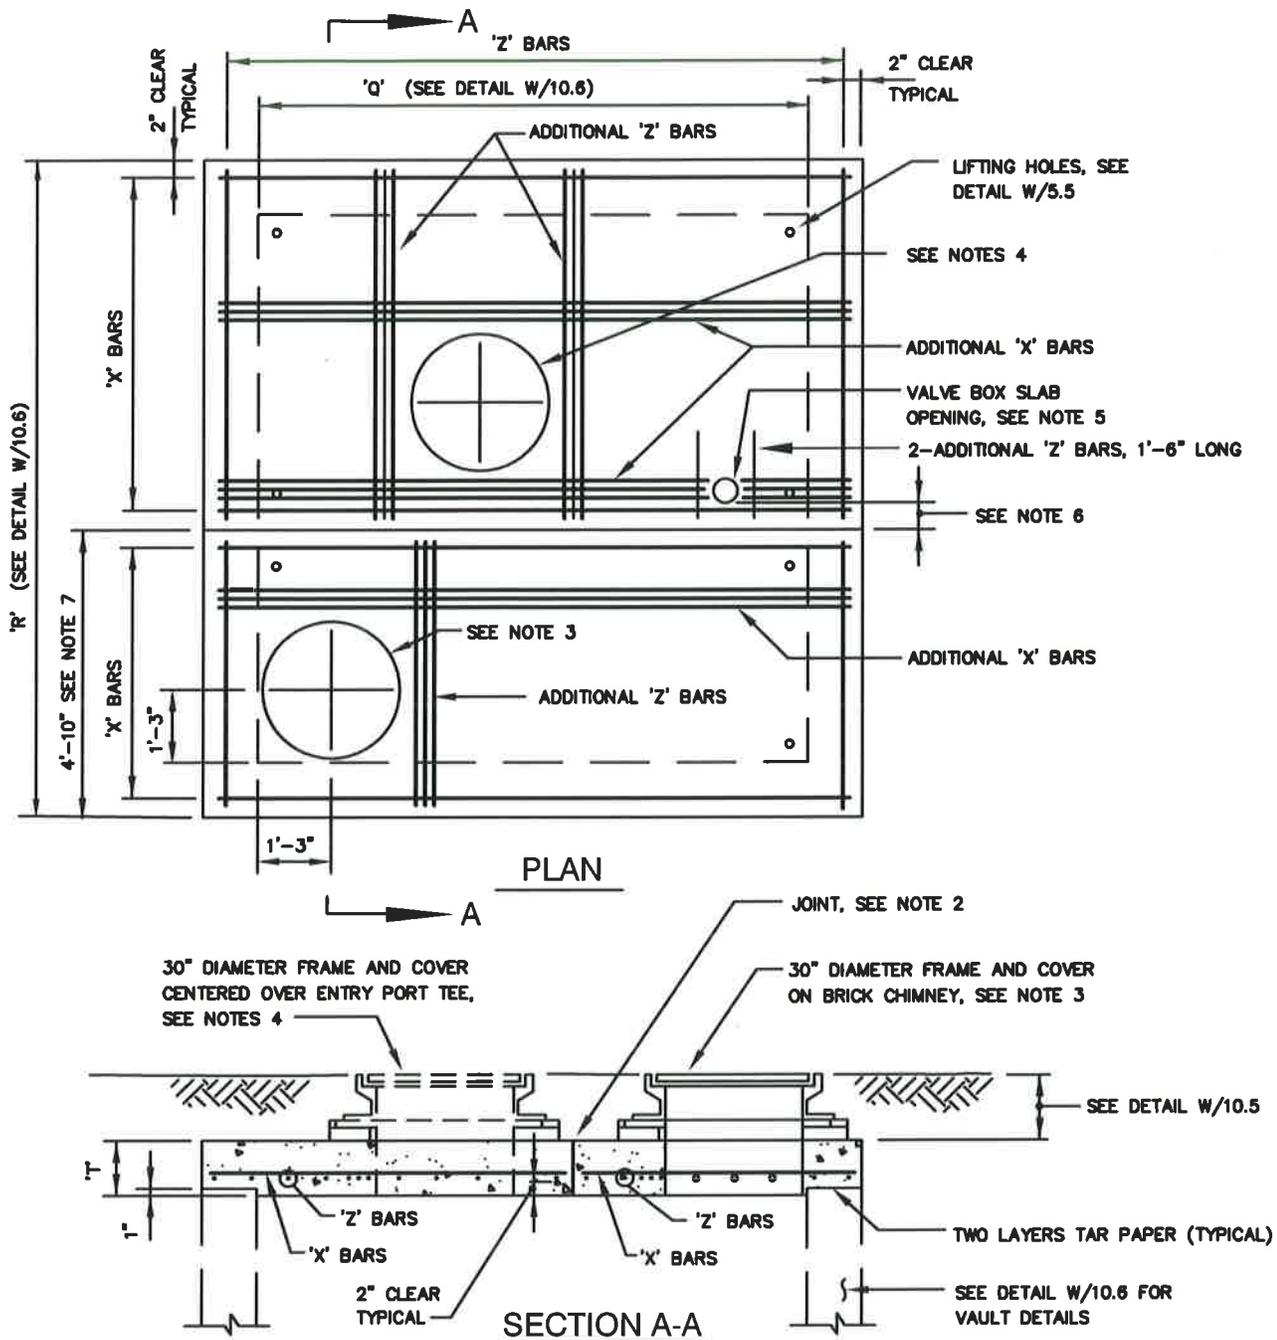

NOTES:


1. FOR CAST IN PLACE CONCRETE TOP SLAB THICKNESS AND REINFORCING, SEE DETAIL W/5.21.
2. FOR JOINT, LIFTING HOLES AND FRAME AND COVER DETAIL, SEE W/5.5.
3. PROVIDE 30" OPENING IN TOP SLAB, SEE DETAIL W/5.5.
4. PROVIDE 30" OPENING IN TOP SLAB, CENTERED OVER ENTRY PORT TEE, SEE DETAIL W/5.5.
5. FOR AIR/VACUUM AND ENTRY PORT VAULTS, ONLY, CENTER 5" DIAMETER OPENING OVER OPERATING NUT OF VALVE FOR AIR/VACUUM VALVE. SEE DETAIL W/5.5.
6. PROVIDE MINIMUM 4" CLEAR, BETWEEN 5" DIAMETER OPENING AND SLAB JOINT.
7. IF MINIMUM 4" CLEAR, AS SPECIFIED IN NOTE 6, CAN NOT BE MET, THE CONTRACTOR SHALL SUBMIT WORKING DRAWINGS FOR TOP SLAB DESIGN.
8. CONTRACTOR MAY USE PRECAST TOP SLAB, SEE SPECIFICATIONS FOR SUBMITTAL REQUIREMENTS.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED: 9/29/16

Chief Engineer

STANDARD DETAIL
CAST IN PLACE TOP
SLAB REINFORCING FOR
AIR/VACUUM VALVE VAULT
AND ENTRY PORT VAULTS

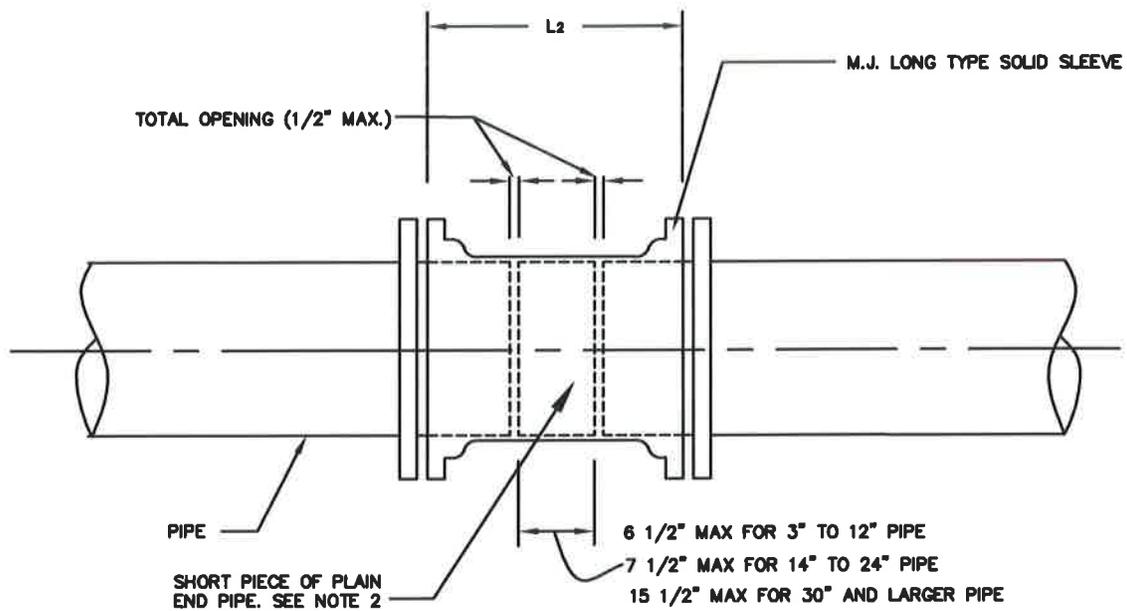W
10.7

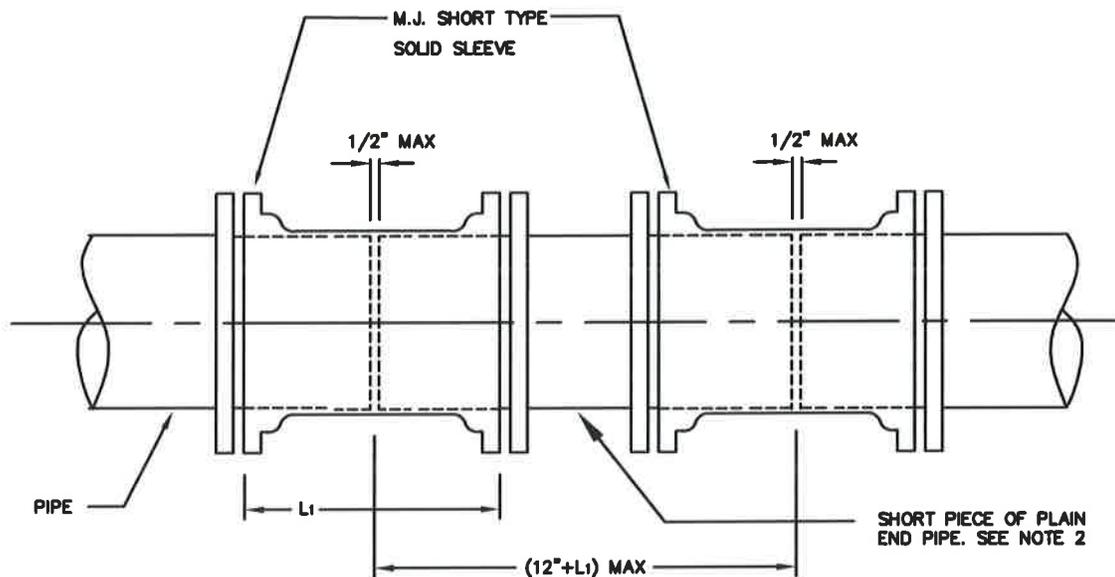

MECHANICAL JOINT SOLID SLEEVE (LONG TYPE)




MECHANICAL JOINT TWO SOLID SLEEVES (SHORT TYPE)

NOTES:

1. FOR L₁ & L₂ DIMENSIONS, SEE AWWA C110 AND C153 FOR MECHANICAL JOINT SLEEVES (L₂ FOR LONG TYPE AND L₁ FOR SHORT TYPE).
2. TO BE CUT FROM THE SAME TYPE AND SIZE OF PIPE BEING SLEEVED.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED:

9/29/16

Chief Engineer

STANDARD DETAIL


PIPE CLOSURE
JOINT DETAIL
USING MJ SOLID SLEEVES

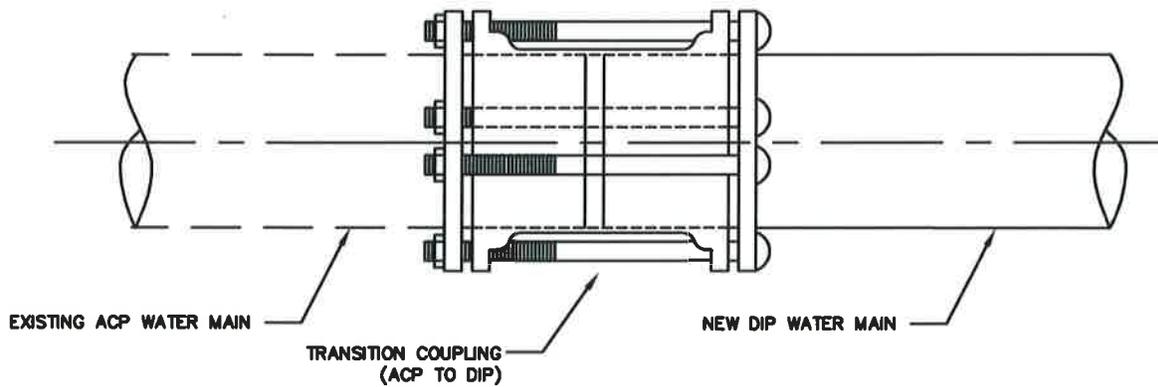
W
11.0




NOTES:

1. LOCATE END OF EXISTING ACP WATER MAIN. VERIFY OD OF EXISTING ACP WATER MAIN, WITH OD TOLERANCES OF COUPLING MANUFACTURER BEFORE REMOVING EXISTING WATER MAIN TO BE REPLACED.
2. TO BE CUT FROM THE SAME TYPE AND SIZE OF PIPE BEING SLEEVED.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/29/16</u>  Chief Engineer	STANDARD DETAIL PIPE CLOSURE JOINT DETAIL FOR EXIST. ACP WATER MAINS	$\frac{W}{11.1}$
--	---	---	------------------

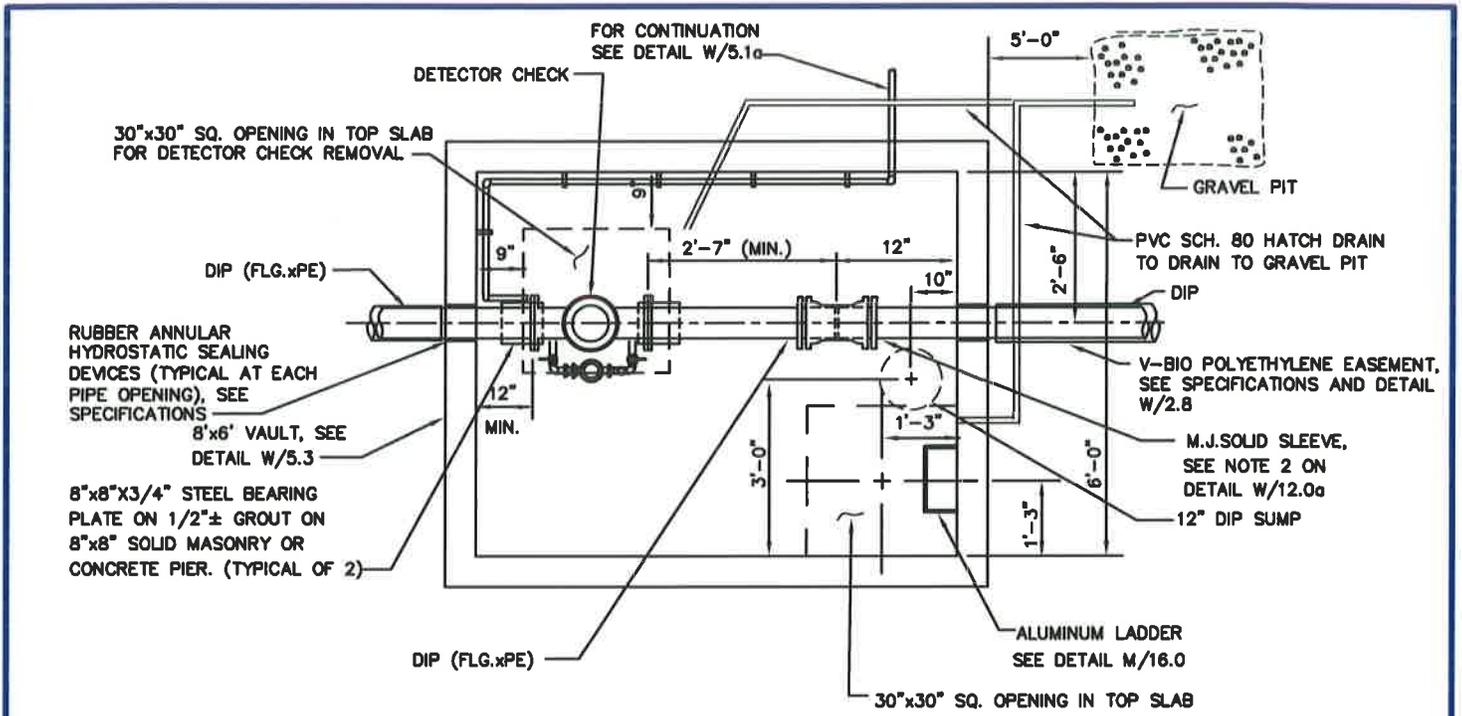

PLAN

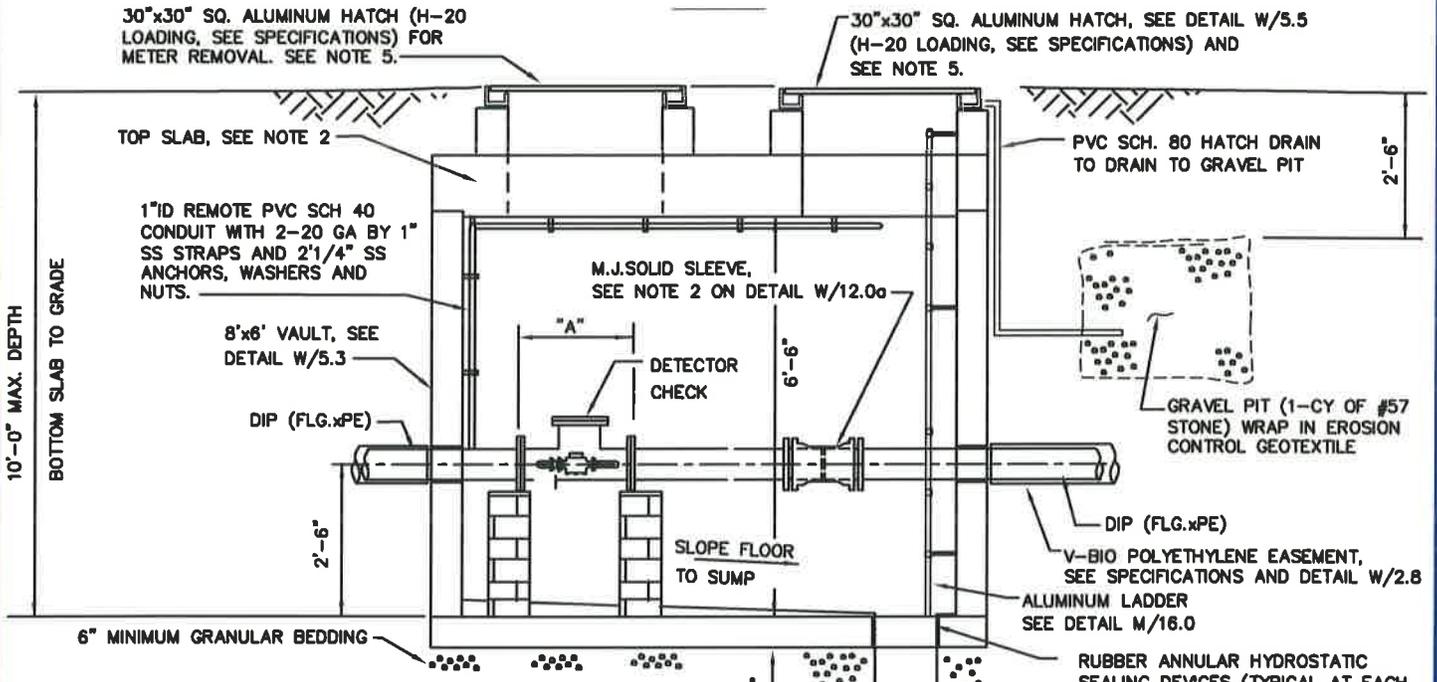


ELEVATION

NOTES:

1. FOR PIPE AND DETECTOR CHECK SIZES, PIPING LAYOUT AND NOTES, SEE DETAILS W/12.0a.
2. FOR TOP SLAB DETAILS, SEE DETAIL W/5.24.
3. FOR DIMENSION "A", SEE DETAIL W/12.0a.
4. FOR LOCATION OF BY-PASS PIPING, SEE DETAIL W/12.0a.
5. IF VAULT IS LOCATED IN TRAFFIC AREA, USE 30" DIA. FRAME AND COVER AND SEE DETAILS W/5.5 AND W/5.0e.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>9/29/16</u> Chief Engineer	STANDARD DETAIL 4-INCH, 6-INCH, 8-INCH AND 10-INCH DETECTOR CHECK VAULT FOR THE REPLACEMENT OF EXISTING DETECTOR CHECK ONLY	$\frac{W}{12.0}$
--	--	--	------------------

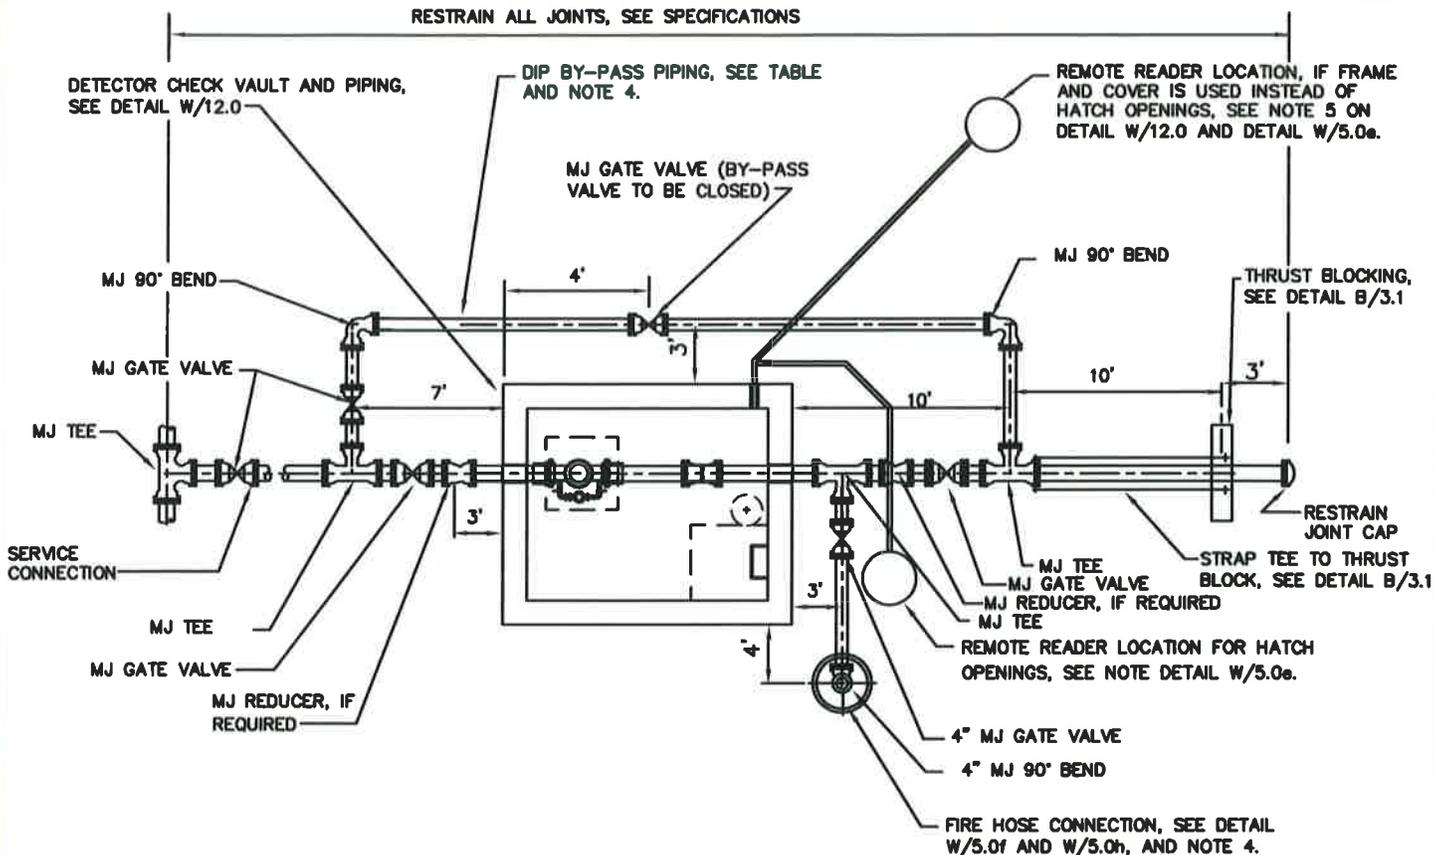

**PLAN - DETECTOR CHECK VAULTS
TYPICAL PIPING LAYOUT**

NOTES:

1. FOR DETECTOR CHECK VAULT AND PIPING DETAILS, SEE DETAIL W/12.0.
2. PROVIDE M.J. SOLID SLEEVE WHERE SHOWN WITH WEDGE ACTION RESTRAINER GLAND, SEE SPECIFICATIONS. TOLERANCE BETWEEN PIPE ENDS SHALL NOT EXCEED 1/2". DO NOT USE PIPE SPACERS, SEE SPECIFICATIONS.
3. ONLY DUCTILE IRON PIPE AND FITTINGS ONLY, EXCEPT AS NOTED. SEE DRAWINGS FOR SIZES.
4. RESTRAIN ALL JOINTS DIP BY-PASS PIPING, FROM TEE TO TEE WITH WEDGE ACTION RESTRAINER GLANDS, SEE SPECIFICATIONS. RESTRAIN ALL JOINTS ON FIRE HOSE CONNECTION WITH WEDGE ACTION RESTRAINER GLANDS, SEE SPECIFICATIONS.
5. PROVIDE EXTENSION STEMS AND VALVE BOXES FOR ALL BURIED VALVES, SEE DETAIL W/2.2.
6. POLYETHYLENE ENCASUREMENT FOR ALL DUCTILE IRON PIPE AND FITTINGS. SEE DETAIL W/2.8 AT CONCRETE INTERFACE.
7. PROVIDE RUBBER ANNULAR HYDROSTATIC SEALING DEVICES FOR ALL PIPE THROUGH WALL CONNECTIONS, SEE SPECIFICATIONS.

BY-PIPE SIZE	
DETECTOR CHECK SIZE	BY-PASS PIPE SIZE
4"	4"
6"	6"
8"	8"
10"	10"

"A" DIMENSION (SEE DETAIL W/12.0)	
DETECTOR CHECK SIZE	"A" (LENGTH OF METER)
4"	15"
6"	21"
8"	25"
10"	28.75"


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/29/16

Chief Engineer

STANDARD DETAIL
DETECTOR CHECK VAULT PIPING
LAYOUT FOR REPLACEMENT OF
EXISTING DETECTOR CHECK
VAULTS ONLY

W
12.0a

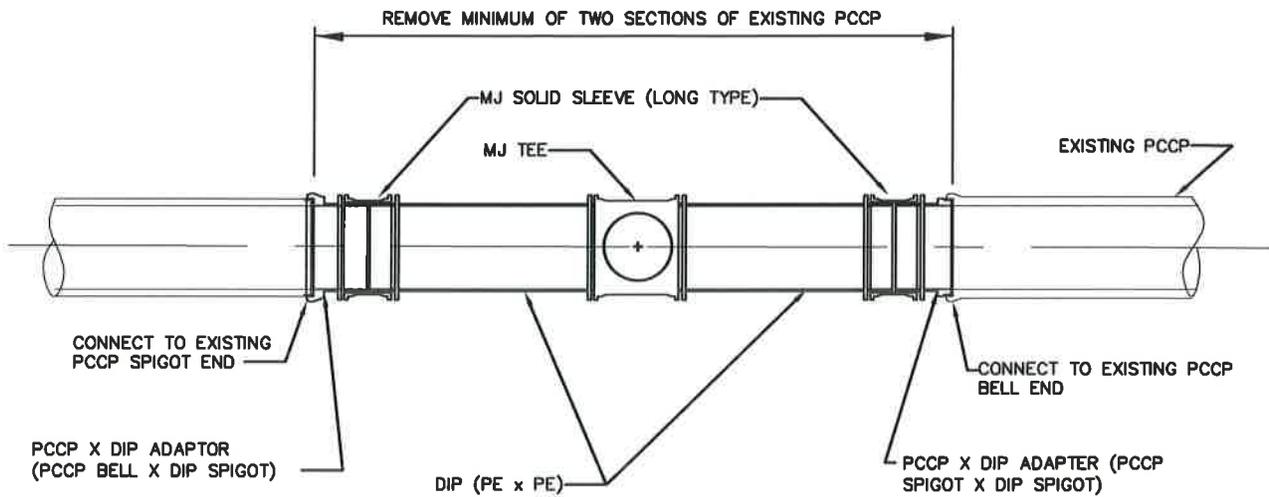

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:


9/29/16

Chief Engineer

STANDARD DETAIL

CONNECTING TO EXISTING
PCCP WATER MAINS
USING DUCTILE IRON TEE

W
13.0

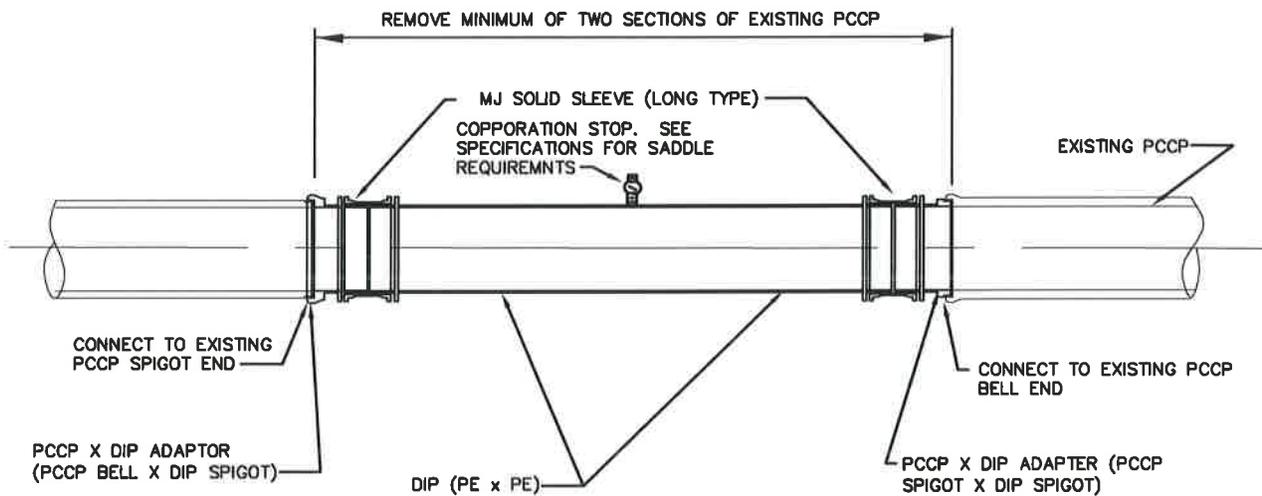

WASHINGTON
SUBURBAN
SANITARY
COMMISSION


APPROVED:

9/29/16


Chief Engineer

STANDARD DETAIL
CONNECTING TO EXISTING
PCCP WATER MAINS
FOR 2" AND SMALLER
WATER SERVICE

W
13.1

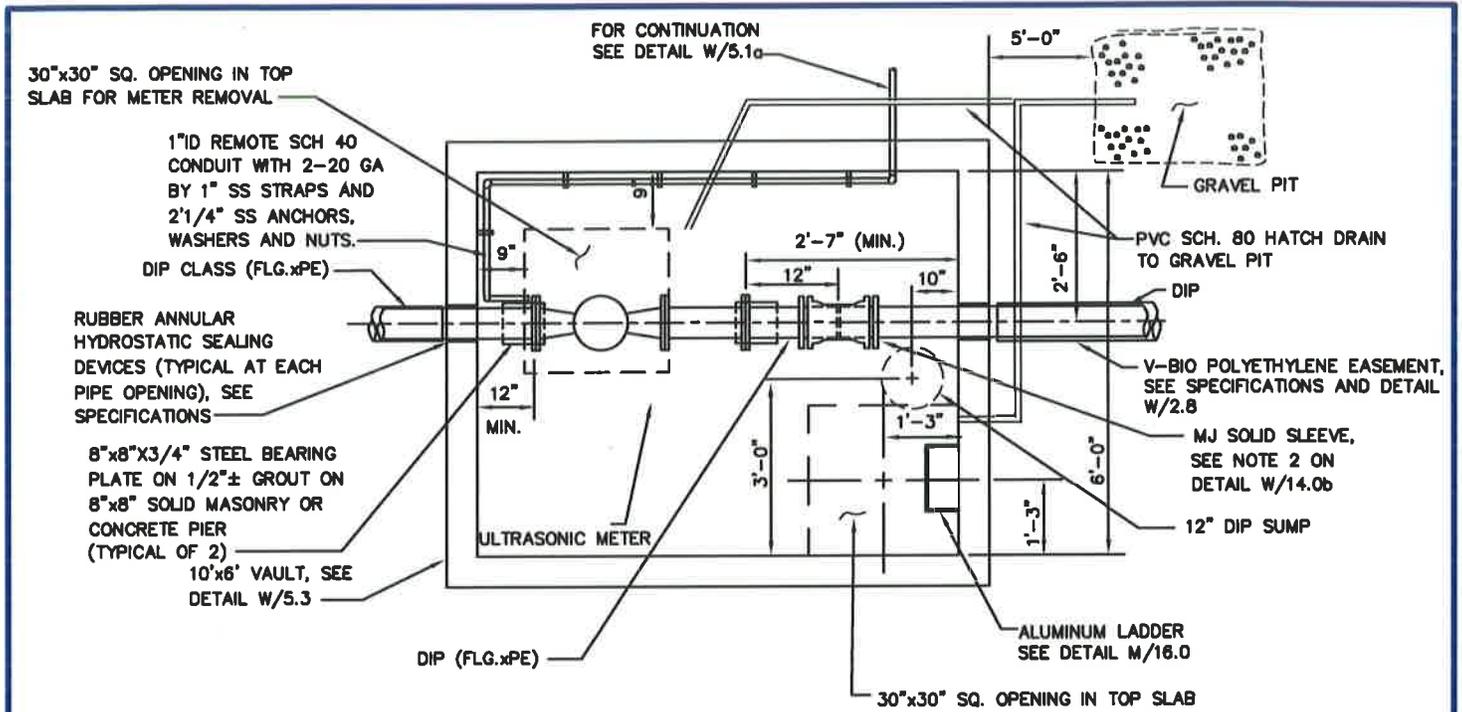

PLAN

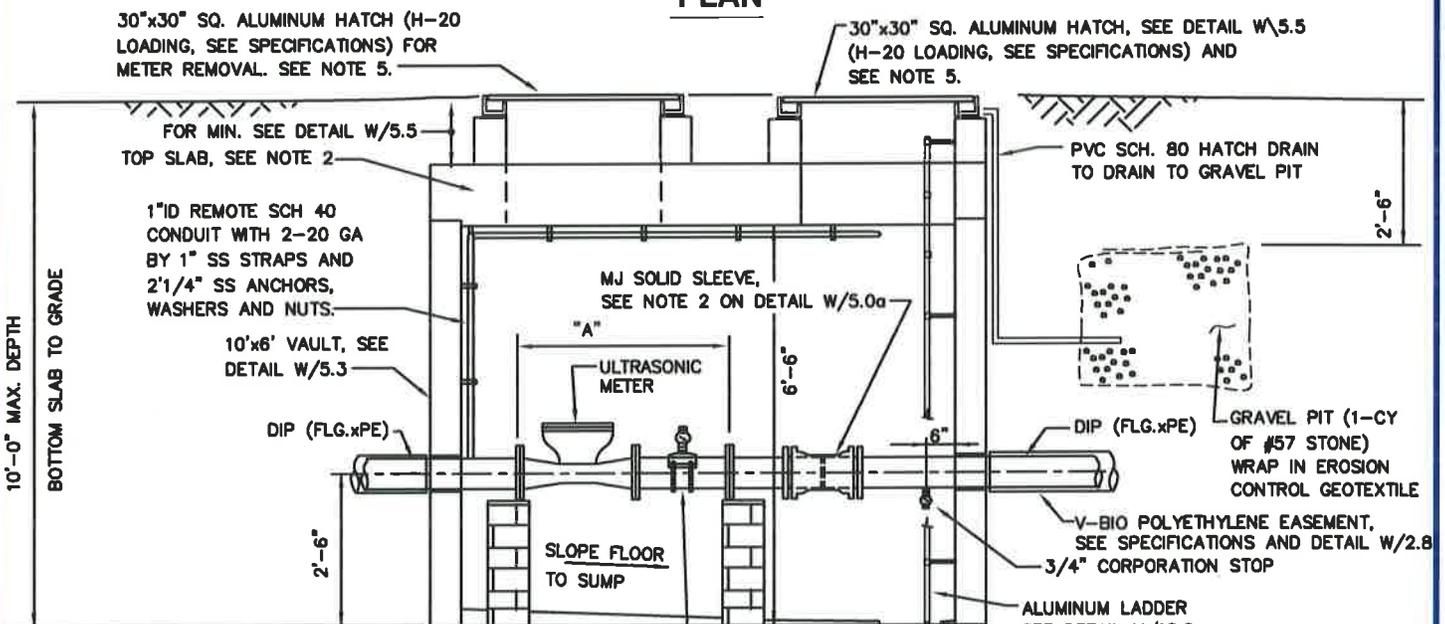

ELEVATION

NOTES:

1. FOR PIPE AND ULTRASONIC METER SIZES, PIPING LAYOUT AND NOTES, SEE DETAIL W/14.0b.
2. FOR TOP SLAB DETAILS, SEE DETAIL W/5.25.
3. FOR DIMENSION "A", SEE DETAIL W/14.0b.
4. FOR LOCATION OF BY-PASS PIPING, SEE DETAIL W/14.0b.
5. IF VAULT LOCATION IS LOCATED IN TRAFFIC AREA, USE 30" DIA. FRAME AND COVER AND SEE DETAIL W/14.0b.
6. FOR 12" DIP, USE 10" ULTRASONIC METER WITH 12" SERVICE CONNECTION AND 12" BY-PASS PIPING.

STANDARD DETAIL

10-INCH
ULTRASONIC METER VAULT


W
14.0a

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:

9/29/16

Chief Engineer

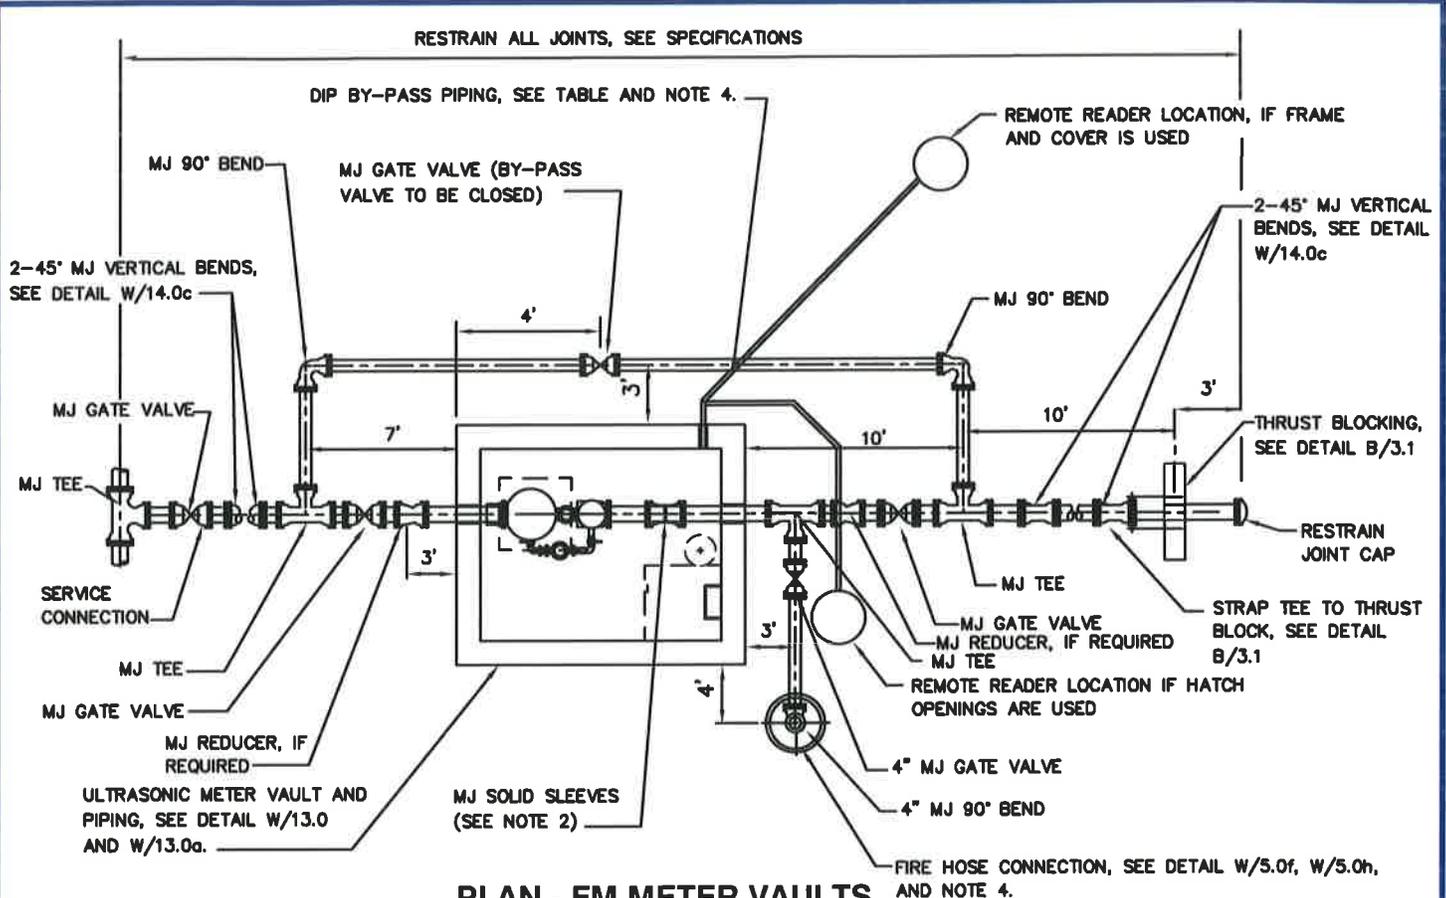

**PLAN - FM METER VAULTS
TYPICAL PIPING LAYOUT**

NOTES:

1. FOR ULTRASONIC METER VAULT AND PIPING DETAILS, SEE DETAIL W/14.0 AND W/14.0a
2. PROVIDE M.J. SOLID SLEEVE WHERE SHOWN WITH WEDGE ACTION RESTRAINER GLAND, SEE SPECIFICATIONS. TOLERANCE BETWEEN PIPE ENDS SHALL NOT EXCEED 1/2". DO NOT USE PIPE SPACERS, SEE SPECIFICATIONS.
3. ONLY DUCTILE IRON PIPE AND FITTINGS, EXCEPT AS NOTED. SEE DRAWINGS FOR SIZES.
4. RESTRAIN ALL JOINTS ON BY-PASS PIPING FROM TEE TO TEE WITH WEDGE ACTION RESTRAINER GLANDS, SEE SPECIFICATION. RESTRAIN ALL JOINTS ON FIRE HOSE CONNECTION WITH WEDGE ACTION RESTRAINER GLANDS, SEE SPECIFICATION.
5. PROVIDE EXTENSION STEMS AND VALVE BOXES FOR ALL BURIED VALVES, SEE DETAIL W/2.2.
6. POLYETHYLENE ENCASUREMENT FOR ALL DUCTILE IRON PIPE AND FITTINGS. SEE DETAIL W/2.8 FOR CONCRETE INTERFACE.
7. PROVIDE RUBBER ANNULAR HYDROSTATIC SEALING DEVICES FOR ALL PIPE THROUGH WALL CONNECTIONS, SEE SPECIFICATIONS.
8. WHEN 12" ULTRASONIC METERS ARE REQUIRED, USE 10" ULTRASONIC, SEE W/14.0b. SERVICE PIPING AND BY-PASS SHALL BE 12"DIA.

BY-PIPE SIZE	
FM METER SIZE	BY-PASS PIPE SIZE
4"	4"
6"	6"
8"	8"
10"	10"

"A" DIMENSION (SEE DETAIL W/14.0 and W/14.0a)	
FM METER SIZE	"A" (LENGTH OF METER)
4"	33"
6"	45"
8"	53"
10"	68"


WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/29/16

Chief Engineer

STANDARD DETAIL
4-INCH, 6-INCH AND 8-INCH
ULTRASONIC METER VAULT
PIPING LAYOUT

W
14.0b

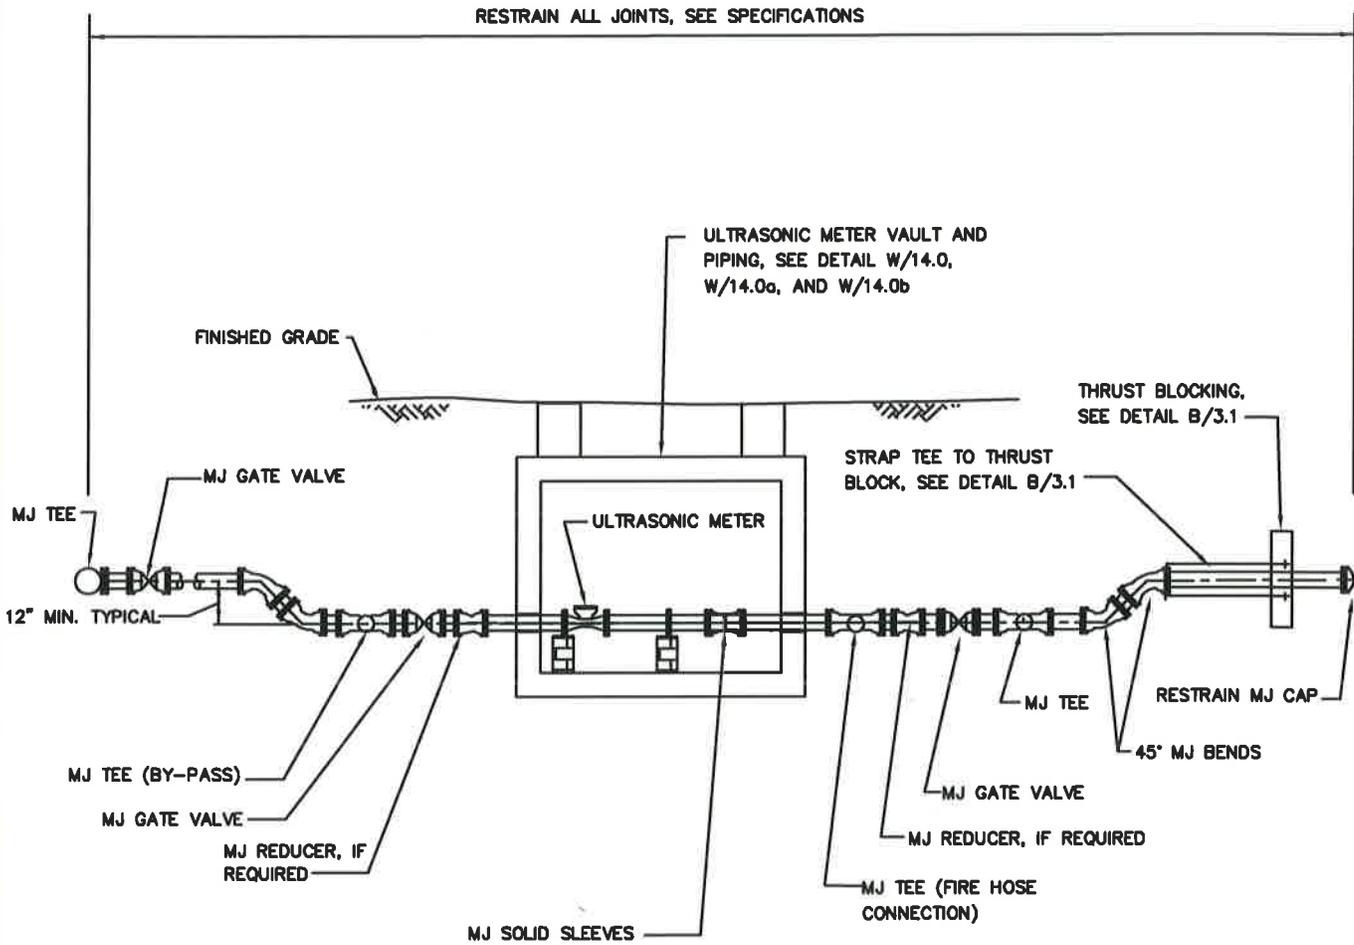

ELEVATION

FOR NOTES SEE DETAIL W/14.0, W/14.0a AND W/14.0b

<p>WASHINGTON SUBURBAN SANITARY COMMISSION</p>	<p>APPROVED: <u>9/29/16</u>  Chief Engineer</p>	<p>STANDARD DETAIL 4-INCH, 6-INCH, 8-INCH, AND 10-INCH ULTRASONIC METER VAULT PIPING LAYOUT</p>	<p>W 14.0c</p>
--	--	---	--------------------